



MID-CENTURY MODERN ACCESSORY DWELLING UNIT - PLAN 3A SAN LUIS OBISPO COUNTY, CA

USER LICENSE AGREEMENT

BY USING THESE PERMIT READY ACCESSORY DWELLING UNIT CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE, HOLD HARMLESS, AND INDEMNIFY THE COUNTY OF SAN LUIS OBISPO, ITS ELECTED OFFICIALS AND EMPLOYEES, RRM DESIGN GROUP, AND THE ARCHITECT OR ENGINEER WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.

THE PLANS ATTACHED HERE ARE APPROVED FOR ONLY USE IN SAN LUIS OBISPO COUNTY, NO DEVIATIONS, ALTERATIONS, OR OPTIONS BEYOND THOSE SPECIFICALLY INDICATED IN THE PLANS ARE ALLOWED WITHOUT PRIOR APPROVAL BY THE ISSUING JURISDICTION AND CHIEF BUILDING OFFICIAL. ANY UNAPPROVED PLAN MODIFICATIONS MAY BE DEVELOPED THROUGH RRM DESIGN GROUP AND THE APPROVING JURISDICTION IF REQUIRED.

SIGNATURE _____ DATE _____

SHEET INDEX

| | |
|-------|---|
| G-031 | TITLE SHEET - PLAN 3A |
| G-101 | GENERAL NOTES |
| G-102 | INDEX, ABBREVIATIONS, & SYMBOLS |
| G-103 | 2022 SINGLE-FAMILY RESIDENTIAL MANDATORY REQUIREMENTS |
| G-201 | CAL GREEN RESIDENTIAL REQUIREMENTS |
| G-202 | CAL GREEN RESIDENTIAL REQUIREMENTS |

AS-103 ARCHITECTURAL SITE PLAN (EXAMPLE & INSTRUCTIONS)

| | |
|--------|--|
| A3-101 | FLOOR PLAN |
| A3-111 | FINISH, MECHANICAL, & ELECTRICAL PLANS |
| A3-121 | ROOF PLAN & REFLECTED CEILING PLAN |
| A3-201 | ELEVATIONS & BUILDING SECTIONS |

| | |
|-------|------------------------------|
| A-901 | ARCHITECTURAL DETAILS |
| A-902 | ARCHITECTURAL DETAILS |
| A-903 | ARCHITECTURAL DETAILS |
| A-911 | ARCHITECTURAL DETAILS |
| A-912 | ARCHITECTURAL DETAILS - ROOF |

| | |
|-------|---|
| S-101 | SHEET INDEX, ABBREVIATIONS & SYMBOLS |
| S-102 | GENERAL NOTES |
| S-103 | GENERAL NOTES, SPECIAL INSPECTION & TESTS |
| S-201 | FOUNDATION PLAN - MID-CENTURY MODERN |
| S-202 | ROOF FRAMING PLAN - MID-CENTURY MODERN |
| S-301 | TYPICAL CONCRETE DETAILS |
| S-311 | CONCRETE DETAILS |
| S-312 | CONCRETE DETAILS |
| S-401 | TYPICAL WOOD DETAILS |
| S-402 | TYPICAL WOOD DETAILS |
| S-403 | TYPICAL WOOD DETAILS |
| S-404 | TYPICAL WOOD DETAILS |
| S-421 | ROOF FRAMING DETAILS |
| S-422 | ROOF FRAMING DETAILS |

| | |
|-----------|-----------------------------|
| T24 - 301 | ENERGY COMPLIANCE - PLAN 3A |
| T24 - 302 | ENERGY COMPLIANCE - PLAN 3A |
| T24 - 303 | ENERGY COMPLIANCE - PLAN 3A |
| T24 - 304 | ENERGY COMPLIANCE - PLAN 3A |
| T24 - 313 | ENERGY COMPLIANCE - PLAN 3 |

Grand total: 35

SPECIAL INSTRUCTIONS REQUIRED

OWNER/APPLICANT HAS COMPLETED SPECIAL INSPECTION FORM

OWNER/APPLICANT SIGNATURE: _____
SEE SHEET S-103 FOR REQUIRED SPECIAL INSPECTIONS

A REGISTERED DESIGN PROFESSIONAL SHALL COMPLETE THE COUNTY OF SAN LUIS OBISPO STATEMENT OF REQUIRED SPECIAL INSPECTIONS CERTIFICATE (FORM BLD-1032) PRIOR TO PERMIT ISSUANCE. IDENTIFY THE TYPE OF WORK REQUIRING SPECIAL INSPECTIONS IN THE PLANS AND THE INDIVIDUALS OR FIRMS RESPONSIBLE FOR THE SPECIAL INSPECTION ELEMENT(S). FURTHER INSTRUCTIONS ARE IDENTIFIED IN THE STATEMENT OF SPECIAL INSPECTION AGREEMENT (FORM BLD-1031).

VICINITY MAP

*FOR PLANNING STAFF ONLY
INITIAL WHEN SECTION HAS BEEN REVIEWED. STAFF INITIALS: _____

(TO BE PROVIDED BY OWNER/APPLICANT)

PROJECT GENERAL NOTES

THESE NOTES APPLY TO ALL PORTIONS, PHASES AND SUBCONTRACTORS OF THIS PROJECT.

- APPLICABLE CODES AND STANDARDS:
- 2022 CALIFORNIA BUILDING CODE AND ITS APPENDICES AND STANDARDS.
 - 2022 CALIFORNIA PLUMBING CODE AND ITS APPENDICES AND STANDARDS.
 - 2022 CALIFORNIA MECHANICAL CODE AND ITS APPENDICES AND STANDARDS.
 - 2022 CALIFORNIA FIRE CODE AND ITS APPENDICES AND STANDARDS.
 - 2022 CALIFORNIA ELECTRICAL CODE AND ITS APPENDICES AND STANDARDS.
 - 2022 CALIFORNIA BUILDING ENERGY EFFICIENCY STANDARDS.
 - 2022 CALIFORNIA GREEN BUILDING STANDARDS CODE AND ITS APPENDICES AND STANDARDS.

CURRENT COUNTY OF SAN LUIS OBISPO MUNICIPAL CODE.

PROJECT DIRECTORY

*FOR PLANNING STAFF ONLY
INITIAL WHEN SECTION HAS BEEN REVIEWED. STAFF INITIALS: _____

APPLICANT (TO BE PROVIDED BY OWNER/APPLICANT)

ADDRESS: _____ PROJECT ADDRESS: _____

CONTACT: _____

EMAIL: _____

PHONE: _____

ARCHITECT

ADDRESS: 3765 S HIGUERA ST, SUITE 102
SAN LUIS OBISPO, CA 93401

CONTACT: RANDY RUSSOM

EMAIL: RWRUSSOM@RRMDESIGN.COM

PHONE: P:(805) 543-1794

SUPPORTING DOCUMENTS

*FOR PLANNING STAFF ONLY
INITIAL WHEN SECTION HAS BEEN REVIEWED. STAFF INITIALS: _____

UTILITY, GRADING, AND DRAINAGE PLAN TO BE PROVIDED BY OTHERS.
PLEASE PROVIDE THE WASTE RECYCLE FORM FILLED OUT AND SIGNED PRIOR TO ISSUANCE. THE OWNER/APPLICANT/CONTRACTOR/PERSON DOING THE WORK IS REQUIRED TO RECYCLE 75% OF ALL PROJECT CONSTRUCTION AND DEMOLITION DEBRIS.

ENERGY COMPLIANCE
PREPARED BY: _____ IN BALANCE GREEN CONSULTING
DATE PREPARED: _____ SEPTEMBER 27, 2023
JOB NUMBER: _____ CF1R-PRF-01E

HERS QII

HERS VCHP: HERS RATER WILL NEED TO FOLLOW THE VERIFICATION AND TESTING PROTOCOL FOR THE VARIABLE CAPACITY HEAT PUMP CREDIT REQUIREMENTS, INCLUDING BUT NOT LIMITED TO VERIFIED REFRIGERANT CHARGE, VERIFIED MINIMUM HSPF AND EER/SEER, AND CAPACITY, DUCTLESS INDOOR UNITS AND THE COMPONENTS ARE WITHIN THE CONDITIONED ENVELOPE, AND AIRFLOW PROVIDED TO ALL HABITABLE SPACES (BDRMS AND LIVING SPACE).

SOILS & FOUNDATIONS

*FOR PLANNING STAFF ONLY
INITIAL WHEN SECTION HAS BEEN REVIEWED. STAFF INITIALS: _____

NOTE: THESE PRE-APPROVED PLANS ARE INTENDED FOR FLAT LOTS, WITHOUT THE PRESENCE OF EXPANSIVE OR LIQUEFIABLE SOILS. THE BUILDING OFFICIAL SHALL MAKE THIS DETERMINATION PRIOR TO ISSUING THE PERMIT. A NOTE HAS BEEN ADDED TO THE FOUNDATION PLAN AND FOUNDATION NOTES TO CLEARLY OUTLINE THIS REQUIREMENT. PLEASE REFER TO GENERAL FOUNDATION NOTE 11 ON S-102 AND FOUNDATION PLAN NOTE 17 ON S-201.

PROJECT INFORMATION

*FOR PLANNING STAFF ONLY
INITIAL WHEN SECTION HAS BEEN REVIEWED. STAFF INITIALS: _____

PROJECT SCOPE:
1. CONSTRUCTION OF A NEW DETACHED ONE STORY 742 SF ACCESSORY DWELLING UNIT WITH 3 BEDROOMS AND 1 BATH.
2. ALL SITE WORK WITHIN THE PROPERTY LINE.
3. ALL THE WORK SHOWN IN THE DRAWINGS AND SPECIFICATIONS.

SITE INFORMATION (TO BE PROVIDED BY COUNTY OF SAN LUIS OBISPO):

STREET ADDRESS: _____

APN: _____

ZONING: _____

LOT SIZE: _____

LAND USE: _____

EXISTING USE: _____

PROPOSED USE: _____

FLOOR AREA RATIO (TO BE PROVIDED BY COUNTY OF SAN LUIS OBISPO)

MAXIMUM FAR: _____

PROPOSED FAR: _____

LOT COVERAGE (TO BE PROVIDED BY OWNER/APPLICANT)

BUILDING: _____

HARDSCAPE/PAVING: _____

LANDSCAPE: _____

SETBACKS (TO BE PROVIDED BY COUNTY OF SAN LUIS OBISPO)

| | | |
|--------|-----------------------|----------|
| FRONT: | REQUIRED | PROPOSED |
| REAR: | 4' - 0" (A.B. 110.02) | |
| SIDES: | 4' - 0" (A.B. 110.05) | |

BUILDING INFORMATION:

NUMBER OF STORIES: _____ 1

OCCUPANCY GROUP: _____ R-3 1 & 2 FAMILY DWELLINGS

CONSTRUCTION TYPE: _____ VB

SPRINKLERED: _____ SEE FIRE SPRINKLER SECTION ON SHEET

IF YES, A SEPARATE REVIEW/PERMIT IS REQUIRED FOR AUTO SPRINKLER SYSTEM DESIGN [CRC R313.3]

MAX. HEIGHT ALLOWED (PER CBC TABLE 504.3): _____ 16' - 0"

MAX. HEIGHT PROPOSED: _____ 16' - 0"

ROOF RATING: _____ REFER TO 'WILDLAND-URBAN INTERFACE FIRE AREA' AND 'FIRE HAZARD SEVERITY ZONE LEVEL'

HIGH FIRE ZONE: _____

UTILITIES

WATER AND SEWER SERVICE _____ COUNTY OF SAN LUIS OBISPO UTILITIES

ELECTRICAL SERVICE _____ PACIFIC GAS & ELECTRIC

GAS SERVICE _____ PACIFIC GAS & ELECTRIC

TELEPHONE SERVICE _____

GARBAGE SERVICE _____

CABLE SERVICE _____

BUILDING AREAS

AREAS - PLAN 3

| | |
|-------------------------------|--------|
| PLAN 3 - GROUND FLOOR | 742 SF |
| FRONT PORCH OPTION (EXTERIOR) | 93 SF |

PROJECT CHECKLIST

*FOR PLANNING STAFF ONLY
INITIAL WHEN SECTION HAS BEEN REVIEWED. STAFF INITIALS: _____

WASTE WATER SEWER SEPTIC *A SEPARATE REVIEW & PERMIT IS REQUIRED FOR SEPTIC.

FIRE SPRINKLERS

DOES THE PRIMARY RESIDENCE HAVE NFPA 13D SPRINKLERS?
 NO YES *IF YES, A SEPARATE REVIEW & PERMIT IS REQUIRED FOR AUTOMATIC SPRINKLER SYSTEM DESIGN [CRC R313.3]

REQUIRED AT PROPOSED ADU: COUNTY OF SAN LUIS OBISPO FIRE SPRINKLERS SYSTEM REQUIREMENTS FOR ADU BLD-3044

NO (NOT REQUIRED IF THE PRIMARY RESIDENCE IS UNSPRINKLERED)
 YES (REQUIRED IF THE PRIMARY RESIDENCE IS SPRINKLERED)

FIRE SPRINKLERS NOTES

- IF FIRE SPRINKLERS ARE REQUIRED AT PROPOSED ADU THEN THE FOLLOWING NOTES APPLY.
- AUTOMATIC FIRE SPRINKLER SYSTEM - AN AUTOMATIC FIRE SPRINKLER SYSTEM SHALL BE INSTALLED AS PER NFPA 13D THE MOST CURRENT EDITION. DETAILED SPRINKLER PLANS SHALL BE SUBMITTED TO THE FIRE PREVENTION BUREAU AND APPROVED PRIOR TO INSTALLATION. PLANS AND INSTALLATION MUST BE BY A C16 LICENSED SPRINKLER CONTRACTOR.
- SECTION 903.2.1 GROUP R AN AUTOMATIC SPRINKLER SYSTEM INSTALLED IN ACCORDANCE WITH SECTION 903.3 SHALL BE PROVIDED THROUGHOUT ALL BUILDINGS WITH A GROUP R FIRE AREA. THIS INCLUDES SINGLE FAMILY DWELLINGS, MULTI-FAMILY DWELLINGS AND ALL "SITE-TYPE" CARE FACILITIES REGARDLESS OF OCCUPANT LOAD.
- SECTION 903.2.1.1 ADDITIONS AN AUTOMATIC SPRINKLER SYSTEM INSTALLED IN ACCORDANCE WITH 903.3 MAY BE REQUIRED TO BE INSTALLED THROUGHOUT STRUCTURES WHEN THE ADDITION IS MORE THAN 50% OF THE EXISTING BUILDING OR WHEN THE ALTERED BUILDING WILL EXCEED A FIRE FLOW OF 1,500 GALLONS PER MINUTE AS CALCULATED PER SECTION 907.3. THE FIRE CODE OFFICIAL MAY REQUIRE AN AUTOMATIC SPRINKLER SYSTEM BE INSTALLED IN BUILDINGS WHERE NO WATER MAIN EXISTS TO PROVIDE THE REQUIRED FIRE FLOW OR WHERE A SPECIAL HAZARD EXISTS SUCH AS: POOR ACCESS ROADS, GRADE, BLUFFS AND CANYON RIMS, HAZARDOUS BRUSH AND RESPONSE TIMES GREATER THAN 5 MINUTES BY A FIRE DEPARTMENT.
- SECTION 903.2.1.2 REMODELS OR RECONSTRUCTION AN AUTOMATIC SPRINKLER SYSTEM INSTALLED IN ACCORDANCE WITH SECTION 903.3 MAY BE REQUIRED IF THE SCOPE OF WORK INCLUDES SIGNIFICANT MODIFICATION TO THE INTERIOR AND/OR ROOF OF THE BUILDING, AND THE COST OF THE INSTALLATION DOES NOT EXCEED 15 PERCENT OF THE CONSTRUCTION COSTS OF THE REMODEL.
- LOCATION AND SIZE OF WATER SERVICE UNDERGROUND SHALL BE INSTALLED AS SHOWN ON APPROVED FIRE SPRINKLER PLANS. A MINIMUM 1 INCH WATER SHALL BE INSTALLED.
- A FIRE UNDERGROUND FLUSH CERTIFICATION SHALL BE REQUIRED AT FINAL INSPECTION.
- A HYDRO INSPECTION OF THE FIRE SPRINKLER SYSTEM IS REQUIRED PRIOR TO FRAME INSPECTION. ONLY THE NEW PIPING SHALL BE TESTED.

ONSITE PARKING REQUIRED

- NONE, EXCEPTION USED:
- THE ADU IS LOCATED WITHIN 1/2 MILE OF PUBLIC TRANSIT.
- OFF STREET PARKING PERMITS ARE REQUIRED BUT NOT OFFERED TO THE OCCUPANT OF THE ADU.
- WHEN THERE IS A CAR SHARE VEHICLE LOCATED WITHIN ONE BLOCK OF THE ADU.
- ONE PARKING SPACE (STUDIO OR 1-BEDROOM ADU)
- TWO PARKING SPACES (2-BEDROOM ADU)

WILDLAND-URBAN INTERFACE FIRE AREA

- PORTIONS OF THE COUNTY OF SAN LUIS OBISPO COUNTY ARE LOCATED IN WITHIN THE WILDLAND-URBAN INTERFACE FIRE AREA (AS DEFINED BY CRC R337.2).
 - AREA DEFINED BY STATE AS A "FIRE HAZARD SEVERITY ZONE" (FHSZ).
 - AREA DESIGNATED BY ENFORCING AGENCY TO BE AT A SIGNIFICANT RISK FROM WILDFIRES.
- MORE INFORMATION ABOUT FIRE HAZARD SEVERITY ZONES, INCLUDING AN INTERACTIVE MAP, BUILDING MATERIALS LISTINGS, AND WUI REQUIREMENTS CAN BE FOUND ON THE OFFICE OF THE STATE FIRE MARSHAL WEBSITE (HTTPS://OSFM.FIRE.CA.GOV).
- AN ADU WITHIN THE WILDLAND-URBAN INTERFACE FIRE AREA SHALL COMPLY WITH THE CRC SECTION R337.
- THIS PROTOTYPE PLAN PROVIDES DESIGNS THAT COMPLY WITH THE PROVISIONS REQUIRED BY THE CRC SECTION R337.

FIRE HAZARD SEVERITY ZONE LEVEL

- NONE MODERATE HIGH VERY HIGH
- IN ACCORDANCE WITH THE CFC SECTION 4904, STRUCTURES LOCATED IN THE VERY HIGH FIRE HAZARD SEVERITY ZONE SHALL PROVIDE & MAINTAIN A FUEL MODIFICATION ZONE. FUEL MODIFICATION ZONES: THE APPLICANT SHALL PROVIDE & MAINTAIN FIRE/FUEL BREAKS TO THE SATISFACTION OF THE LOCAL FIRE DEPARTMENT. FIRE/FUEL BREAKS SHALL BE SHOWN ON THE GRADING, MAP, AND BUILDING PLANS.

OPTIONS SELECTIONS

*OWNER OR APPLICANT REQUIRED TO PROVIDE SELECTIONS FOR EACH OF THE FOLLOWING CATEGORIES. ADDITIONALLY, OWNER/APPLICANT TO PROVIDE MANUFACTURER, COLOR/FINISH SPECIFICATIONS, & W.U.I. PRODUCT LISTING (WHEN APPLICABLE) IN THE MATERIALS LEGEND.
NOTE: OWNER/APPLICANT TO STRIKE THROUGH UNSELECTED OPTIONS THROUGHOUT THE PLAN SET WHEN APPLICABLE FOR CLARITY.

TRUSS SELECTION (SELECT ONE)
 A) RAISED CEILING TRUSS PACKAGE REF: 313134 B) FLAT CEILING TRUSS PACKAGE REF: 313133

FRONT PORCH (SELECT ONE) A) FRONT (COVERED) PORCH B) NO FRONT PORCH

RAKE & EAVE DETAILS (SELECT ONE) A) ENCLOSED B) OPEN EXPOSED

EXTERIOR RAKES, EAVES, & PORCH SOFFITS & OVERHANGS MATERIALS (MARK ALL THAT APPLY)

- A) 2X TOUNGE & GROOVED (SOLID SAWN LUMBER)
- B) FIBER CEMENT SOFFIT PANELS
- C) HARDBOARD SOFFIT PANELS
- D) EXT. GRADE FIRE RETARDANT TREATED SHEATHING

WALL COVERINGS (MARK ALL THAT APPLY)

NOTE: WALL COVERINGS TO MEET ALL REQUIREMENTS OF CRC R703.3. SEE CRC TABLE R703.3(1) FOR MIN. ATTACHMENT AND MIN. THICKNESS REQUIREMENTS.

- E) FIBER CEMENT HORIZONTAL LAP SIDING
- F) EXT. GRADE WOOD HORIZONTAL LAP SIDING

EXTERIOR TRIM ELEMENTS (SELECT ONE) A) FIBER CEMENT B) EXT. GRADE WOOD

BASE TRIM 24/A-901 (SELECT ONE) A) YES B) NO

EXTERIOR LIGHT (SELECT ONE) A) LNC - MODERN B) LUTEC BARN LIGHT


DOOR MATERIAL (SELECT ONE)

- A) VINYL B) FIBERGLASS C) WOOD D) ALUMINUM CLAD WOOD

WINDOW MATERIAL (SELECT ONE)

- A) VINYL B) FIBERGLASS C) WOOD D) ALUMINUM CLAD WOOD

DECORATIVE FAUX GABLE VENTS (SELECT ONE) A) NO B) YES LABEL LOCATIONS ON ELEV.



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRACT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA
TITLE SHEET - PLAN 3A

APPROVED SET
DATE
09/28/2023
SHEET
G-031

PROJECT GENERAL NOTES

- ALL WORK DESCRIBED IN THE DRAWINGS SHALL BE VERIFIED FOR DIMENSION, GRADE, EXTENT AND COMPATIBILITY WITH EXISTING SITE CONDITIONS. ANY DISCREPANCIES AND UNEXPECTED CONDITIONS THAT AFFECT OR CHANGE THE WORK DESCRIBED IN THE CONTRACT DOCUMENTS SHALL BE BROUGHT TO THE ARCHITECT'S ATTENTION IMMEDIATELY. DO NOT PROCEED WITH THE WORK IN THE AREA OF DISCREPANCIES UNTIL ALL SUCH DISCREPANCIES ARE RESOLVED. IF THE CONTRACTOR CHOOSES TO DO SO, HE/SHE SHALL BE PROCEEDING AT HIS/HER OWN RISK.
- DIMENSIONS SHOWN SHALL TAKE PRECEDENCE OVER DRAWING SCALE OR PROPORTION. LARGER SCALE DRAWINGS SHALL TAKE PRECEDENCE OVER SMALLER SCALE DRAWINGS.
- IN THE EVENT OF THE UNFORESEEN ENCOUNTER OF MATERIALS SUSPECTED TO BE OF AN ARCHAEOLOGICAL OR PALEONTOLOGICAL NATURE, ALL GRADING AND EXCAVATION SHALL CEASE IN THE IMMEDIATE AREA AND THE CONTRACTOR SHALL NOTIFY THE OWNER. THE FIND SHALL BE LEFT UNTOUCHED UNTIL AN EVALUATION BY A QUALIFIED ARCHAEOLOGIST OR PALEONTOLOGIST IS MADE.
- CONTRACTOR IS TO BE RESPONSIBLE FOR BEING FAMILIAR WITH THESE DOCUMENTS INCLUDING ALL CONTRACT REQUIREMENTS.
- GRADING PLANS, DRAINAGE IMPROVEMENTS, ROAD AND ACCESS REQUIREMENTS AND ENVIRONMENTAL HEALTH CONSIDERATIONS SHALL COMPLY WITH ALL LOCAL ORDINANCES.
- FIRE SPRINKLER SHOP DRAWINGS & CALCULATIONS SHALL BE SUBMITTED TO BUILDING DEPT. & APPROVED BY FIRE DEPT. PRIOR TO INSTALLATION.
- SHOP WELDS MUST BE PERFORMED BY A LICENSED FABRICATORS SHOP.
- THE FOLLOWING ITEMS SHOWN ON THE DRAWINGS ARE OWNER PROVIDED, OWNER INSTALLED. UTILITIES PROVIDED FOR THESE ITEMS WILL BE PROVIDED BY THE CONTRACTOR. CONTRACTOR TO COORDINATE INSTALLATION WITH OWNER.
- TV/DVD SYSTEMS
- ICE MACHINE
- VENDING MACHINE
- REFRIGERATOR
- MICROWAVE
- OSHA PERMITS REQUIRED FOR VERTICAL CUTS 5' OR OVER
- CONTRACTOR TO PROVIDE COMPLETE DETAILS OF ENGINEERED TEMPORARY SHORING OR SLOT CUTTING PROCEDURES ON PLANS. CALL FOR INSPECTION BEFORE EXCAVATION BEGINS.
- THE SOILS ENGINEER IS TO APPROVE THE KEY OR BOTTOM AND LEAVE A CERTIFICATE ON THE SITE FOR THE GRADING INSPECTOR. THE GRADING INSPECTOR IS TO BE NOTIFIED BEFORE ANY GRADING BEGINS, AND FOR BOTTOM INSPECTION, BEFORE FILL IS PLACED. FILL MAY NOT BE PLACED WITHOUT APPROVAL OF THE GRADING INSPECTOR.
- CONTRACTOR TO REVIEW CALIFORNIA GREEN CODE REQUIREMENTS FOR CONTRACTOR REQUIREMENTS.
- A SEPARATE OFFICER, ACCESS EASEMENT/AGREEMENT, AND/OR RECIPROCAL ACCESS EASEMENT/AGREEMENT MAY BE REQUIRED TO INSURE THAT THE PROPOSED PRIVATE ACCESS ROADWAY WILL REMAIN OPEN TO THROUGH TRAFFIC AND EMERGENCY VEHICLES PRIOR TO FINAL OF BUILDING PERMIT.
- PROVIDE FIRE ALARM SYSTEM. FIRE ALARM SYSTEM SHALL ACTIVATE UPON FIRE SPRINKLER SYSTEM OPERATION

SITE NOTES

- CALL BEFORE YOU DIG!** CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING.
- UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS.
- LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER TO CAUSE DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY.
- NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT RUNOFF TO A LANDSCAPED AREA. DOWNSPOUTS MAY BE CONNECTED TO A POP-UP DRAINAGE EMITTER IN THE LANDSCAPED AREA OR MAY DRAIN TO SPLASH BLOCKS OR COBBLESTONES THAT DIRECT WATER AWAY FROM THE BUILDING.
- CONTRACTOR TO FIELD VERIFY EXISTING DRAINAGE. IF THE EXISTING DRAINAGE SYSTEM IS DAMAGED DURING EXCAVATION, CONTRACTOR SHALL REPAIR AND/OR REROUTE DRAINAGE SYSTEM AND CONNECT TO EXISTING DRAINAGE FACILITY AS NECESSARY.
- EXISTING PUBLIC IMPROVEMENTS THAT ARE DAMAGED BY THE PROJECT CONSTRUCTION SHALL BE REPAIRED OR REPLACED. EXISTING DAMAGED PUBLIC IMPROVEMENTS WITHIN THE PROJECT LIMITS SHALL BE REPAIRED OR REPLACED EVEN IF THE DAMAGE OCCURRED PRIOR TO THE START OF CONSTRUCTION.
- EROSION AND SEDIMENT CONTROL FACILITIES SHALL BE INSTALLED PRIOR TO OCTOBER 1 AND SHALL BE MAINTAINED DAILY UNTIL APRIL 30. THESE FACILITIES SHALL CONTROL AND CONTAIN EROSION-CAUSED SILT DEPOSITS AND PROVIDE FOR THE SAFE DISCHARGE OF SILT-FREE STORM WATERS INTO EXISTING STORM DRAIN FACILITIES. EROSION AND SEDIMENT CONTROL SUPPLIES MUST BE KEPT ON-SITE DURING THE DRY SEASON AND EMPLOYED, AS NECESSARY PRIOR TO AND DURING RAIN EVENTS.
- SEASONALLY APPROPRIATE BEST MANAGEMENT PRACTICES FOR THE FOLLOWING SITE MANAGEMENT CATEGORIES MUST BE IMPLEMENTED YEAR-ROUND: 1) EROSION CONTROL; 2) RUN-ON AND RUN-OFF CONTROL; 3) SEDIMENT CONTROL; 4) GOOD SITE MANAGEMENT; AND 5) NON-STORMWATER MANAGEMENT.
- AN ENCROACHMENT PERMIT WILL BE REQUIRED FOR ANY CONSTRUCTION ACTIVITY WITHIN A PUBLIC STREET RIGHT OF WAY THAT HAS BEEN ACCEPTED BY THE CITY/COUNTY.

FLOOR PLAN NOTES

- WATER HEATER** (REFER TO BUILDING ENERGY ANALYSIS REPORT):
 - ALL DOMESTIC HOT WATER PIPING SHALL BE INSULATED. (2022 CPC 609.12.1)
 - PIPES UP TO 2 INCHES IN DIAMETER: INSULATION WALL THICKNESS NOT LESS THAN DIAMETER OF PIPE. (2022 CPC 609.12.2)
 - PIPES GREATER THAN 2 INCHES IN DIAMETER: INSULATION WALL THICKNESS NOT LESS THAN 2 INCHES. (2022 CPC 609.12.2)
 - EXCEPTIONS:**
 - PIPING THAT PENETRATES FRAMING MEMBERS SHALL NOT BE REQUIRED TO HAVE PIPE INSULATION FOR THE DISTANCE OF THE FRAMING PENETRATION. (2022 CPC 609.12.2)
 - HOT WATER PIPING BETWEEN THE FIXTURE CONTROL VALVE OR SUPPLY STOP AND THE FIXTURE OR APPLIANCE SHALL NOT BE REQUIRED TO BE INSULATED. (2022 CPC 609.12.2)
- PROVIDE A TEMPERATURE AND PRESSURE RELIEF VALVE WITH A FULL SIZE DRAIN OF GALVANIZED STEEL OR HARD DRAWN COPPER TO THE OUTSIDE OF THE BUILDING WITH THE END OF THE PIPE PROTRUDING 6" MINIMUM @ 2' MAX. ABOVE GRADE POINTING DOWNWARD TO THE TERMINATION - UNTHREADED.
- COMBUSTION AIR PER MANUFACTURE REQUIREMENTS.
- CLEARANCES PER MANUFACTURE REQUIREMENTS.
- INSULATION FOR PIPING AND TANKS** (2022 CEC 105.01):
 - WATER PIPING:** SCOUR WATER HEATING SYSTEM PIPING, AND SPACE-CONDITIONING SYSTEM LINE INSULATION THICKNESS AND CONDUCTIVITY. PIPING SHALL BE INSULATED AS FOLLOWS:
 - DOMESTIC HOT WATER PIPING. SEE NOTES ABOVE.
 - PIPING FOR SPACE-CONDITIONING SYSTEMS, SOLAR WATERHEATER SYSTEM COLLECTOR LOOP. SEE 2022 CEC SECTION 120.3(c).**EXCEPTION:**
 - PIPING SURROUNDED WITH A MINIMUM OF 1 INCH OF WALL INSULATION, 2 INCHES OF CRAWLSPACE INSULATION, OR 4 INCHES OF ATTIC INSULATION SHALL NOT BE REQUIRED TO HAVE PIPE INSULATION.
 - INSULATION PROTECTION:** PIPE INSULATION SHALL BE PROTECTED FROM DAMAGE DUE TO SUNLIGHT, MOISTURE, EQUIPMENT MAINTENANCE AND WIND. PROTECTION SHALL, AT MINIMUM, INCLUDE THE FOLLOWING (2022 CEC SECTION 120.3(b)):
 - PIPE INSULATION EXPOSED TO WEATHER SHALL BE PROTECTED BY A COVER SUITABLE FOR OUTDOOR SERVICE. THE COVER SHALL BE WATER RETARDANT AND PROVIDES SHIELDING FROM SOLAR RADIATION THAT CAN CAUSE DEGRADATION OF THE MATERIAL. ADHESIVE TAPE SHALL NOT BE USED TO PROVIDE THIS PROTECTION.
 - PIPE INSULATION COVERING CHILLED WATER PIPING AND REFRIGERANT SUCTION PIPING LOCATED OUTSIDE THE CONDITIONED SPACE SHALL INCLUDE, OR BE PROTECTED BY, A CLASS I OR CLASS II VAPOR RETARDER. ALL PENETRATIONS AND JOINTS SHALL BE SEALED.
 - PIPE INSULATION EXPOSED BELOW GRADE MUST BE INSTALLED IN A WATER PROOF AND NONCRUSHABLE CASING OR SLEEVE.
- WEATHER BARRIERS.**
 - NOT FEWER THAN ONE-LAYER WATER-RESISTIVE BARRIER SHALL BE APPLIED OVER STUDS OR SHEATHING OF ALL EXTERIOR WALLS CONTINUOUS FROM TOP OF WALLS AND TERMINATED AT PENETRATIONS AND BUILDING APPENDAGES WITH FLASHING. MINIMUM NO. 15 FELT COMPLYING WITH ASTM D226, TYPE 1.
 - PROVIDE (2) LAYERS OF GRADE D PAPER OR EQUAL WHEN PLASTER IS INSTALLED OVER WOOD BASED SHEATHING. (2022 CRC R703.7.3)
- DOMESTIC RANGE:** VENTILATION DUCTS SHALL HAVE SMOOTH INTERIOR SURFACES. (2022 CMC 504.3)
- CLOTHES DRYER:** MOISTURE EXHAUST DUCTS SHALL TERMINATE OUTSIDE THE BUILDING AND HAVE A BACK-DRAFT DAMPER. EXHAUST DUCT IS LIMITED TO 14'-0" W/ TWO ELBOWS. THIS SHALL BE REDUCED 2'-0" FOR EVERY ELBOW IN EXCESS OF TWO. MIN. DIA. 4", SMOOTH, METAL DUCT. (2022 CMC 504.4)
- ALL MANUFACTURED EQUIPMENT** SHALL BE INSTALLED AS PER MANUFACTURER'S SPECIFICATION AND DIMENSIONS VERIFIED WITH INSTALLATION REQUIREMENTS. ALL MANUFACTURER'S INSTALLATION INSTRUCTIONS SHOULD BE ON SITE FOR INSPECTIONS.
- SHOWERS AND TUB-SHOWER COMBINATION:** CONTROL VALVES MUST BE PRESSURE BALANCED OR THERMOSTATIC MIXING VALVES. (2022 CPC 417.0)
- WET-ROOM GLAZING:** PROVIDE TEMPERED GLAZING IN DOORS AND ENCLOSURES FOR SHOWERS, BATHTUBS, SAUNAS, STEAM ROOMS, HOT TUBS & SIMILAR USES WHERE THE BOTTOM EXPOSED EDGE IS LESS THAN 60-INCHES ABOVE FINISHING SURFACE. (2022 CRC R308.4.5)
- HEATING AND AIR-CONDITIONING SYSTEM DESIGN** SHALL CONFORM TO CALGREEN SEC. 4.507, ENVIRONMENTAL COMFORT.
- WATER CLOSETS.**
 - CLEARANCES: 24" MIN. FRONT, 30" MIN COMPARTMENT WIDTH.
 - PROVIDE A MIN 3 SF WINDOW, 1/2 OF WHICH SHALL BE OPENABLE OR AN EXHAUST FAN 50 CFM FOR INTERMITTENT OR 20 CFM FOR CONTINUOUS, DIRECT VENT TO OUTSIDE WITH BACKDRAFT DAMPER. (2022 CRC R303.3)
 - NEW WATER CLOSETS AND ASSOCIATED FLUSHMETER VALVES, IF ANY SHALL USE NO MORE THAN 1.28 GALLONS PER FLUSH AND SHALL MEET PERFORMANCE STANDARDS ESTABLISHED BY THE AMERICAN SOCIETY OF MECHANICAL ENGINEERS STANDARD A112.19.2. H & S CODE, SECTION 17921.3(B).
- BATH ACCESSORIES:** PROVIDE MINIMUM 1 TOILET PAPER HOLDER AND 1 TOWEL BAR PER BATHROOM. PROVIDE NECESSARY BLOCKING FOR TOILET PAPER HOLDER AND TOWEL BARS.
- WHOLE-BUILDING MECHANICAL VENTILATION SYSTEM** PER ASHRAE STANDARD 62.2. PROVIDE THE COUNTY INSPECTOR THE FOLLOWING INFORMATION AT OR BEFORE THE TIME OF INSPECTION:
 - CALCULATIONS FOR REQUIRED VENTING RATES.
 - CALCULATION ADJUSTMENTS FOR INTERMITTENT SYSTEMS IF APPLICABLE.
 - DUCT DIAMETER AND MAXIMUM DUCT LENGTH PER ASHRAE 62.2 TABLE 7.1.
 - TYPE OF SYSTEM USED AND PROVIDE COMPLETED CR-6R-MECH-05 FORM.
 - FANS SHALL BE A MAXIMUM OF 1 SONE.
 - FANS SHALL BE PROVIDED A COVER OF R-2 WHEN OFF.
- ATTIC ACCESS:**
 - PROVIDE 30" MIN. HEADROOM IN THE ATTIC SPACE (2019 CRC R807.1)
 - IN ATTIC, PROVIDE LIGHT AND SWITCH, AND ALL NECESSARY ELECTRICAL. PROVIDE UNOBSTRUCTED PASSAGEWAY 24" WIDE OF SOLID CONTINUOUS FLOORING FROM ACCESS TO EQUIPMENT AND ITS CONTROLS. ALSO PROVIDE UNOBSTRUCTED WORK SPACE IN FRONT OF EQUIPMENT 30" DEPTH MINIMUM. PROVIDE COMBUSTION AIR AND CONDENSATE LINE TO OUTSIDE OR AN APPROVED DRAIN FOR OPTIONAL AIR CONDITIONING.
 - BUILDINGS WITH COMBUSTIBLE CEILING OR ROOF CONSTRUCTION SHALL HAVE AN ATTIC ACCESS OPENING TO ATTIC AREAS THAT EXCEED 30 SQUARE FEET AND HAVE A VERTICAL HEIGHT OF 30-INCHES OR GREATER. THE VERTICAL HEIGHT SHALL BE MEASURED FROM TOP OF THE CEILING FRAMING MEMBERS TO THE UNDERSIDE OF THE ROOF FRAMING MEMBERS.
 - THE ROUGH-FRAMED OPENING SHALL NOT BE LESS THAN 22" X 30" AND SHALL BE LOCATED NOT OVER 20 FEET FROM THE EQUIPMENT. (2022 CRC R807.1)
 - PROVIDE A 120V RECEPTACLE AND A LIGHT NEAR THE EQUIPMENT WITH LIGHT SWITCH LOCATED AT THE ATTIC ACCESS.

ELECTRICAL NOTES

- CONFORM WITH CURRENT NEC, NFPA, MFR'S, AND LOCAL REQUIREMENTS.
- ELECTRICAL SYSTEMS, DOMESTIC, SHALL BE PROVIDED PER NEC ARTICLE 250-81.
- ALL MATERIALS TO BE U.L. LABELED.
- METER: "SQUARE D", 120 VOLT/240 VOLT, 1 AND 3 WIRE GROUND OR EQUAL.
- ELECTRICAL SUB PANEL: FLUSH MOUNT, 30" CLEARANCE, 100 AMP.
- CONDUCTORS: TW, THW, COPPER, MINIMUM 14 AT LIGHTING, 12 AT OTHER CIRCUITS.
- LAMPS: FOR GENERAL LIGHTING IN KITCHENS AND BATH SHALL HAVE AN EFFICIENCY OF NOT LESS THAN 40 LUMENS/WATT. ALL SOCKETS FILLED WITH SOFT-WHITE, 55 WATT FLUORESCENT: COOL WHITE, RS, SOUND RATING "1", 40 WATT (U.O.N.)
- ALL ELECTRICAL OUTLETS INSTALLED IN BATHROOMS, GARAGES, BASEMENTS, CRAWL SPACES, OUTDOORS, KITCHEN COUNTERS, AND AT WET BAR SINKS SHALL HAVE GROUND-FAULT CIRCUIT-INTERRUPTER PROTECTION IN COMPLIANCE WITH NEC ART. 210-8, CONSISTING OF 125 VOLT, SINGLE-PHASE, 15- AND 20- AMPERE RECEPTACLES.
- ALL BATHROOM RECEPTACLE OUTLETS SHALL BE SUPPLIED BY A MINIMUM OF ONE 120-VOLT, 20-AMPERE BRANCH CIRCUIT. SUCH CIRCUITS SHALL HAVE NO OTHER OUTLETS. THIS DEDICATED CIRCUIT MAY SERVE MORE THAN ONE BATHROOM. (2022 CEC 210.11(C))
- PROVIDE ELECTRIC OUTLET AND PUSH-BUTTON WIRE FOR GARAGE OPENER (INCLUDE OPENER).
- WATERMIST SHALL BE A PROGRAMMABLE TYPE, HONEYWELL TH8320 OR EQUAL.
- RECESSED LUMINAIRES INSTALLED IN AREAS TO RECEIVE INSULATION SHALL BE "IC" LUMINAIRES AND ARE CERTIFIED AND LABELED AS AIRTIGHT TO THE STANDARDS PRESCRIBED BY THE RESIDENTIAL ENERGY CODE.
- BUILDING SUSCEPTIBLE TO LIGHTNING. PROVIDE LIGHTNING PROTECTION INDEPENDENTLY OF AN OUTLET BOX OR BY LISTED OUTLET BOX OR OUTLET BOX SYSTEMS IDENTIFIED FOR THE USE AND INSTALLED IN ACCORDANCE WITH ALL LUMINAIRES (2022 CEC 314.27(C)) (2022 CEC 422.18).
- ALL LUMINAIRES, LAMP HOLDERS, AND RETROFIT KITS SHALL BE LISTED
- ALL 120-VOLT, SINGLE PHASE 15- AND 20- AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED IN DWELLING UNIT KITCHENS, FAMILY ROOMS, LIVING ROOMS, DINING ROOMS, PARLORS, LIBRARIES, DEN'S, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY A LISTED ARC-FAULT CIRCUIT INTERRUPTER, COMBINATION-TYPE, INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT. (2022 CEC 210-12(A)).
- ALL NON-LOCKING TYPE 125-VOLT, 15 AND 20 AMPERE RECEPTACLES IN A DWELLING UNIT SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES. EXCEPTIONS: (1) RECEPTACLES MORE THAN 6' ABOVE THE FLOOR, (2) RECEPTACLES PART OF A LUMINAIRE OR APPLIANCE, (3) A SINGLE RECEPTACLE OR A DUPLEX RECEPTACLE FOR TWO APPLIANCES THAT ARE NOT EASILY MOVED AND LOCATED WITHIN DEDICATED SPACE AND ARE CHORD-AND-PLUG CONNECTED AS PER CEC 400.7, AND (4) NON-GROUNDING RECEPTACLES USED FOR REPLACEMENTS AS PERMITTED IN CEC 400.4(D)(2)(A).
- HIGH EFFICACY LUMINAIRES OTHER THAN OUTDOOR HD LIGHTING CONTAIN ONLY ONLY HIGH EFFICACY LAMPS AS OUTLINED IN TABLE 150-C OF THE RESIDENTIAL ENERGY CODE AND NOT CONTAIN A MEDIUM SCREW BASE SOCKET.
- BALLAST FOR LAMPS 15 WATTS OR GREATER SHALL BE ELECTRONIC AND HAVE AN OUTPUT FREQUENCY NO LESS THAN 20 KHZ.
- SMOKE DETECTORS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND PROVIDED WITH A BATTERY BACK-UP. ALL SMOKE DETECTORS SHALL BE INTERCONNECTED. ALL SMOKE DETECTORS SHALL MAINTAIN A MINIMUM 3 FOOT CLEARANCE TO HVAC SUPPLY OR RETURN AIR REGISTERS.
- CARBON MONOXIDE ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND PROVIDED WITH A BATTERY BACK-UP. ALL CARBON MONOXIDE ALARMS SHALL BE INTERCONNECTED.
- LIGHTS IN OTHER THAN KITCHENS, BATHROOMS, GARAGES, LAUNDRY ROOMS, AND UTILITY ROOMS MUST BE CONTROLLED BY A DIMMER OR CONTROLLED BY A MANUAL-ON OCCUPANT SENSOR. SUCH SENSORS SHALL BE CAPABLE OF AUTOMATICALLY TURNING OFF THE LIGHTS NO MORE THAN 30 MINUTES AFTER THE AREA HAS BEEN VACATED.
- EXHAUST FANS WILL BE CONTROLLED BY A HUMIDISTAT PER THE GREEN BUILDING STANDARDS CODE SECTION 4.508. EXHAUST FANS MUST BE SWITCHED SEPARATELY FROM LIGHTS (CecG 150.0(k)(2)).
- OUTDOOR LIGHTING PERMANENTLY MOUNTED TO A RESIDENTIAL BUILDING OR TO OTHER BUILDINGS ON THE SAME LOT SHALL BE HIGH EFFICACY AND MUST MEET THE REQUIREMENTS IN ITEM I AND THE REQUIREMENTS IN EITHER ITEM II OR ITEM III:
 - CONTROLLED BY A MANUAL ON AND OFF SWITCH THAT PERMITS THE AUTOMATIC ACTIONS OF ITEMS II OR III BELOW, AND
 - CONTROLLED BY A PHOTOCELL AND EITHER A MOTION SENSOR OR AN AUTOMATIC TIME SWITCH CONTROL, OR
 - CONTROLLED BY AN ASTRONOMICAL TIME CLOCK CONTROL.

NOTE: CONTROLS THAT OVERRIDE TO ON SHALL NOT BE ALLOWED UNLESS THE OVERRIDE AUTOMATICALLY RETURNS THE AUTOMATIC CONTROL TO NORMAL OPERATION WITHIN 6 HOURS. AN ENERGY MANAGEMENT CONTROL SYSTEM THAT PROVIDES THE SPECIFIED LIGHTING CONTROL FUNCTIONALITY AND COMPLIES WITH ALL REQUIREMENTS APPLICABLE TO THE SPECIFIED CONTROLS MAY BE USED TO MEET THESE REQUIREMENTS.

- AT LEAST ONE LUMINAIRE EACH BATHROOM, LAUNDRY ROOM, AND UTILITY ROOM SHALL BE CONTROLLED BY A MANUAL ON/AUTOMATIC-OFF VACANCY SENSOR.
- EXCEPT FOR CLOSETS, LESS THAN 70 SQUARE FEET AND HALLWAYS, ALL LUMINAIRES THAT ARE INSTALLED WITH JAB-CERTIFIED LIGHT SOURCES ARE REQUIRED TO BE CONTROLLED BY EITHER A DIMMER, VACANCY SENSOR OR FAN SPEED CONTROL.

PLUMBING NOTES

- CONFORM WITH CURRENT CPC AND LOCAL REQUIREMENTS.
- PIPING:
 - DOMESTIC WATER (WITHIN BUILDING): COPPER OR PEX PIPE OR APPROVED EQUAL
 - GAS, EXPOSED TO WEATHER: GALVANIZED
 - AIR CHAMBERS: 12" LONG CAPPED NIPPLE AT END OF EACH BRANCH TO EACH FIXTURE.
 - ELECTRICAL UNIONS "P.P.C.O." REQUIREMENT AT ALL DISSIMILAR MATERIAL CONNECTIONS.
 - WHEN "OPTIONAL" SOFT-WATER LOOP INSTALLED, PROVIDE WITH 2 GATE VALVES.
- WATER SERVICE PIPE SHALL BE PER CIVIL PLANS OR AS REQUIRED BY THE JURISDICTION.
- WATER METER: PER WATER DISTRICT (REFER SIZE W/ FIRE SPRINKLER PLANS IF APPLICABLE)
- SHOWER HEADS AND FAUCETS: FLOW RATES PER 2022 CGBSC SECTION 4.303
- PIPE INSULATION REFER TO TITLE 24 - MANDATORY MEASURES - "SPACE CONDITIONING, WATER HEATING & PLUMBING SYSTEM MEASURES"
- STRAPS AND HANGERS: PROVIDE AS NECESSARY TO INSURE A STABLE INSTALLATION. SEE TITLE-24 FOR WATER HEATER REQUIREMENTS.
- ALL HOSE BIBS SHALL HAVE APPROVED BACK FLOW PREVENTION DEVICES. PLUMBING FIXTURES (WATER CLOSETS) AND FITTINGS (FAUCETS AND SHOWERHEADS) SHALL MEET THE STANDARDS REFERENCED IN CALGREEN TABLE 4.303.3.
- WATER HEATER SHALL BE PROVIDED WITH A TEMPERATURE AND PRESSURE RELIEF VALVE. PER (2022 CPC 505.2) THE RELIEF VALVE SHALL BE PROVIDED WITH A DRAIN LINE WHICH EXTENDS FROM THE VALVES TO THE OUTSIDE OF THE BUILDING. PER (2022 605 CPC)
- PER 2022 CPC 605.5.7 OUTLETS WITH HOSE ATTACHMENTS, POTABLE WATER OUTLETS WITH HOSE ATTACHMENTS, OTHER THAN WATER HEATER DRAINS, BOILER DRAINS, AND CLOTHES WASHER CONNECTIONS, SHALL BE PROTECTED BY A NONREMOVABLE HOSE BIBB TYPE BACKFLOW PREVENTER. A NONREMOVABLE HOSE BIBB TYPE VACUUM BREAKER, OR BY AN ATMOSPHERIC VACUUM BREAKER INSTALLED NOT LESS THAN 6 INCHES ABOVE THE HIGHEST POINT OF USAGE LOCATED ON THE DISCHARGE SIDE OF THE LAST VALVE. IN CLIMATES WHERE FREEZING TEMPERATURES OCCUR, A LISTED SELF DRAINING FROST-PROOF HOSE BIBB WITH AN INTEGRAL BACKFLOW PREVENTER OR VACUUM BREAKER SHALL BE USED.

MECHANICAL NOTES

- CONFORM WITH CURRENT ADOPTED CRC, CMC, SMACNA, NFPA AND LOCAL REQUIREMENTS.
- DUCTWORK: SMACNA "LOW VELOCITY DUCT CONSTRUCTION" NFPA STANDARD #90A. ALL TRANSVERSE DUCT PLENUM AND FITTING JOINTS SHALL BE SEALED WITH PRESSURE SENSITIVE NON-CLOTH TAPE MEETING THE REQUIREMENTS OF UL181, 181A, OR 181B, OR MASTIC TO PREVENT AIR LOSS. DUCTS SHALL BE INSULATED AS REQUIRED BY THE UMC. SEE FLOOR PLAN FOR F.A.U. AND FIREPLACES. DUCTS PENETRATING A WALL OR FLOOR-CEILING BETWEEN GARAGE & DWELLING TO BE MINIMUM 26 GAUGE METAL WITHOUT OPENING IN GARAGE. FIRE DAMPER REQUIRED OTHERWISE.
- GRILLES AND REGISTERS, DIFFUSERS, ETC. SUBJECT TO OWNERS APPROVAL. "CARNES" OR EQUAL FANS. DIRECTLY VENTED TO OUTSIDE. BACK DRAFT DAMPERS ARE REQUIRED (PER TITLE 2-53V, EQUIPMENT 24 C.A.C.).
- THE RETURN AIR PLENUM SERVING THE MECHANICAL EQUIPMENT MUST BE FULLY DUCTED FROM THE EQUIPMENT TO THE CONDITIONED SPACE. DROP CEILINGS, WALL CAVITIES AND EQUIPMENT PLATFORMS MAY NOT BE USED AS PLENUMS.
- LAUNDRY DRYER VENT TO EXTERIOR TO BE 14 FEET MAXIMUM, LESS 2 FEET PER 90 DEGREE TURN PER CMC 504.3.2.2. IF VENT IS OVER 14' AN APPROVED POWER ASSISTED DEVICE IS REQUIRED.
- BATHROOM EXHAUST FANS (BATHROOM APPLIES TO ROOMS CONTAINING BATHUB, SHOWER, OR TUB/SHOWER COMBINATION) WHICH EXHAUST DIRECTLY FROM BATHROOMS SHALL COMPLY WITH THE FOLLOWING (2022 CGBSC SEC. 4.506.1):
 - FANS SHALL BE ENERGY STAR COMPLIANT AND BE DUCTED TO TERMINATE OUTSIDE THE BUILDING MIN 3' FROM OPENINGS.
 - EXHAUST FANS SHALL BE A COMPONENT OF A WHOLE HOUSE VENTILATION SYSTEM, FANS MUST BE CONTROLLED BY A HUMIDITY CONTROL.
 - HUMIDITY CONTROLS SHALL BE CAPABLE OF ADJUSTMENT BETWEEN A RELATIVE HUMIDITY RANGE OF 5-50 PERCENT TO A MAXIMUM OF 80 PERCENT. A HUMIDITY CONTROL MAY UTILIZE MANUAL OR AUTOMATIC MEANS OF ADJUSTMENT.
 - HUMIDITY CONTROL MAY BE A SEPARATE COMPONENT TO EXHAUST FAN AND IS NOT REQUIRED TO BE INTEGRAL (I.E. BUILT IN)
- BATHROOM EXHAUST FANS SHALL BE PROVIDED MINIMUM 50 CFM EXHAUST RATE (2022 CMC TABLE 403.7)
- KITCHEN EXHAUST FANS SHALL PROVIDE MINIMUM 100 CFM EXHAUST RATE (2022 CMC TABLE 403.7)
- PER 2022 CEC 150(m) PORTIONS OF SUPPLY-AIR AND RETURN-AIR DUCTS AND PLENUMS SHALL BE INSULATED TO A MINIMUM INSTALLED LEVEL OF R-6.0 (OR ANY LEVEL HIGHER LEVEL REQUIRED BY 2022 CMC SECTION 605) OR BE ENCLOSED ENTIRELY IN CONDITIONED SPACE.

TITLE 24 COMPLIANCE

- ALL INTERIOR RESIDENTIAL LIGHTING IS TO BE HIGH EFFICACY.
- THE FOLLOWING LIGHTING IS HIGH EFFICACY: PIN BASED LINEAR FLUORESCENT, PIN BASED COMPACT FLUORESCENT, PULSE-START METAL HALIDE, HIGH PRESSURE SODIUM, GU24 (OTHER THAN LED'S), INSEPARABLE SOLID STATE LUMINAIRES (SSL'S) INSTALLED OUTDOORS OR INSEPARABLE SSL LUMINAIRES WITH COLORED LIGHT SOURCES FOR DECORATIVE LIGHTING PURPOSES. (2022 CEC TABLE 150.0-A)
- THE FOLLOWING LAMPS AND LIGHT SOURCES ARE HIGH EFFICACY IF THEY ARE JOINT APPENDIX JAB-CERTIFIED. JAB-CERTIFIED LAMPS AND LIGHT SOURCES ARE MARKED AS "JAB-2016" OR "JAB-2016-E". THESE FIXTURES INCLUDE: LED LUMINAIRES WITH INTEGRAL SOURCES THAT ARE CERTIFIED TO THE ENERGY COMMISSION, SCREW-BASED LED LAMPS (A LAMPS, PAR LAMPS, ETC.), PIN BASED LED LAMPS (MR-16AR-111, ETC.), GU-24 BASED LED LIGHT SOURCES AND OTHER LUMINAIRES. (2022 CEC TABLE 150.0-A) LISTING OF CA CERTIFIED FIXTURES IS LOCATED ON THE CALIFORNIA ENERGY COMMISSION WEBSITE AT: [HTTP://WWW.ENERGY.CA.GOV/ADVANCEDSEARCH.ASPX](http://www.energy.ca.gov/advancedssearch.aspx)
- RECESSED LUMINAIRES INSTALLED IN AREAS TO RECEIVE INSULATION SHALL BE "IC" LUMINAIRES AND ARE CERTIFIED AND LABELED AS AIRTIGHT TO THE STANDARDS PRESCRIBED BY THE RESIDENTIAL ENERGY CODE.
- ADDITIONAL REQUIREMENTS FOR ANY RECESSED DOWNLIGHTS IN CEILING ARE AS FOLLOWS: THEY
 - SHALL NOT HAVE SCREW BASED SOCKETS.
 - SHALL CONTAIN JAB-CERTIFIED LIGHT SOURCES AND
 - SHALL MEET PERFORMANCE REQUIREMENTS OF 2022 CEC SECTION 150.0(K)1.
- THE NUMBER OF ELECTRICAL BOXES LOCATED MORE THAN 5 FEET ABOVE FINISHED FLOOR THAT DO NOT CONTAIN ALUMINAIRE OR OTHER DEVICE SHALL NOT EXCEED THE NUMBER OF BEDROOMS. THESE BOXES MUST BE SERVED BY A DIMMER, VACANCY SENSOR OR FAN SPEED CONTROL. (2022 CEC SECTION 150(K)1(B))
- UNDERCABINET LIGHTING MUST BE SWITCHED SEPARATE FROM ALL OTHER LIGHTING
- ALL LIGHTING MUST HAVE READILY ACCESSIBLE MANUAL CONTROLS
- EXHAUST FANS MUST BE SWITCHED SEPARATE FROM LIGHTING OR UTILIZE A DEVICE WHERE LIGHTING CAN BE TURNED OFF WHILE THE FAN IS RUNNING.
- FOR ALL SPACE TYPES EXCEPT HALLWAYS AND CLOSETS THAT ARE 70 SF OR SMALLER, VACANCY SENSORS OR DIMMERS ARE REQUIRED WHEN USING A SOURCE REGULATED BY JAB.
- IN KITCHENS, IF THE LUMINAIRE IS AN ENCLOSED OR RECESSED LUMINAIRE, YOU MUST USE A DIMMER OR VACANCY SENSOR.
- AT LEAST ONE LUMINAIRE IN THE BATHROOM, GARAGE, LAUNDRY ROOM AND UTILITY ROOM MUST BE CONTROLLED BY A VACANCY SENSOR.
- THE BUILDER MUST PROVIDE NEW HOMEOWNERS WITH A LUMINAIRE SCHEDULE THAT INCLUDES A LIST OF INSTALLED LAMPS AND LUMINAIRES.
- ALL JOINTS, PENETRATIONS AND OTHER OPENINGS IN THE BUILDING ENVELOPE THAT ARE POTENTIAL SOURCES OF AIR LEAKAGE SHALL BE CALKED, GASKETED, WEATHER-STRIPPED OR OTHERWISE SEALED TO LIMIT INFILTRATION AND EXFILTRATION (2022 CEC 110.7).
- ATTIC ACCESS DOORS SHALL HAVE PERMANENTLY ATTACHED INSULATION USING ADHESIVE OR MECHANICAL FASTENERS. THE ATTIC ACCESS SHALL BE GASKETED TO PREVENT AIR LEAKAGE (2022 CEC 150.0(a)2)
- ALL INSTALLED LUMINAIRES SHALL BE HIGH EFFICACY IN ACCORDANCE WITH CEC TABLE 150.0-A. (2022 CEC 150(K)1A)
- THE NUMBER OF ELECTRICAL BOXES THAT ARE MORE THAN 5 FEET ABOVE THE FINISHED FLOOR AND DO NOT CONTAIN A LUMINAIRE OR OTHER DEVICE SHALL BE NO GREATER THAN THE NUMBER OF BEDROOMS. THESE ELECTRICAL BOXES MUST BE SERVED BY A DIMMER, VACANCY SENSOR CONTROL, OR FAN SPEED CONTROL. (2022 CEC 150(K)1B)

SOLAR READY NOTES

SOLAR READY REQUIREMENTS PER CcNC 110.10(b) THROUGH 110.10(e)

SOLAR ZONE:

- MINIMUM AREA.** THE SOLAR ZONE SHALL HAVE A MINIMUM TOTAL AREA AS DESCRIBED BELOW. THE SOLAR ZONE SHALL COMPLY WITH ACCESS, PATHWAY, SMOKE VENTILATION, AND SPACING REQUIREMENTS AS SPECIFIED IN TITLE 24, PART 9 OR OTHER PARTS OF TITLE 24 OR IN ANY REQUIREMENTS ADOPTED BY A LOCAL JURISDICTION.
- THE SOLAR ZONE TOTAL AREA SHALL BE COMPRISED OF AREAS THAT HAVE NO DIMENSION LESS THAN FIVE FEET AND ARE NO LESS THAN 80 SQUARE FEET EACH FOR BUILDINGS WITH ROOF AREAS LESS THAN OR EQUAL TO 10,000 SQUARE FEET OR NO LESS THAN 160 SQUARE FEET EACH FOR BUILDINGS WITH ROOF AREAS GREATER THAN 10,000 SQUARE FEET.
 - SINGLE FAMILY RESIDENCES.** THE SOLAR ZONE SHALL BE LOCATED ON THE ROOF OR OVERHANG OF THE BUILDING AND HAVE A TOTAL AREA NO LESS THAN 250 SQUARE FEET.

EXCEPTION 5 TO SECTION 110.10(B)(1A): SINGLE FAMILY RESIDENCES WITH A PERMANENTLY INSTALLED DOMESTIC SOLAR WATER-HEATING SYSTEM MEETING THE INSTALLATION CRITERIA SPECIFIED IN THE REFERENCE RESIDENTIAL APPENDIX R44 AND WITH A MINIMUM SOLAR SAVINGS FRACTION OF 0.50.

EXCEPTION 5 TO SECTION 110.10(B)(1A): SINGLE FAMILY RESIDENCES HAVING A SOLAR ZONE TOTAL AREA NO LESS THAN 150 SQUARE FEET AND WHERE ALL THERMOSTATS ARE DEMAND RESPONSIVE CONTROLS AND COMPLY WITH SECTION 110.12(A), AND ARE CAPABLE OF RECEIVING AND RESPONDING TO DEMAND RESPONSE SIGNALS PRIOR TO GRANTING OF AN OCCUPANCY PERMIT BY THE ENFORCING AGENCY.

EXCEPTION 6 TO SECTION 110.10(B)(1A): SINGLE-FAMILY RESIDENCES MEETING THE FOLLOWING CONDITIONS:

- ALL THERMOSTATS ARE DEMAND RESPONSIVE CONTROLS THAT COMPLY WITH SECTION 110.12(A), AND ARE CAPABLE OF RECEIVING AND RESPONDING TO DEMAND RESPONSE SIGNALS PRIOR TO GRANTING OF AN OCCUPANCY PERMIT BY THE ENFORCING AGENCY.
- COMPLY WITH ONE OF THE FOLLOWING MEASURES:
 - INSTALL A DISHWASHER THAT MEETS OR EXCEEDS THE ENERGY STAR PROGRAM REQUIREMENTS WITH A REFRIGERATOR THAT MEETS OR EXCEEDS THE ENERGY STAR PROGRAM REQUIREMENTS, A WHOLE HOUSE FAN DRIVEN BY AN ELECTRONICALLY COMMUTATED MOTOR, OR AN SAE J1772 LEVEL 2 ELECTRIC VEHICLE SUPPLY EQUIPMENT (EVSE OR EV CHARGER) WITH A MINUTE OF 40 AMPERES, OR
 - INSTALL A HOME AUTOMATION SYSTEM CAPABLE OF, AT A MINIMUM, CONTROLLING THE APPLIANCES AND LIGHTING OF THE DWELLING AND RESPONDING TO DEMAND RESPONSE SIGNALS; OR
 - INSTALL ALTERNATIVE PLUMBING PIPING TO PERMIT THE DISCHARGE FROM THE CLOTHES WASHER AND ALL SHOWERS AND BATHTUBS TO BE USED FOR AN IRRIGATION SYSTEM IN COMPLIANCE WITH THE CALIFORNIA PLUMBING CODE AND ANY APPLICABLE LOCAL ORDINANCES; OR
 - INSTALL A RAINWATER CATCHMENT SYSTEM DESIGNED TO COMPLY WITH THE CALIFORNIA PLUMBING CODE AND ANY APPLICABLE LOCAL ORDINANCES, AND THAT USES RAINWATER FLOWING FROM AT LEAST 65 PERCENT OF THE AVAILABLE ROOF AREA.

WILDLAND-URBAN INTERFACE

- ROOF COVERING SHALL COMPLY WITH 2022 CRC R337.5.2 UNDERLAYMENT SHALL BE ONE LAYER OF OF MINIMUM 72 POUND MINERAL-SURFACED NONPERFORATED CAP SHEET COMPLYING WITH ASTM D3909 INSTALLED OVER THE COMBUSTIBLE DECKING. ALTERNATELY, A CLASS A FIRE RATED ROOF UNDERLAYMENT, TESTED IN ACCORDANCE WITH ASTM E108, SHALL BE PERMITTED TO BE USED.
- ROOF VALLEYS SHALL COMPLY WITH 2022 CRC R337.5.3. VALLEY FLASHING SHALL BE NOT LESS THAN 26 GAGE GALVANIZED SHEET CORROSIVE RESISTANT METAL INSTALLED OVER NOT LESS THAN ONE LAYER OF MINIMUM 72 POUND MINERAL-SURFACED NONPERFORATED CAP SHEET COMPLYING WITH ASTM D3909, AT LEAST 36 INCHES WIDE RUNNING THE FULL LENGTH OF THE VALLEY.
- ROOF GUTTERS SHALL COMPLY WITH 2022 CRC R337.5.4. ROOF GUTTERS SHALL BE PROVIDED WITH THE MEANS TO PREVENT THE ACCUMULATION OF LEAVES AND DEBRIS IN THE GUTTER.
- VENTILATION OPENINGS SHALL COMPLY WITH 2022 CRC R337.6 - VENTILATION OPENINGS FOR ENCLOSED ATTICS, ENCLOSED EAVE SOFFIT SPACES, ENCLOSED RAFTER SPACES FORMED WHERE CEILING ARE APPLIED DIRECTLY TO THE UNDERSIDE OF ROOF RAFTERS, AND UNDERLOFT VENTILATION OPENINGS SHALL BE FULLY COVERED WITH METAL WALL OR METAL VENTILATION DEVICES, REFER TO SECTIONS R337.6.1 THROUGH R337.6.3 FOR ADDITIONAL INFORMATION.
- EXTERIOR COVERINGS SHALL COMPLY WITH 2022CRC R337.7 EXTERIOR WALL COVERINGS OR WALL ASSEMBLIES SHALL COMPLY WITH ONE OF THE FOLLOWING REQUIREMENTS: BE OF NONCOMBUSTIBLE MATERIAL, IGNITION-RESISTANT MATERIAL, HEAVY TIMBER EXTERIOR WALL ASSEMBLY, LOG WALL CONSTRUCTION ASSEMBLY, OR WALL ASSEMBLIES THAT MEET THE PERFORMANCE CRITERIA IN ACCORDANCE WITH THE TEST PROCEDURES FOR A 10-MINUTE DIRECT FLAME CONTACT EXPOSURE TEST SET FORTH IN SFM STANDARD 12-7A-1. REFER TO SECTIONS R337.7.1 THROUGH R337.7.9 FOR ADDITIONAL INFORMATION.

FIRE-RESISTANT CONSTRUCTION

SELECT THE APPROPRIATE BOX BELOW (ONLY 1):

| | | |
|--------------------------|--|---|
| <input type="checkbox"/> | FIRE SEPARATION DISTANCE: 25'-0" (EXTERIOR WALLS, PROJECTIONS, OPENINGS, AND PENETRATIONS) | NO FIRE-RESISTANCE RATING REQUIRED |
| <input type="checkbox"/> | FIRE SEPARATION DISTANCE: 4'-0" - 5'-0" (EXTERIOR WALLS, OPENINGS, AND PENETRATIONS) PROJECTION SEPARATION DIST.: 23'-0" | NO FIRE-RESISTANCE RATING REQUIRED |
| | EXTERIOR WALLS AND PROJECTIONS | 1-HR FIRE-RESISTANCE |
| <input type="checkbox"/> | SPRINKLERED | |
| <input type="checkbox"/> | FIRE SEPARATION DISTANCE: 34'-0" (EXTERIOR WALLS, OPENINGS, AND PENETRATIONS) | NO FIRE-RESISTANCE RATING REQUIRED |



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRACT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT

SAN LUIS OBISPO, CA

GENERAL NOTES

APPROVED SET

DATE
09/28/2023

SHEET

G-101

CLIMATE ZONE

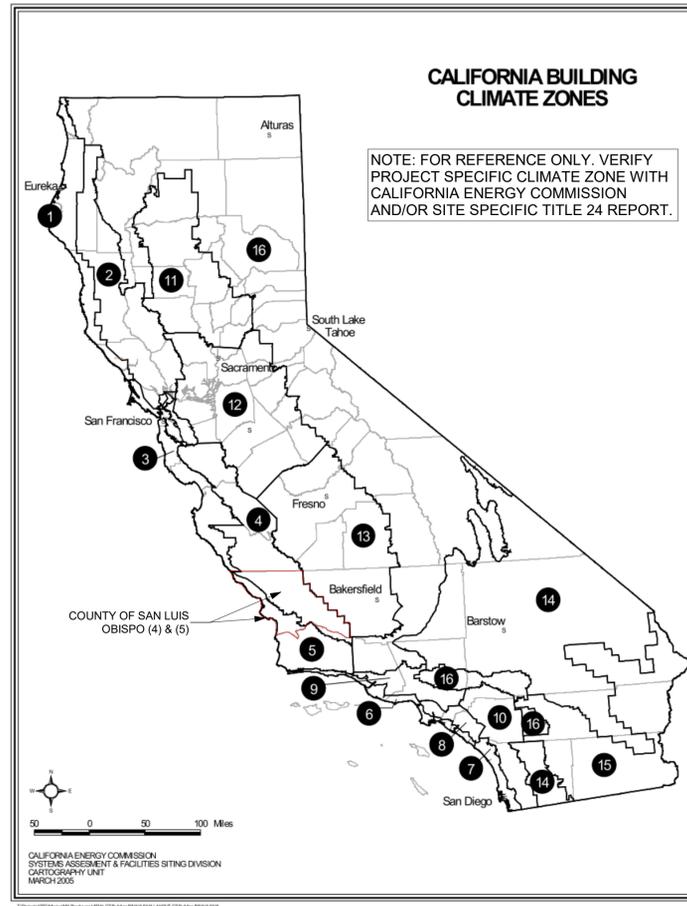


FIGURE 100.1-A—CALIFORNIA CLIMATE ZONES
Climate Zones for Residential and Nonresidential Occupancies

SECTION 100.1 – DEFINITIONS AND RULES OF CONSTRUCTION

ABBREVIATIONS


| | | | | | | | |
|-------|---------------------------------|--------|---|-------|----------------------------------|--------|---|
| A/C | AIR CONDITIONING | EXT | EXTERIOR | MAX | MAXIMUM | SF | SQUARE FOOT |
| ABV | ABOVE | FACP | FIRE ALARM CONTROL PANEL | MDF | MEDIUM DENSITY FIBERBOARD | SHT | SHEET |
| ACOUS | ACOUSTICAL | FAU | FORCED AIR UNIT | MECH | MECHANICAL | SHTHG | SHEATHING |
| ACT | ACOUSTICAL CEILING TILE | FAWP | FLUID APPLIED WATERPROOFING | MEMB | MEMBRANE | SIM | SIMILAR |
| ADA | AMERICANS WITH DISABILITIES ACT | FD | FLOOR DRAIN | MEP | MECHANICAL, ELECTRICAL, PLUMBING | SM | SHEET METAL |
| AFCI | ARC FAULT CIRCUIT INTERRUPTER | FDC | FIRE DEPARTMENT CONNECTION | MFR | MANUFACTURER | SPEC | SPECIFICATION |
| AFF | ABOVE FINISH FLOOR | FE | FIRE EXTINGUISHER | MIN | MINIMUM | SQ | SQUARE |
| AL | ALUMINUM | FEC | FIRE EXTINGUISHER CABINET | MISC | MISCELLANEOUS | SS | SOLID SURFACE |
| ALT | ALTERNATE | FF | FINISHED FLOOR ELEVATION | MO | MASONRY OPENING | SSTL | STAINLESS STEEL |
| ARCH | ARCHITECT(URAL) | FG | FINISHED GRADE | MTD | MOUNTED | STC | SOUND TRANSMISSION CLASS |
| BD | BOARD | FH | FIRE HYDRANT | MTL | METAL | STD | STANDARD |
| BDRM | BEDROOM | FHC | FIRE HOSE CABINET | N | NORTH | STL | STEEL |
| BET | BETWEEN | FIN | FINISH | NIC | NOT IN CONTRACT | STOR | STORAGE |
| BIT | BITUMINOUS | FIXT | FIXTURE | NO | NUMBER | STRUCT | STRUCTURAL |
| BLDG | BUILDING | FLR | FLOOR | NOM | NOMINAL | SUSP | SUSPENDED |
| BLKG | BLOCKING | FLUOR | FLOURESCENT | NTS | NOT TO SCALE | SV | SHEET VINYL |
| BLW | BELOW | FND | FOUNDATION | O.P. | OVERFLOW PIPE | SYM | SYMMETRICAL |
| BM | BEAM | FO | FACE OF | OC | ON CENTER | T | TREAD |
| BOT | BOTTOM | FOC | FACE OF CONCRETE | OD | OVERFLOW DRAIN | T&G | TONGUE & GROOVE |
| BUR | BUILT UP ROOF | FOF | FACE OF FINISH | OFF | OFFICE | TEL | TELEPHONE |
| CB | CATCH BASIN | FOIC | FURNISHED BY OWNER INSTALLED BY CONTRACTOR | OH | OPPOSITE HAND | TEMP | TEMPERED |
| CB | CALIFORNIA BUILDING CODE | FOM | FACE OF MASONRY | OPG | OPENING | TER | TERRAZZO |
| CEM | CEMENT | FOS | FACE OF STUD | OPP | OPPOSITE | THK | THICK |
| CFM | CUBIC FEET PER MINUTE | FRP | FIBERGLASS REINFORCED PANELS | (P) | PROPOSED | THR | THRESHOLD |
| CIP | CAST IN PLACE | FT | FOOT OR FEET | PERM | PERIMETER | TJI | TRUSS JOIST I-JOIST |
| CJ | CONTROL JOINT | FTG | FOOTING | PERP | PERPENDICULAR | TO | TOP OF |
| CL | CENTER LINE | GA | GAGE, GAGE | PC | PAINT GRADE | TOS | TOP OF SLAB |
| CLG | CEILING | GALV | GALVANIZED | PL | PLATE, PROPERTY LINE | TOW | TOP OF WALL |
| CLO | CLOSET | GB | GRAB BAR | PLAM | PLASTIC LAMINATE | TRANS | TRANSFORMER |
| CLR | CLEAR | GC | GENERAL CONTRACTOR | PLBG | PLUMBING | TV | TELEVISION |
| CMU | CONCRETE MASONRY UNIT | GFCI | GROUND FAULT CIRCUIT INTERRUPTER | PLYWD | PLYWOOD | TYP | TYPICAL |
| CO | CLEAN OUT | GWB | GYPSON BOARD | PNL | PANEL | UFAS | UNIFORM FEDERAL ACCESSIBILITY STANDARDS |
| COL | COLUMN | GYP | GYPSON | PP | POWER POLE | UG | UNDERGROUND |
| CONC | CONCRETE | HB | HOSE BIBB | PR | PAIR | UNFIN | UNFINISHED |
| CONST | CONSTRUCTION | HC | HOLLOW CORE | PRTN | PARTITION | UNO | ULNS NOTED OTHERWISE |
| CONT | CONTINUOUS | HDWD | HARDWOOD | PSF | POUNDS PER SQUARE FOOT | UV | ULTRAVIOLET |
| CONTR | CONTRACTOR | HDWR | HARDWARE | PSI | POUNDS PER SQUARE INCH | VCT | VINYL COMPOSITION TILE |
| CPT | CARPET | HGT | HEIGHT | PSL | PARALLEL STRAND LUMBER | VERT | VERTICAL |
| CT | CERAMIC TILE | HM | HOLLOW METAL | PT | PRESSURE TREATED | VIF | VERIFY IN FIELD |
| CTR | CENTER | HORIZ | HORIZONTAL | PTD | PAINTED | VTR | VENT TERMINATION PIPE |
| DBL | DOUBLE | HVAC | HEATING, VENTILATION, A/C | PV | PHOTO VOLTAIC | VWC | VINYL WALL COVERING |
| DF | DRINKING FOUNTAIN | ID | INSIDE DIAMETER | PVC | POLYVINYL CHLORIDE | W | WEST |
| DIA | DIAMETER, DIAPHRAGM | IIC | IMPACT INSULATION CLASS | PVMT | PAVEMENT | W | WITH |
| DIM | DIMENSION | IN | INCH | QTY | QUANTITY | WD | WASHER DRYER |
| DN | DOWN | INCAND | INCANDESCENT | R | RADIUS, RISER | WO | WITHOUT |
| DR | DOOR | INSUL | INSULATION, INSULATED | RB | RUBBER BASE | WC | WATERCLOSET |
| DS | DOWN SPOUT | INT | INTERIOR | RCP | REFLECTED CEILING PLAN | WD | WOOD |
| DTL | DETAIL | JC | JANITORS CLOSET | RD | ROOF DRAIN | WDW | WINDOW |
| DW | DISHWASHER | JT | JOINT | REF | REFRIGERATOR | WH | WATER HEATER |
| DWG | DRAWING | LAM | LAMINATE | REIN | REINFORCED | WI | WROUGHT IRON |
| (E) | EXISTING | LAV | LAVATORY | REQD | REQUIRED | WIN | WINDOW |
| E | EAST | LBS | POUNDS | RH | RIGHT HAND | WP | WATERPROOF(ING) |
| EA | EACH | LEED | LEADERSHIP IN ENERGY AND ENVIRONMENTAL DESIGN | RM | ROOM | WR | WEATHER RESISTIVE |
| EJ | EXPANSION JOINT | LF | LINEAR FEET | RO | ROUGH OPENING | WRB | WATER RESISTIVE BARRIER |
| EL | ELEVATION | LIN | LINEN CLOSET | RTU | ROOF TOP UNIT (MECH) | WSCT | WAINSCOT |
| ELEV | ELEVATION | LINO | LINOLEUM | S | SOUTH | WT | WEIGHT |
| ELEC | ELECTRIC | LT(G) | LIGHT(ING) | SAFB | SOUND ATTENUATION FIBER BATT | WWF | WELED WIRE FABRIC |
| ENCL | ENCLOSURE | LVL | LAMINATED VENEER LUMBER | SAWP | SAWY | YD | YARD |
| EQ | EQUAL | LVT | LUXURY VINYL TILE | SC | SCUPPER/SOLID CORE | | |
| EQUIP | EQUIPMENT | LW | LIGHTWEIGHT | SCHED | SCHEDULE | | |
| EXH | EXHAUST | | | SEAL | SEALANT | | |
| EXP | EXPANSION | | | SECT | SECTION | | |



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRACT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

FIRE HAZARD SEVERITY ZONES

DISCLAIMER: MAP IS FOR GENERAL REFERENCE ONLY. TO ACQUIRE ACCURATE INFORMATION FOR FIRE HAZARD SEVERITY IN SITE SPECIFIC LOCATION, REFER TO THE CALIFORNIA DEPARTMENT OF FORESTRY AND FIRE PROTECTION.

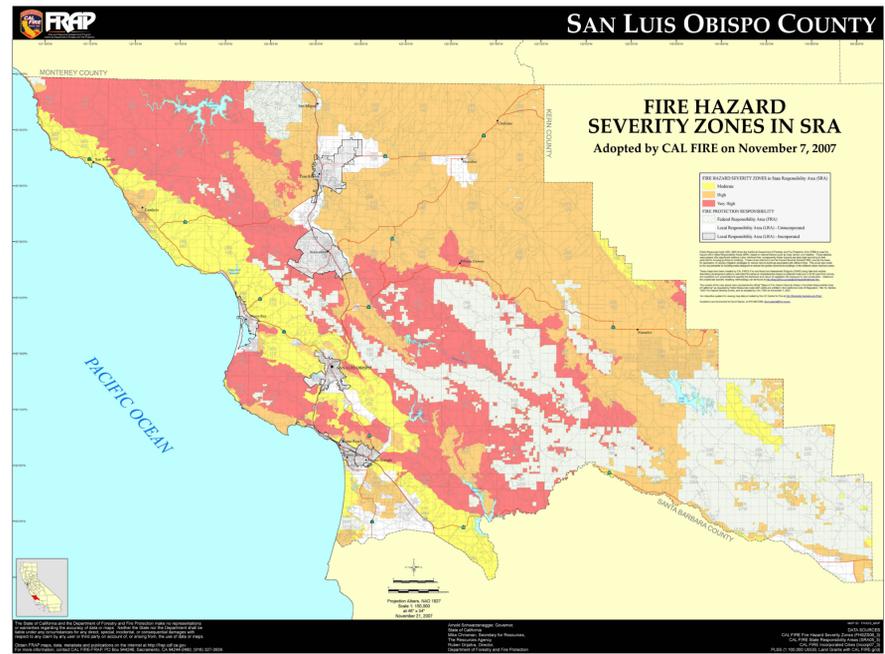

SYMBOLS

VIEW NUMBER: 20
VIEW TITLE: View Name
SCALE: 1/8" = 1'-0"

VIEW SHEET LOCATION: A-101, A-202
REFERENCE SHEET LOCATION: A-101

LEVEL DESIGNATION: Name 0'-0"

LEVEL ELEVATION: 0

BUILDING LEVELS: 101, 01, A4, S

DOOR W/CLOSER: 101, 01

DOOR TAG: 101, 01

WINDOW TAG: 01

WALL TAG: A4

STOREFRONT TAG: S

MATERIAL TAG: P1

REVISION TAG: 1, 2, 3, 4

CENTERLINE: CL

NORTH ARROW

GRID REFERENCE: 0

BUILDING ELEVATION: 1 A101

SECTION REFERENCE: 1 A101

INTERIOR ELEVATIONS: 1 A101, 2, 3, 4

DETAIL REFERENCE: 1 A101

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA

INDEX, ABBREVIATIONS, &
SYMBOLS

APPROVED SET

DATE: 09/28/2023
SHEET: G-102



2022 Single-Family Residential Mandatory Requirements Summary

§ 150.0(m)13: Space Conditioning System Airflow Rate and Fan Efficacy. Space conditioning systems that use ducts to supply cooling must have a hole for the placement of a static pressure probe, or a permanently installed static pressure probe in the supply plenum. Airflow must be 250 CFM per ton of nominal cooling capacity, and an air-handling unit fan efficiency <= 0.45 watts per CFM for gas furnace air handlers and <= 0.58 watts per CFM for all others. Small duct high velocity systems must provide an airflow >= 250 CFM per ton of nominal cooling capacity, and an air-handling unit fan efficiency <= 0.62 watts per CFM. Field verification testing is required in accordance with Reference Residential Appendix RA3.3.*

Ventilation and Indoor Air Quality:

§ 150.0(o)1: Requirements for Ventilation and Indoor Air Quality. All dwelling units must meet the requirements of ASHRAE Standard 62.2, Ventilation and Acceptable Indoor Air Quality in Residential Buildings subject to the amendments specified in § 150.0(o)1.*

§ 150.0(o)1B: Central Fan Integrated (CFI) Ventilation Systems. Continuous operation of CFI air handlers is not allowed to provide the whole-dwelling unit ventilation airflow required per § 150.0(o)1C. A motorized damper(s) must be installed on the ventilation duct(s) that prevents all airflow through the space conditioning duct system when the damper(s) is closed and controlled per § 150.0(o)1B(ii)(iv). CFI ventilation systems must have controls that track outdoor air ventilation run time, and either open or close the motorized damper(s) for compliance with § 150.0(o)1C.

§ 150.0(o)1C: Whole-Dwelling Unit Mechanical Ventilation for Single-Family Detached and Townhouses. Single-family detached dwelling units, and attached dwelling units not sharing ceilings or floors with other dwelling units, occupiable spaces, public garages, or commercial spaces must have mechanical ventilation airflow specified in § 150.0(o)1C-ii.

§ 150.0(o)1G: Local Mechanical Exhaust. Kitchens and bathrooms must have local mechanical exhaust; nonenclosed kitchens must have demand-controlled exhaust system meeting requirements of § 150.0(o)1G(i) enclosed kitchens and bathrooms can use demand-controlled or continuous exhaust meeting § 150.0(o)1G(ii)-(iv). Airflow must be measured by the installer per § 150.0(o)1G(v), and rated for sound per § 150.0(o)1G(vi).*

§ 150.0(o)1H(i): Airflow Measurement and Sound Ratings of Whole-Dwelling Unit Ventilation Systems. The airflow required per § 150.0(o)1C must be measured by using a flow hood, flow grid, or other airflow measuring device at the fan's inlet or outlet terminals/grilles per Reference Residential Appendix RA3.7. Whole-dwelling unit ventilation systems must be rated for sound per ASHRAE 62.2 § 7.2 at no less than the minimum airflow rate required by § 150.0(o)1C.

§ 150.0(o)2: Field Verification and Diagnostic Testing. Whole-dwelling unit ventilation airflow, vented range hood airflow and sound rating, and HRV and ERV fan efficiency must be verified in accordance with Reference Residential Appendix RA3.7. Vented range hoods must be verified per Reference Residential Appendix RA3.7.4.3 to confirm if it is rated by HVI or AHAM to comply with the airflow rates and sound requirements per § 150.0(o)1G

Pool and Spa Systems and Equipment:

§ 110.4(a): Certification by Manufacturers. Any pool or spa heating system or equipment must be certified to have all of the following: compliance with the Appliance Efficiency Regulations and listing in MAEDDS; an on-off switch mounted outside of the heater that allows shutting off the heater without adjusting the thermostat setting; a permanent weatherproof plate or card with operating instructions; and must not use electric resistance heating.*

§ 110.4(b)1: Piping. Any pool or spa heating system or equipment must be installed with at least 36 inches of pipe between the filter and the heater, or dedicated suction and return lines, or built-in or built-up connections to allow for future solar heating.

§ 110.4(b)2: Covers. Outdoor pools or spas that have a heat pump or gas heater must have a cover.

§ 110.4(b)3: Directional Inlets and Time Switches for Pools. Pools must have directional inlets that adequately mix the pool water, and a time switch that will allow all pumps to be set or programmed to run only during off-peak electric demand periods.

§ 110.5: Pilot Light. Natural gas pool and spa heaters must not have a continuously burning pilot light.

§ 150.0(p): Pool Systems and Equipment Installation. Residential pool systems or equipment must meet the specified requirements for pump sizing, flow rate, piping, filters, and valves.*

Lighting:

§ 110.9: Lighting Controls and Components. All lighting control devices and systems, ballasts, and luminaires must meet the applicable requirements of § 110.9.*

§ 150.0(k)1A: Luminaire Efficacy. All installed luminaires must meet the requirements in Table 150.0-A, except lighting integral to exhaust fans, kitchen range hoods, bath vanity mirrors, and garage door openers; navigation lighting less than 5 watts; and lighting internal to drawers, cabinets, and linen closets with an efficacy of at least 45 lumens per watt.

§ 150.0(k)1B: Screw based luminaires. Screw based luminaires must contain lamps that comply with Reference Joint Appendix JA8.*

§ 150.0(k)1C: Recessed Downlight Luminaires in Ceilings. Luminaires recessed into ceilings must not contain screw based sockets, must be airtight, and must be sealed with a gasket or caulk. California Electrical Code § 410.116 must also be met.

§ 150.0(k)1D: Light Sources in Enclosed or Recessed Luminaires. Lamps and other separable light sources that are not compliant with the JAB elevated temperature requirements, including marking requirements, must not be installed in enclosed or recessed luminaires.

§ 150.0(k)1E: Blank Electrical Boxes. The number of electrical boxes that are more than five feet above the finished floor and do not contain a luminaire or other device shall be no more than the number of bedrooms. These boxes must be served by a dimmer, vacancy sensor control, low voltage wiring, or fan speed control.

§ 150.0(k)1F: Lighting Integral to Exhaust Fans. Lighting integral to exhaust fans (except when installed by the manufacturer in kitchen exhaust hoods) must meet the applicable requirements of § 150.0(k).

5/6/22

03



2022 Single-Family Residential Mandatory Requirements Summary

§ 110.5: Pilot Lights. Continuously burning pilot lights are prohibited for natural gas: fan-type central furnaces; household cooking appliances (except appliances without an electrical supply voltage connection with pilot lights that consume less than 150 Btu per hour); and pool and spa heaters.*

§ 150.0(h)1: Building Cooling and Heating Loads. Heating and/or cooling loads are calculated in accordance with the ASHRAE Handbook, Equipment Volume, Applications Volume, and Fundamentals Volume; the SMACNA Residential Comfort System Installation Standards Manual; or the ACCA Manual J using design conditions specified in § 150.0(h)2.

§ 150.0(h)3A: Clearances. Air conditioner and heat pump outdoor condensing units must have a clearance of at least five feet from the outlet of any dryer.

§ 150.0(h)3B: Liquid Line Drier. Air conditioners and heat pump systems must be equipped with liquid line filter driers if required, as specified by the manufacturer's instructions.

§ 150.0(j)1: Water Piping, Solar Water-heating System Piping, and Space Conditioning System Line Insulation. All domestic hot water piping must be insulated as specified in § 609.11 of the California Plumbing Code.*

§ 150.0(j)2: Insulation Protection. Piping insulation must be protected from damage, including that due to sunlight, moisture, equipment maintenance, and wind as required by § 120.3(b). Insulation exposed to weather must be water resistant and protected from UV light (no adhesive tapes). Insulation covering chilled water piping and refrigerant suction piping located outside the conditioned space must include, or be protected by, a Class I or Class II vapor retarder. Pipe insulation buried below grade must be installed in a waterproof and non-crushable casing or sleeve.

§ 150.0(n)1: Gas or Propane Water Heating Systems. Systems using gas or propane water heaters to serve individual dwelling units must designate a space at least 2.5' x 2.5' x 7' suitable for the future installation of a heat pump water heater, and meet electrical and plumbing requirements, based on the distance between this designated space and the water heater location; and a condensate drain no more than 2' higher than the base of the water heater.

§ 150.0(n)3: Solar Water-heating Systems. Solar water-heating systems and collectors must be certified and rated by the Solar Rating and Certification Corporation (SRCC), the International Association of Plumbing and Mechanical Officials, Research and Testing (IAPMO R&T), or by a listing agency that is approved by the executive director.

Ducts and Fans:

§ 110.8(d)3: Ducts. Insulation installed on an existing space-conditioning duct must comply with § 604.0 of the California Mechanical Code (CMC). If a contractor installs the insulation, the contractor must certify to the customer, in writing, that the insulation meets this requirement.

§ 150.0(m)1: CMC Compliance. All air-distribution system ducts and plenums must meet CMC §§ 601.0-605.0 and ANSISMACNA-006-2006 HVAC Duct Construction Standards Metal and Flexible 3rd Edition. Portions of supply-air and return-air ducts and plenums must be insulated to R-6.0 or higher; ducts located entirely in conditioned space as confirmed through field verification and diagnostic testing (RA3.1.4.3.8) do not require insulation. Connections of metal ducts and inner core of flexible ducts must be mechanically fastened. Openings must be sealed with mastic, tape, or other duct-closure system that meets the applicable UL requirements, or aerosol sealant that meets UL 723. The combination of mastic and either mesh or tape must be used to seal openings greater than 1/4". If mastic or tape is used, Building cavities, air handler support platforms, and plenums designed or constructed with materials other than sealed sheet metal, duct board or flexible duct must not be used to convey conditioned air. Building cavities and support platforms may contain ducts; ducts installed in these spaces must not be compressed.*

§ 150.0(m)2: Factory-Fabricated Duct Systems. Factory-fabricated duct systems must comply with applicable requirements for duct construction, connections, and closures; joints and seams of duct systems and their components must not be sealed with cloth back rubber adhesive duct tapes unless such tape is used in combination with mastic and draw bands.

§ 150.0(m)3: Field-Fabricated Duct Systems. Field-fabricated duct systems must comply with applicable requirements for: pressure-sensitive tapes, mastics, sealants, and other requirements specified for duct construction.

§ 150.0(m)7: Backdraft Damper. Fan systems that exchange air between the conditioned space and outdoors must have backdraft or automatic dampers.

§ 150.0(m)8: Gravity Ventilation Dampers. Gravity ventilating systems serving conditioned space must have either automatic or readily accessible, manually operated dampers in all openings to the outside, except combustion inlet and outlet air openings and elevator shaft vents.

§ 150.0(m)9: Protection of Insulation. Insulation must be protected from damage due to sunlight, moisture, equipment maintenance, and wind. Insulation exposed to weather must be suitable for outdoor service (e.g., protected by aluminum sheet metal, painted canvas, or plastic cover). Cellular foam insulation must be protected as above or painted with a water resistant and solar radiation-resistant coating.

§ 150.0(m)10: Porous Inner Core Flex Duct. Porous inner cores of flex ducts must have a non-porous layer or air barrier between the inner core and outer vapor barrier.

§ 150.0(m)11: Duct System Sealing and Leakage Test. When space conditioning systems use forced air duct systems to supply conditioned air to an occupiable space, the ducts must be sealed and duct leakage tested, as confirmed through field verification and diagnostic testing, in accordance with Reference Residential Appendix RA3.1.

§ 150.0(m)12: Air Filtration. Space conditioning systems with ducts exceeding 10 feet and the supply side of ventilation systems must have MERV 13 or equivalent filters. Filters for space conditioning systems must have a two inch depth or be one inch if sized per Equalon 150-A. Clean-filter pressure drop and labeling must meet the requirements in § 150.0(m)12. Filters must be accessible for regular service. Filter racks or grilles must use gaskets, sealing, or other means to close gaps around the inserted filter to and prevent air from bypassing the filter.*

5/6/22

02



2022 Single-Family Residential Mandatory Requirements Summary

NOTE: Single-family residential buildings subject to the Energy Codes must comply with all applicable mandatory measures, regardless of the compliance approach used. Review the respective section for more information. (04/2022)

Building Envelope:

§ 110.6(a)1: Air Leakage. Manufactured fenestration, exterior doors, and exterior pet doors must limit air leakage to 0.3 CFM per square foot or less when tested per NFRC-400, ASTM E283, or AAMA WDMA/CSA 1011 S.2/A440-2011.*

§ 110.6(a)5: Labeling. Fenestration products and exterior doors must have a label meeting the requirements of § 10-111(a).

§ 110.6(b): Field fabricated exterior doors and fenestration products must use U-factors and solar heat gain coefficient (SHGC) values from Tables 110.6-A, 110.6-B, or JA4.5 for exterior doors. They must be caulked and/or weather-stripped.

§ 110.7: Air Leakage. Gaskets, penetrations, and other openings in the building envelope that are potential sources of air leakage must be caulked, gasketed, or weather-stripped.

§ 110.8(a): Insulation Certification by Manufacturers. Insulation must be certified by the Department of Consumer Affairs, Bureau of Household Goods and Services (BHGS).

§ 110.8(g): Insulation Requirements for Heated Slab Floors. Heated slab floors must be insulated per the requirements of § 110.8(g).

§ 110.8(i): Roofing Products Solar Reflectance and Thermal Emittance. The thermal emittance and aged solar reflectance values of the roofing material must meet the requirements of § 110.8(i) and be labeled per § 110-113 when the installation of a cool roof is specified on the CFI-R.

§ 110.8(j): Radiant Barrier. When required, radiant barriers must have an emittance of 0.05 or less and be certified to the Department of Consumer Affairs.

§ 150.0(a): Roof Deck, Ceiling and Rafter Roof Insulation. Roof decks in newly constructed attics in climate zones 4 and 8-16 area-weighted average U-factor not exceeding U-0.184. Ceiling and rafter roofs minimum R-22 insulation in wood-frame ceiling; or area-weighted average U-factor must not exceed 0.043. Rafter roof alterations minimum R-19 or area-weighted average U-factor of 0.054 or less. Attic access doors must have permanently attached insulation using adhesive or mechanical fasteners. The attic access must be gasketed to prevent air leakage. Insulation must be installed in direct contact with a roof or ceiling which is sealed to limit infiltration and exfiltration as specified in § 110.7, including but not limited to placing insulation either above or below the roof deck or on top of a drywall ceiling.

§ 150.0(b): Loose-fill Insulation. Loose fill insulation must meet the manufacturer's required density for the labeled R-value.

§ 150.0(c): Wall Insulation. Minimum R-13 insulation in 2x4 inch wood framing wall or have a U-factor of 0.102 or less, or R-20 in 2x6 inch wood framing or have a U-factor of 0.071 or less. Opaque non-framed assemblies must have an overall assembly U-factor not exceeding 0.102. Masonry walls must meet Tables 150.1-A or B.*

§ 150.0(d): Raised-floor Insulation. Minimum R-19 insulation in raised wood framed floor or 0.037 maximum U-factor.*

§ 150.0(f): Slab Edge Insulation. Slab edge insulation must meet all of the following: have a water absorption rate, for the insulation material alone without facings, no greater than 0.3 percent; have a water vapor permeance no greater than 2.0 perm per inch; be protected from physical damage and UV light deterioration; and, when installed as part of a heated slab floor, meet the requirements of § 110.8(g).

§ 150.0(g)1: Vapor Retarder. In climate zones 1 through 16, the earth floor or unvented crawl space must be covered with a Class I or Class II vapor retarder. This requirement also applies to controlled ventilation crawl space for buildings complying with the exception to § 150.0(g).

§ 150.0(g)2: Vapor Retarder. In climate zones 14 and 16, a Class I or Class II vapor retarder must be installed on the conditioned space side of all insulation in all exterior walls, vented attics, and unvented attics with air-permeable insulation.

§ 150.0(q): Fenestration Products. Fenestration, including skylights, separating conditioned space from unconditioned space or outdoors must have a maximum U-factor of 0.45; or area-weighted average U-factor of fenestration must not exceed 0.45.

Fireplaces, Decorative Gas Appliances, and Gas Log:

§ 110.5(e): Pilot Light. Continuously burning pilot lights are not allowed for indoor and outdoor fireplaces.

§ 150.0(e)1: Closable Doors. Masonry or factory-built fireplaces must have a closable metal or glass door covering the entire opening of the firebox.

§ 150.0(e)2: Combustion Intake. Masonry or factory-built fireplaces must have a combustion outside air intake, which is at least six square inches in area and is equipped with a readily accessible, operable, and tight-fitting damper or combustion-air control device.*

§ 150.0(e)3: Flue Damper. Masonry or factory-built fireplaces must have a flue damper with a readily accessible control device.*

Space Conditioning, Water Heating, and Plumbing System:

§ 110.0-§ 110.3: Certification. Heating, ventilation, and air conditioning (HVAC) equipment, water heaters, showerheads, faucets, and all other regulated appliances must be certified by the manufacturer to the California Energy Commission.

§ 110.2(a): HVAC Efficiency. Equipment must meet the applicable efficiency requirements in Table 110.2-A through Table 110.2-N.*

§ 110.2(b): Controls for Heat Pumps with Supplementary Electric Resistance Heaters. Heat pumps with supplementary electric resistance heaters must have controls that prevent supplementary heater operation when the heating load can be met by the heat pump alone; and in which the cut-out temperature for compression heating is higher than the cut-out temperature for supplementary heating, and the cut-off temperature for compression heating is higher than the cut-off temperature for supplementary heating.

§ 110.2(c): Thermostats. All heating or cooling systems not controlled by a central energy management control system (EMCS) must have a setback thermostat.*

§ 110.3(c)3: Insulation. Unlined service water heater storage tanks and solar water-heating backup tanks must have adequate insulation, or tank surface heat loss rating.

§ 110.3(c)6: Isolation Valves. Instantaneous water heaters with an input rating greater than 6.5 kBtu per hour (2 kW) must have isolation valves with hose bibbs or other fittings on both cold and hot water lines to allow for flushing the water heater when the valves are closed.

5/6/22

01



2022 Single-Family Residential Mandatory Requirements Summary

§ 150.0(s): Energy Storage System (ESS) Ready. All single-family residences must meet all of the following: Either ESS-ready interconnection equipment with backed up capacity of 60 amps or more and four or more ESS supplied branch circuits, or a dedicated raceway from the main service to a subpanel that supplies the branch circuits in § 150.0(s); at least four branch circuits must be identified and have their source collocaated at a single panelboard suitable to be supplied by the ESS, with one circuit supplying the refrigerator, one lighting circuit near the primary exit, and one circuit supplying a sleeping room receptacle outlet; main panelboard must have a minimum busbar rating of 225 amps; sufficient space must be reserved to allow future installation of a system isolation equipment/transfer switch within 3' of the main panelboard, with raceways installed between the panelboard and the switch location to allow the connection of backup power source.

§ 150.0(t): Heat Pump Space Heater Ready. Systems using gas or propane furnaces to serve individual dwelling units must include: A dedicated unobstructed 240V branch circuit wiring installed within 3' of the furnace with circuit conductors rated at least 30 amps with the blank cover identified as "240V ready;" and a reserved main electrical service panel space to allow for the installation of a double pole circuit breaker permanently marked as "For Future 240V use."

§ 150.0(u): Electric Cooktop Ready. Systems using gas or propane cooktop to serve individual dwelling units must include: A dedicated unobstructed 240V branch circuit wiring installed within 3' of the cooktop with circuit conductors rated at least 50 amps with the blank cover identified as "240V ready;" and a reserved main electrical service panel space to allow for the installation of a double pole circuit breaker permanently marked as "For Future 240V use."

§ 150.0(v): Electric Clothes Dryer Ready. Clothes dryer locations with gas or propane plumbing to serve individual dwelling units must include: A dedicated unobstructed 240V branch circuit wiring installed within 3' of the dryer location with circuit conductors rated at least 30 amps with the blank cover identified as "240V ready;" and a reserved main electrical service panel space to allow for the installation of a double pole circuit breaker permanently marked as "For Future 240V use."

*Exceptions may apply.

5/6/22

05



2022 Single-Family Residential Mandatory Requirements Summary

§ 150.0(k)1G: Screw based luminaires. Screw based luminaires must contain lamps that comply with Reference Joint Appendix JA8.*

§ 150.0(k)1H: Light Sources in Enclosed or Recessed Luminaires. Lamps and other separable light sources that are not compliant with the JAB elevated temperature requirements, including marking requirements, must not be installed in enclosed or recessed luminaires.

§ 150.0(k)1I: Light Sources in Drawers, Cabinets, and Linen Closets. Light sources internal to drawers, cabinetry or linen closets are not required to comply with Table 150.0-A or be controlled by vacancy sensors provided that they are rated to consume no more than 5 watts of power, emit no more than 150 lumens, and are equipped with controls that automatically turn the lighting off when the drawer, cabinet or linen closet is closed.

§ 150.0(k)2A: Interior Switches and Controls. All forward phase cut dimmers used with LED light sources must comply with NEMA SSL 7A.

§ 150.0(k)2B: Interior Switches and Controls. Exhaust fans must be controlled separately from lighting systems.*

§ 150.0(k)2A: Accessible Controls. Lighting must have readily accessible wall-mounted controls that allow the lighting to be manually turned on and off.*

§ 150.0(k)2B: Multiple Controls. Controls must not bypass a dimmer, occupant sensor, or vacancy sensor function if the dimmer or sensor is installed to comply with § 150.0(k).

§ 150.0(k)2C: Mandatory Requirements. Lighting controls must comply with the applicable requirements of § 110.9.

§ 150.0(k)2D: Energy Management Control Systems. An energy management control system (EMCS) may be used to comply with dimming, occupancy, and control requirements if it provides the functionality of the specified control per § 110.9 and the physical controls specified in § 150.0(k)2A.

§ 150.0(k)2E: Automatic Shut-off Controls. In bathrooms, garages, laundry rooms, utility rooms and walk-in closets, at least one installed luminaire must be controlled by an occupancy or vacancy sensor providing automatic off functionality. Lighting inside drawers and cabinets with opaque fronts or doors must have controls that turn the light off when the drawer or door is closed.

§ 150.0(k)2F: Dimmers. Lighting in habitable spaces (e.g., living rooms, dining rooms, kitchens, and bedrooms) must have readily accessible wall-mounted dimming controls that allow the lighting to be manually adjusted up and down. Forward phase cut dimmers controlling LED light sources in these spaces must comply with NEMA SSL 7A.

§ 150.0(k)2K: Independent controls. Integrated lighting of exhaust fans shall be controlled independently from the fans. Lighting under cabinets or shelves, lighting in display cabinets, and switched outlets must be controlled separately from ceiling-installed lighting.

§ 150.0(k)3A: Residential Outdoor Lighting. For single-family residential buildings, outdoor lighting permanently mounted to a residential building, or to other buildings on the same lot, must have a manual on/off switch and either a photocell and motion sensor or automatic time switch control or an astronomical time clock. An energy management control system that provides the specified control functionality and meets all applicable requirements may be used to meet these requirements.

§ 150.0(k)4: Internally illuminated address signs. Internally illuminated address signs must either comply with § 140.8 or consume no more than 5 watts of power.

§ 150.0(k)5: Residential Garages for Eight or More Vehicles. Lighting for residential parking garages for eight or more vehicles must comply with the applicable requirements for nonresidential garages in §§ 110.9, 130.0, 130.1, 130.4, 140.6, and 141.0.

Solar Readiness:

§ 110.10(a)1: Single-family Residences. Single-family residences located in subdivisions with 10 or more single-family residences and where the application for a tentative subdivision map for the residences has been deemed complete and approved by the enforcement agency, which do not have a photovoltaic system installed, must comply with the requirements of § 110.10(b)-(e).

§ 110.10(b)1A: Minimum Solar Zone Area. The solar zone must have a minimum total area as described below. The solar zone must comply with access, pathway, smoke ventilation, and spacing requirements as specified in Title 24, Part 9 or other parts of Title 24 or in any requirements adopted by a local jurisdiction. The solar zone total area must be comprised of areas that have no dimension less than 5 feet and are no less than 80 square feet for buildings with roof areas less than or equal to 10,000 square feet or no less than 160 square feet each for buildings with roof areas greater than 10,000 square feet. For single-family residences, the solar zone must be located on the roof or overhang of the building and have a total area no less than 250 square feet.*

§ 110.10(b)2: Azimuth. All sections of the solar zone located on steep-sloped roofs must have an azimuth between 90-300° of true north.

§ 110.10(b)3A: Shading. The solar zone must not contain any obstructions, including but not limited to: vents, chimneys, architectural features, and roof mounted equipment.*

§ 110.10(b)3B: Shading. Any obstruction located on the roof or any other part of the building that projects above a solar zone must be located at least twice the horizontal distance of the height difference between the highest point of the obstruction and the horizontal projection of the nearest point of the solar zone, measured in the vertical plane.*

§ 110.10(b)4: Structural Design Loads on Construction Documents. For areas of the roof designated as a solar zone, the structural design loads for roof dead load and roof live load must be clearly indicated on the construction documents.

§ 110.10(c): Interconnection Pathways. The construction documents must indicate a location reserved for inverters and metering equipment and a pathway reserved for routing of conduit from the solar zone to the point of interconnection with the electrical service; and for single-family residences and central water-heating systems, a pathway reserved for routing plumbing from the solar zone to the water-heating system.

§ 110.10(d): Documentation. A copy of the construction documents or a comparable document indicating the information from § 110.10(b)-(c) must be provided to the occupant.

§ 110.10(e)1: Main Electrical Service Panel. The main electrical service panel must have a minimum busbar rating of 200 amps.

§ 110.10(e)2: Main Electrical Service Panel. The main electrical service panel must have a reserved space to allow for the installation of a double pole circuit breaker for a future solar electric installation. The reserved space must be permanently marked as "For Future Solar Electric."

Electric and Energy Storage Ready:

5/6/22

04



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRACT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA
2022 SINGLE-FAMILY RESIDENTIAL
MANDATORY REQUIREMENTS

APPROVED SET

DATE
09/28/2023
SHEET

G-103

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

RESIDENTIAL MANDATORY MEASURES (SHEET 1)



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT UNDER THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRACT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

CHAPTER 1 - ADMINISTRATION

SECTION 101 GENERAL

101.1 TITLE.
THESE REGULATIONS SHALL BE KNOWN AS THE CALIFORNIA GREEN BUILDING STANDARDS CODE AND MAY BE CITED AS SUCH AND WILL BE REFERRED TO HEREIN AS "THIS CODE." IT IS INTENDED THAT IT SHALL ALSO BE KNOWN AS THE CALGREEN CODE. THE CALIFORNIA GREEN BUILDING STANDARDS CODE IS PART 11 OF THIRTEEN PARTS OF THE OFFICIAL COMPILATION AND PUBLICATION OF THE ADOPTION, AMENDMENT AND REPEAL OF BUILDING REGULATIONS TO THE CALIFORNIA CODE OF REGULATIONS, TITLE 24, ALSO REFERRED TO AS THE CALIFORNIA BUILDING STANDARDS CODE.

101.2 PURPOSE.
THE PURPOSE OF THIS CODE IS TO IMPROVE PUBLIC HEALTH, SAFETY AND GENERAL WELFARE BY ENHANCING THE DESIGN AND CONSTRUCTION OF BUILDINGS THROUGH THE USE OF BUILDING CONCEPTS HAVING A REDUCED NEGATIVE IMPACT OR POSITIVE ENVIRONMENTAL IMPACT AND ENCOURAGING SUSTAINABLE CONSTRUCTION PRACTICES IN THE FOLLOWING CATEGORIES:
1. PLANNING AND DESIGN.
2. ENERGY EFFICIENCY.
3. WATER EFFICIENCY AND CONSERVATION.
4. MATERIAL CONSERVATION AND RESOURCE EFFICIENCY.
5. ENVIRONMENTAL QUALITY.

101.3 SCOPE.
THE PROVISIONS OF THIS CODE SHALL APPLY TO THE PLANNING, DESIGN, OPERATION, CONSTRUCTION, USE AND OCCUPANCY OF EVERY NEWLY CONSTRUCTED BUILDING OR STRUCTURE, UNLESS OTHERWISE INDICATED IN THIS CODE, THROUGHOUT THE STATE OF CALIFORNIA.

IT IS NOT THE INTENT THAT THIS CODE SUBSTITUTE OR BE IDENTIFIED AS MEETING THE CERTIFICATION REQUIREMENTS OF ANY GREEN BUILDING PROGRAM.

SECTION 102 CONSTRUCTION DOCUMENTS AND INSTALLATION VERIFICATION

102.1 SUBMITTAL DOCUMENTS.
CONSTRUCTION DOCUMENTS AND OTHER DATA SHALL BE SUBMITTED IN ONE OR MORE SETS WITH EACH APPLICATION FOR A PERMIT, WHERE SPECIAL CONDITIONS EXIST, THE ENFORCING AGENCY IS AUTHORIZED TO REQUIRE ADDITIONAL CONSTRUCTION DOCUMENTS TO BE PREPARED BY A LICENSED DESIGN PROFESSIONAL AND MAY BE SUBMITTED SEPARATELY.

EXCEPTION: THE ENFORCING AGENCY IS AUTHORIZED TO WAIVE THE SUBMISSION OF CONSTRUCTION DOCUMENTS AND OTHER DATA NOT REQUIRED TO BE PREPARED BY A LICENSED DESIGN PROFESSIONAL.

102.2 INFORMATION ON CONSTRUCTION DOCUMENTS.
CONSTRUCTION DOCUMENTS SHALL BE OF SUFFICIENT CLARITY TO INDICATE THE LOCATION, NATURE AND SCOPE OF THE PROPOSED GREEN BUILDING FEATURE AND SHOW THAT IT WILL CONFORM TO THE PROVISIONS OF THIS CODE, THE CALIFORNIA BUILDING STANDARDS CODE AND OTHER RELEVANT LAWS, ORDINANCES, RULES AND REGULATIONS AS DETERMINED BY THE ENFORCING AGENCY.

102.3 VERIFICATION.
DOCUMENTATION OF CONFORMANCE FOR APPLICABLE GREEN BUILDING MEASURES SHALL BE PROVIDED TO THE ENFORCING AGENCY. ALTERNATE METHODS OF DOCUMENTATION SHALL BE ACCEPTABLE WHEN THE ENFORCING AGENCY FINDS THAT THE PROPOSED ALTERNATE DOCUMENTATION IS SATISFACTORY TO DEMONSTRATE SUBSTANTIAL CONFORMANCE WITH THE INTENT OF THE PROPOSED GREEN BUILDING MEASURE.

CHAPTER 3 - GREEN BUILDING

SECTION 301 GENERAL

301.1 SCOPE.
BUILDINGS SHALL BE DESIGNED TO INCLUDE THE GREEN BUILDING MEASURES SPECIFIED AS MANDATORY IN THE APPLICATION CHECKLISTS CONTAINED IN THIS CODE. VOLUNTARY GREEN BUILDING MEASURES, ALSO INCLUDED IN THE APPLICATION CHECKLISTS AND MAY BE INCLUDED IN THE DESIGN AND CONSTRUCTION OF STRUCTURES COVERED BY THIS CODE, BUT ARE NOT REQUIRED UNLESS ADOPTED BY A CITY, COUNTY, OR CITY AND COUNTY AS SPECIFIED IN SECTION 101.7.

301.1.1 ADDITIONS AND ALTERATIONS. [HCD] THE MANDATORY PROVISIONS OF CHAPTER 4 SHALL BE APPLIED TO ADDITIONS OR ALTERATIONS OF EXISTING RESIDENTIAL BUILDINGS WHERE THE ADDITION OR ALTERATION INCREASES THE BUILDING'S CONDITIONED AREA, VOLUME, OR SIZE. THE REQUIREMENTS SHALL APPLY ONLY TO AND/OR WITHIN THE SPECIFIC AREA OF THE ADDITION OR ALTERATION.

THE MANDATORY PROVISIONS OF SECTION 4.106.4.2 MAY APPLY TO ADDITIONS OR ALTERATIONS OF EXISTING PARKING FACILITIES OR THE ADDITION OF NEW PARKING FACILITIES SERVING EXISTING MULTIFAMILY BUILDINGS. SEE SECTION 4.106.4.3 FOR APPLICATION.

NOTE: REPAIRS INCLUDING, BUT NOT LIMITED TO, RESURFACING, RESTRIPING, AND REPAIRING OR MAINTAINING EXISTING LIGHTING FIXTURES ARE NOT CONSIDERED ALTERATIONS FOR THE PURPOSE OF THIS SECTION.

301.2 LOW-RISE AND HIGH-RISE RESIDENTIAL BUILDINGS [HCD].
THE PROVISIONS OF INDIVIDUAL SECTIONS OF CALGREEN MAY APPLY TO EITHER LOW-RISE RESIDENTIAL BUILDINGS, HIGH-RISE RESIDENTIAL BUILDINGS, OR BOTH. INDIVIDUAL SECTIONS WILL BE DESIGNATED BY BANNERS TO INDICATE WHERE THE SECTION APPLIES SPECIFICALLY TO LOW-RISE ONLY (LR) OR HIGH-RISE ONLY (HR), WHEN THE SECTION APPLIES TO BOTH LOW-RISE AND HIGH-RISE BUILDINGS, NO BANNER WILL BE USED.

SECTION 302 MIXED OCCUPANCY BUILDINGS

302.1 MIXED OCCUPANCY BUILDINGS.
IN MIXED OCCUPANCY BUILDINGS, EACH PORTION OF A BUILDING SHALL COMPLY WITH THE SPECIFIC GREEN BUILDING MEASURES APPLICABLE TO EACH SPECIFIC OCCUPANCY.

CHAPTER 4 - RESIDENTIAL MANDATORY MEASURES

DIVISION 4.1 PLANNING AND DESIGN

4.106 SITE DEVELOPMENT

4.106.1 GENERAL.
PRESERVATION AND USE OF AVAILABLE NATURAL RESOURCES SHALL BE ACCOMPLISHED THROUGH EVALUATION AND CAREFUL PLANNING TO MINIMIZE NEGATIVE EFFECTS ON THE SITE AND ADJACENT AREAS. PRESERVATION OF SLOPES, MANAGEMENT OF STORM WATER DRAINAGE AND EROSION CONTROLS SHALL COMPLY WITH THIS SECTION.

4.106.2 STORM WATER DRAINAGE AND RETENTION DURING CONSTRUCTION
PROJECTS WHICH DISTURB LESS THAN ONE ACRE OF SOIL AND ARE NOT PART OF A LARGER COMMON PLAN OF DEVELOPMENT WHICH IN TOTAL DISTURBS ONE ACRE OR MORE, SHALL MANAGE STORM WATER DRAINAGE DURING CONSTRUCTION. IN ORDER TO MANAGE STORM WATER DRAINAGE DURING CONSTRUCTION, ONE OR MORE OF THE FOLLOWING MEASURES SHALL BE IMPLEMENTED TO PREVENT FLOODING OF ADJACENT PROPERTY, PREVENT EROSION AND RETAIN SOIL RUNOFF ON THE SITE.
1. RETENTION BASINS OF SUFFICIENT SIZE SHALL BE UTILIZED TO RETAIN STORM WATER ON THE SITE.
2. WHERE STORM WATER IS CONVEYED TO A PUBLIC DRAINAGE SYSTEM, COLLECTION POINT, GUTTER OR SIMILAR DISPOSAL METHOD, WATER SHALL BE FILTERED BY USE OF A BARRIER SYSTEM, WATTLE OR OTHER METHOD APPROVED BY THE ENFORCING AGENCY.
3. COMPLIANCE WITH A LAWFULLY ENACTED STORM WATER MANAGEMENT ORDINANCE.

4.106.3 GRADING AND PAVING
CONSTRUCTION PLANS SHALL INDICATE HOW THE SITE GRADING OR DRAINAGE SYSTEM WILL MANAGE ALL SURFACE WATER FLOWS TO KEEP WATER FROM ENTERING BUILDINGS. EXAMPLES OF METHODS TO MANAGE SURFACE WATER INCLUDE, BUT ARE NOT LIMITED TO, THE FOLLOWING:
1. SWALES
2. WATER COLLECTION AND DISPOSAL SYSTEMS
3. FRENCH DRAINS
4. WATER RETENTION GARDENS
5. OTHER WATER MEASURES WHICH KEEP SURFACE WATER AWAY FROM BUILDINGS AND AID IN GROUNDWATER RECHARGE.

EXCEPTIONS: ADDITIONS AND ALTERATIONS NOT ALTERING THE DRAINAGE PATH.
4.106.4 ELECTRIC VEHICLE (EV) CHARGING FOR NEW CONSTRUCTION
NEW CONSTRUCTION SHALL COMPLY WITH SECTION 4.106.4.1, 4.106.4.2, OR 4.106.4.3, TO FACILITATE FUTURE INSTALLATION AND USE OF EV CHARGERS. ELECTRIC VEHICLE SUPPLY EQUIPMENT (EVSE) SHALL BE INSTALLED IN ACCORDANCE WITH THE CALIFORNIA ELECTRICAL CODE, ARTICLE 625.

EXCEPTIONS:
1. ON A CASE-BY-CASE BASIS, WHERE THE LOCAL ENFORCING AGENCY HAS DETERMINED THAT ADDITIONAL LOCAL UTILITY INFRASTRUCTURE DESIGN REQUIREMENTS, DIRECTLY RELATED TO THE IMPLEMENTATION OF SECTION 4.106.4, MAY ADVERSELY IMPACT THE CONSTRUCTION COST OF THE PROJECT.
2. ACCESSORY DWELLING UNITS (ADU) AND JUNIOR ACCESSORY DWELLINGS UNITS (JADU) WITHOUT ADDITIONAL PARKING FACILITIES.

4.106.4.1 NEW ONE- AND TWO-FAMILY DWELLINGS AND TOWNHOUSES WITH ATTACHED PRIVATE GARAGES
FOR EACH DWELLING UNIT, INSTALL A LISTED RACEWAY TO ACCOMMODATE A DEDICATED 208/240-VOLT BRANCH CIRCUIT. THE RACEWAY SHALL NOT BE LESS THAN TRADE SIZE 1 (NOMINAL 1-INCH INSIDE DIAMETER). THE RACEWAY SHALL ORIGINATE AT THE MAIN SERVICE OR SUBPANEL AND SHALL TERMINATE INTO A LISTED CABINET, BOX OR OTHER ENCLOSURE IN CLOSE PROXIMITY TO THE PROPOSED LOCATION OF AN EV CHARGER. RACEWAYS ARE REQUIRED TO BE CONTINUOUS AT ENCLOSED, INACCESSIBLE OR CONCEALED AREAS AND SPACES. THE SERVICE PANEL AND/OR SUBPANEL SHALL PROVIDE CAPACITY TO INSTALL A 40-AMPERE MINIMUM DEDICATED BRANCH CIRCUIT AND SPACE(S) RESERVED TO PERMIT INSTALLATION OF A BRANCH CIRCUIT OVERCURRENT PROTECTION DEVICE.

4.106.4.1.1 IDENTIFICATION
THE SERVICE PANEL OR SUBPANEL CIRCUIT DIRECTORY SHALL IDENTIFY THE OVERCURRENT PROTECTIVE DEVICE SPACE(S) RESERVED FOR FUTURE EV CHARGING AS "EV CAPABLE". THE RACEWAY TERMINATION LOCATION SHALL BE PERMANENTLY AND VISIBLY MARKED AS "EV CAPABLE".

4.106.4.2 NEW MULTIFAMILY DWELLINGS, HOTELS AND MOTELS AND NEW RESIDENTIAL PARKING FACILITIES
WHEN PARKING IS PROVIDED, PARKING SPACES FOR NEW MULTIFAMILY DWELLINGS, HOTELS AND MOTELS SHALL MEET THE REQUIREMENTS OF SECTIONS 4.106.4.2.1 AND 4.106.4.2.2. CALCULATIONS FOR SPACES SHALL BE ROUNDED UP TO THE NEAREST WHOLE NUMBER. THE NUMBER OF SPACES SERVED BY ELECTRIC VEHICLE SUPPLY EQUIPMENT OR DESIGNED AS A FUTURE EV CHARGING SPACE SHALL COUNT AS AT LEAST ONE STANDARD AUTOMOBILE PARKING SPACE ONLY FOR THE PURPOSE OF COMPLYING WITH ANY APPLICABLE MINIMUM PARKING SPACE REQUIREMENTS ESTABLISHED BY A LOCAL JURISDICTION. SEE VEHICLE CODE SECTION 22511.2 FOR FURTHER DETAILS.

4.106.4.2.1 MULTIFAMILY DEVELOPMENT PROJECTS WITH LESS THAN 20 DWELLING UNITS, AND HOTELS AND MOTELS WITH LESS THAN 20 SLEEPING UNITS OR GUEST ROOMS
THE NUMBER OF DWELLING UNITS, SLEEPING UNITS OR GUEST ROOMS SHALL BE BASED ON ALL BUILDINGS ON A PROJECT SITE SUBJECT TO THIS SECTION.

1. EV CAPABLE. TEN (10) PERCENT OF THE TOTAL NUMBER OF PARKING SPACES ON A BUILDING SITE, PROVIDED FOR ALL TYPES OF PARKING FACILITIES, SHALL BE ELECTRIC VEHICLE CHARGING SPACES (EV SPACES) CAPABLE OF SUPPORTING FUTURE LEVEL 2 EVSE. ELECTRICAL LOAD CALCULATIONS SHALL DEMONSTRATE THAT THE ELECTRICAL PANEL SERVICE CAPACITY AND ELECTRICAL SYSTEM, INCLUDING ANY ON-SITE DISTRIBUTION TRANSFORMERS, HAVE SUFFICIENT CAPACITY TO SIMULTANEOUSLY CHARGE ALL EVS AT ALL REQUIRED EV SPACES AT A MINIMUM OF 40 AMPERES.

THE SERVICE PANEL OR SUBPANEL CIRCUIT DIRECTORY SHALL IDENTIFY THE OVERCURRENT PROTECTIVE DEVICE SPACE(S) RESERVED FOR FUTURE EV CHARGING PURPOSES AS "EV CAPABLE" IN ACCORDANCE WITH THE CALIFORNIA ELECTRICAL CODE.

EXCEPTIONS:
1. WHEN EV CHARGERS (LEVEL 2 EVSE) ARE INSTALLED IN A NUMBER EQUAL TO OR GREATER THAN THE REQUIRED NUMBER OF EV CAPABLE SPACES.
2. WHEN EV CHARGERS (LEVEL 2 EVSE) ARE INSTALLED IN A NUMBER LESS THAN THE REQUIRED NUMBER OF EV CAPABLE SPACES, THE NUMBER OF EV CAPABLE SPACES REQUIRED MAY BE REDUCED BY A NUMBER EQUAL TO THE NUMBER OF EV CHARGERS INSTALLED.

NOTES:
a. CONSTRUCTION DOCUMENTS ARE INTENDED TO DEMONSTRATE THE PROJECT'S CAPABILITY AND CAPACITY FOR FACILITATING FUTURE EV CHARGING.
b. THERE IS NO REQUIREMENT FOR EV SPACES TO BE CONSTRUCTED OR AVAILABLE UNTIL RECEPTACLES FOR EV CHARGING OR EV CHARGERS ARE INSTALLED FOR USE.

2. EV READY. TWENTY-FIVE (25) PERCENT OF THE TOTAL NUMBER OF PARKING SPACES SHALL BE EQUIPPED WITH LOW POWER LEVEL 2 EV CHARGING RECEPTACLES. FOR MULTIFAMILY PARKING FACILITIES, NO MORE THAN ONE RECEPTACLE IS REQUIRED PER DWELLING UNIT WHEN MORE THAN ONE PARKING SPACE IS PROVIDED FOR USE BY A SINGLE DWELLING UNIT.
EXCEPTION: AREAS OF PARKING FACILITIES SERVED BY PARKING LIFTS.

4.106.4.2.2 MULTIFAMILY DEVELOPMENT PROJECTS WITH 20 OR MORE DWELLING UNITS, HOTELS AND MOTELS WITH 20 OR MORE SLEEPING UNITS OR GUEST ROOMS
THE NUMBER OF DWELLING UNITS, SLEEPING UNITS OR GUEST ROOMS SHALL BE BASED ON ALL BUILDINGS ON A PROJECT SITE SUBJECT TO THIS SECTION.

1. EV CAPABLE. TEN (10) PERCENT OF THE TOTAL NUMBER OF PARKING SPACES ON A BUILDING SITE, PROVIDED FOR ALL TYPES OF PARKING FACILITIES, SHALL BE ELECTRIC VEHICLE CHARGING SPACES (EV SPACES) CAPABLE OF SUPPORTING FUTURE LEVEL 2 EVSE. ELECTRICAL LOAD CALCULATIONS SHALL DEMONSTRATE THAT THE ELECTRICAL PANEL SERVICE CAPACITY AND ELECTRICAL SYSTEM, INCLUDING ANY ON-SITE DISTRIBUTION TRANSFORMERS, HAVE SUFFICIENT CAPACITY TO SIMULTANEOUSLY CHARGE ALL EVS AT ALL REQUIRED EV SPACES AT A MINIMUM OF 40 AMPERES.

THE SERVICE PANEL OR SUBPANEL CIRCUIT DIRECTORY SHALL IDENTIFY THE OVERCURRENT PROTECTIVE DEVICE SPACE(S) RESERVED FOR FUTURE EV CHARGING PURPOSES AS "EV CAPABLE" IN ACCORDANCE WITH THE CALIFORNIA ELECTRICAL CODE.

EXCEPTION: WHEN EV CHARGERS (LEVEL 2 EVSE) ARE INSTALLED IN A NUMBER GREATER THAN FIVE (5) PERCENT OF PARKING SPACES REQUIRED BY SECTION 4.106.4.2.2, ITEM 3, THE NUMBER OF EV CAPABLE SPACES REQUIRED MAY BE REDUCED BY A NUMBER EQUAL TO THE NUMBER OF EV CHARGERS INSTALLED OVER THE FIVE (5) PERCENT REQUIRED.

NOTES:
CONSTRUCTION DOCUMENTS SHALL SHOW LOCATIONS OF FUTURE EV SPACES. THERE IS NO REQUIREMENT FOR EV SPACES TO BE CONSTRUCTED OR AVAILABLE UNTIL RECEPTACLES FOR EV CHARGING OR EV CHARGERS ARE INSTALLED FOR USE.

2. EV READY. TWENTY-FIVE (25) PERCENT OF THE TOTAL NUMBER OF PARKING SPACES SHALL BE EQUIPPED WITH LOW POWER LEVEL 2 EV CHARGING RECEPTACLES. FOR MULTIFAMILY PARKING FACILITIES, NO MORE THAN ONE RECEPTACLE IS REQUIRED PER DWELLING UNIT WHEN MORE THAN ONE PARKING SPACE IS PROVIDED FOR USE BY A SINGLE DWELLING UNIT.

EXCEPTION: AREAS OF PARKING FACILITIES SERVED BY PARKING LIFTS.
3. EV CHARGERS. FIVE (5) PERCENT OF THE TOTAL NUMBER OF PARKING SPACES SHALL BE EQUIPPED WITH LEVEL 2 EVSE. WHERE COMMON USE PARKING IS PROVIDED, AT LEAST ONE EV CHARGER SHALL BE LOCATED IN THE COMMON USE PARKING AREA AND SHALL BE AVAILABLE FOR USE BY ALL RESIDENTS OR GUESTS.

WHEN LOW POWER LEVEL 2 EV CHARGING RECEPTACLES OR LEVEL 2 EVSE ARE INSTALLED BEYOND THE MINIMUM REQUIRED, AN AUTOMATIC LOAD MANAGEMENT SYSTEM (ALMS) MAY BE USED TO REDUCE THE MAXIMUM REQUIRED ELECTRICAL CAPACITY TO EACH SPACE SERVED BY THE ALMS. THE ELECTRICAL SYSTEM AND ANY ON-SITE DISTRIBUTION TRANSFORMERS SHALL HAVE SUFFICIENT CAPACITY TO DELIVER AT LEAST 3.3 KW SIMULTANEOUSLY TO EACH EV CHARGING STATION (EVCS) SERVED BY THE ALMS. THE BRANCH CIRCUIT SHALL HAVE A MINIMUM CAPACITY OF 40 AMPERES, AND INSTALLED EVSE SHALL HAVE A CAPACITY OF NOT LESS THAN 30 AMPERES. ALMS SHALL NOT BE USED TO REDUCE THE MINIMUM REQUIRED ELECTRICAL CAPACITY TO THE REQUIRED EV CAPABLE SPACES.

4.106.4.2.2.1 ELECTRIC VEHICLE CHARGING STATIONS (EVCS)
ELECTRIC VEHICLE CHARGING STATIONS REQUIRED BY SECTION 4.106.4.2.2, ITEM 3, SHALL COMPLY WITH SECTION 4.106.4.2.2.1.

EXCEPTION: ELECTRIC VEHICLE CHARGING STATIONS SERVING PUBLIC ACCOMMODATIONS, PUBLIC HOUSING, MOTELS AND HOTELS SHALL NOT BE REQUIRED TO COMPLY WITH THIS SECTION. SEE CALIFORNIA BUILDING CODE, CHAPTER 11B, FOR APPLICABLE REQUIREMENTS.

4.106.4.2.2.1.1 LOCATION
EVCS SHALL COMPLY WITH AT LEAST ONE OF THE FOLLOWING OPTIONS:
THE CHARGING SPACE SHALL BE LOCATED ADJACENT TO AN ACCESSIBLE PARKING SPACE MEETING THE REQUIREMENTS OF THE CALIFORNIA BUILDING CODE, CHAPTER 11A, TO ALLOW USE OF THE EV CHARGER FROM THE ACCESSIBLE PARKING SPACE.

THE CHARGING SPACE SHALL BE LOCATED ON AN ACCESSIBLE ROUTE, AS DEFINED IN THE CALIFORNIA BUILDING CODE, CHAPTER 2, TO THE BUILDING.

EXCEPTION: ELECTRIC VEHICLE CHARGING STATIONS DESIGNED AND CONSTRUCTED IN COMPLIANCE WITH THE CALIFORNIA BUILDING CODE, CHAPTER 11B, ARE NOT REQUIRED TO COMPLY WITH SECTION 4.106.4.2.2.1.1 AND SECTION 4.106.4.2.2.1.2, ITEM 3.

4.106.4.2.2.1.2 ELECTRIC VEHICLE CHARGING STATIONS (EVCS) DIMENSIONS
THE CHARGING SPACES SHALL BE DESIGNED TO COMPLY WITH THE FOLLOWING:
1. THE MINIMUM LENGTH OF EACH EV SPACE SHALL BE 18 FEET.
2. THE MINIMUM WIDTH OF EACH EV SPACE SHALL BE 9 FEET.
3. ONE IN EVERY 25 CHARGING SPACES, BUT NOT LESS THAN ONE, SHALL ALSO HAVE AN 8-FOOT WIDE MINIMUM AISLE. A 5-FOOT WIDE MINIMUM AISLE SHALL BE PERMITTED PROVIDED THE MINIMUM WIDTH OF THE EV SPACE IS 12 FEET.
a. SURFACE SLOPE FOR THIS EV SPACE AND THE AISLE SHALL NOT EXCEED 1 UNIT VERTICAL IN 48 UNITS HORIZONTAL (2.083 PERCENT SLOPE) IN ANY DIRECTION.

4.106.4.2.2.1.3 ACCESSIBLE EV SPACES
IN ADDITION TO THE REQUIREMENTS IN SECTIONS 4.106.4.2.2.1.1 AND 4.106.4.2.2.1.2, ALL EVSE, WHEN INSTALLED, SHALL COMPLY WITH THE ACCESSIBILITY PROVISIONS FOR EV CHARGERS IN THE CALIFORNIA BUILDING CODE, CHAPTER 11B, AND THE CALIFORNIA BUILDING CODE, CHAPTER 11A, SECTION 1109A.

4.106.4.2.3 EV SPACE REQUIREMENTS

1. SINGLE EV SPACE REQUIRED. INSTALL A LISTED RACEWAY CAPABLE OF ACCOMMODATING A 208/240-VOLT DEDICATED BRANCH CIRCUIT. THE RACEWAY SHALL NOT BE LESS THAN TRADE SIZE 1 (NOMINAL 1-INCH INSIDE DIAMETER). THE RACEWAY SHALL ORIGINATE AT THE MAIN SERVICE OR SUBPANEL AND SHALL TERMINATE INTO A LISTED CABINET, BOX OR ENCLOSURE IN CLOSE PROXIMITY TO THE LOCATION OF THE PROPOSED LOCATION OF THE EV SPACE. CONSTRUCTION DOCUMENTS SHALL IDENTIFY THE RACEWAY TERMINATION POINT, RECEPTACLE OR CHARGER LOCATION, AS APPLICABLE. THE SERVICE PANEL AND/OR SUBPANEL SHALL HAVE A 40-AMPERE MINIMUM DEDICATED BRANCH CIRCUIT, INCLUDING BRANCH CIRCUIT OVERCURRENT PROTECTIVE DEVICE INSTALLED, OR SPACE(S) RESERVED TO PERMIT INSTALLATION OF A BRANCH CIRCUIT OVERCURRENT PROTECTIVE DEVICE.

EXCEPTION: A RACEWAY IS NOT REQUIRED IF A MINIMUM 40-AMPERE 208/240-VOLT DEDICATED EV BRANCH CIRCUIT IS INSTALLED IN CLOSE PROXIMITY TO THE LOCATION OR THE PROPOSED LOCATION OF THE EV SPACE, AT THE TIME OF ORIGINAL CONSTRUCTION IN ACCORDANCE WITH THE CALIFORNIA ELECTRICAL CODE.

2. MULTIPLE EV SPACES REQUIRED. CONSTRUCTION DOCUMENTS SHALL INDICATE THE RACEWAY TERMINATION POINT AND THE LOCATION OF INSTALLED OR FUTURE EV SPACES, RECEPTACLES OR EV CHARGERS. CONSTRUCTION DOCUMENTS SHALL ALSO PROVIDE INFORMATION ON AMPERAGE OF INSTALLED OR FUTURE RECEPTACLES OR EVSE, RACEWAY METHOD(S), WIRING SCHEMATICS AND ELECTRICAL LOAD CALCULATIONS. PLAN DESIGN SHALL BE BASED UPON A 40-AMPERE MINIMUM BRANCH CIRCUIT, REQUIRED RACEWAYS AND RELATED COMPONENTS THAT ARE PLANNED TO BE INSTALLED UNDERGROUND, ENCLOSED, INACCESSIBLE OR IN CONCEALED AREAS AND SPACES SHALL BE INSTALLED AT THE TIME OF ORIGINAL CONSTRUCTION.

EXCEPTION: A RACEWAY IS NOT REQUIRED IF A MINIMUM 40-AMPERE 208/240-VOLT DEDICATED EV BRANCH CIRCUIT IS INSTALLED IN CLOSE PROXIMITY TO THE LOCATION OR THE PROPOSED LOCATION OF THE EV SPACE, AT THE TIME OF ORIGINAL CONSTRUCTION IN ACCORDANCE WITH THE CALIFORNIA ELECTRICAL CODE.

4.106.4.2.4 IDENTIFICATION
THE SERVICE PANEL OR SUBPANEL CIRCUIT DIRECTORY SHALL IDENTIFY THE OVERCURRENT PROTECTIVE DEVICE SPACE(S) RESERVED FOR FUTURE EV CHARGING PURPOSES AS "EV CAPABLE" IN ACCORDANCE WITH THE CALIFORNIA ELECTRICAL CODE.

4.106.4.2.5 ELECTRIC VEHICLE READY SPACE SIGNAGE
ELECTRIC VEHICLE READY SPACES SHALL BE IDENTIFIED BY SIGNAGE OR PAVEMENT MARKINGS, IN COMPLIANCE WITH CALTRANS TRAFFIC OPERATIONS POLICY DIRECTIVE 13-01 (ZERO EMISSION VEHICLE SIGNS AND PAVEMENT MARKINGS) OR ITS SUCCESSORS.

4.106.4.3 ELECTRIC VEHICLE CHARGING FOR ADDITIONS AND ALTERATIONS OF PARKING FACILITIES SERVING EXISTING MULTIFAMILY BUILDINGS
WHEN NEW PARKING FACILITIES ARE ADDED OR ELECTRICAL SYSTEMS OR LIGHTING OF EXISTING PARKING FACILITIES ARE ADDED OR ALTERED AND THE WORK REQUIRES A BUILDING PERMIT, TEN (10) PERCENT OF THE TOTAL NUMBER OF PARKING SPACES ADDED OR ALTERED SHALL BE ELECTRIC VEHICLE CHARGING SPACES (EV SPACES) CAPABLE OF SUPPORTING FUTURE LEVEL 2 EVSE.

NOTES:
1. CONSTRUCTION DOCUMENTS ARE INTENDED TO DEMONSTRATE THE PROJECT'S CAPABILITY AND CAPACITY FOR FACILITATING FUTURE EV CHARGING.
2. THERE IS NO REQUIREMENT FOR EV SPACES TO BE CONSTRUCTED OR AVAILABLE UNTIL EV CHARGERS ARE INSTALLED FOR USE.

DIVISION 4.2 ENERGY EFFICIENCY

4.201 GENERAL

4.201.1 SCOPE.
FOR THE PURPOSES OF MANDATORY ENERGY EFFICIENCY STANDARDS IN THIS CODE, THE CALIFORNIA ENERGY COMMISSION WILL CONTINUE TO ADOPT MANDATORY STANDARDS.

DIVISION 4.3 WATER EFFICIENCY AND CONSERVATION

4.303 INDOOR WATER USE

4.303.1 WATER CONSERVING PLUMBING FIXTURES AND FITTINGS
PLUMBING FIXTURES (WATER CLOSETS AND URINALS) AND FITTINGS (FAUCETS AND SHOWERHEADS) SHALL COMPLY WITH THE FOLLOWING:

4.303.1.1 WATER CLOSETS
THE EFFECTIVE FLUSH VOLUME OF ALL WATER CLOSETS SHALL NOT EXCEED 1.28 GALLONS PER FLUSH. TANK-TYPE WATER CLOSETS SHALL BE CERTIFIED TO THE PERFORMANCE CRITERIA OF THE U.S. EPA WATERSENSE SPECIFICATION FOR TANK TYPE TOILET.

NOTE: THE EFFECTIVE FLUSH VOLUME OF DUAL FLUSH TOILETS IS DEFINED AS THE COMPOSITE AVERAGE FLUSH VOLUME OF TWO REDUCED FLUSHES AND ONE FULL FLUSH.

4.303.1.2 URINALS
THE EFFECTIVE FLUSH VOLUME OF WALL-MOUNTED URINALS SHALL NOT EXCEED 0.125 GALLONS PER FLUSH. THE EFFECTIVE FLUSH VOLUME OF ALL OTHER URINALS SHALL NOT EXCEED 0.5 GALLONS PER FLUSH.

4.303.1.3 SHOWERHEADS
4.303.1.3.1 SINGLE SHOWERHEAD
SINGLE SHOWERHEADS SHALL HAVE A MAXIMUM FLOW RATE OF NOT MORE THAN 1.8 GALLONS PER MINUTE AT 80 PSI. SHOWERHEADS SHALL BE CERTIFIED TO THE PERFORMANCE CRITERIA OF THE U.S. EPA WATERSENSE SPECIFICATION FOR SHOWERHEADS.

4.303.1.3.2 MULTIPLE SHOWERHEADS SERVING ONE SHOWER
WHEN A SHOWER IS SERVED BY MORE THAN ONE SHOWERHEAD, THE COMBINED FLOW RATE OF ALL SHOWERHEADS AND/OR OTHER SHOWER OUTLETS CONTROLLED BY A SINGLE VALVE SHALL NOT EXCEED 1.8 GALLONS PER MINUTE AT 80 PSI, OR THE SHOWER SHALL BE DESIGNED TO ALLOW ONLY ONE SHOWER OUTLET TO BE IN OPERATION AT A TIME.

NOTE: A HAND HELD SHOWER SHALL BE CONSIDERED A SHOWERHEAD.

4.303.1.4 FAUCETS
4.303.1.4.1 RESIDENTIAL LAVATORY FAUCETS
THE MAXIMUM FLOW RATE OF RESIDENTIAL LAVATORY FAUCETS SHALL NOT EXCEED 1.2 GALLONS PER MINUTE AT 80 PSI. THE MINIMUM FLOW RATE OF RESIDENTIAL LAVATORY FAUCETS SHALL NOT BE LESS THAN 0.8 GALLONS PER MINUTE AT 20 PSI.

4.303.1.4.2 LAVATORY FAUCETS IN COMMON AND PUBLIC USE AREAS
THE MAXIMUM FLOW RATE OF LAVATORY FAUCETS INSTALLED IN COMMON AND PUBLIC USE AREAS (OUTSIDE OF DWELLINGS OR SLEEPING UNITS) IN RESIDENTIAL BUILDINGS SHALL NOT EXCEED 0.5 GALLONS PER MINUTE AT 60 PSI.

4.303.1.4.3 METERING FAUCETS
METERING FAUCETS WHEN INSTALLED IN RESIDENTIAL BUILDINGS SHALL NOT DELIVER MORE THAN 0.2 GALLONS PER CYCLE.

4.303.1.4.4 KITCHEN FAUCETS
THE MAXIMUM FLOW RATE OF KITCHEN FAUCETS SHALL NOT EXCEED 1.8 GALLONS PER MINUTE AT 60 PSI. KITCHEN FAUCETS MAY TEMPORARILY INCREASE THE FLOW ABOVE THE MAXIMUM RATE, BUT NOT TO EXCEED 2.2 GALLONS PER MINUTE AT 80 PSI, AND MUST DEFAULT TO A MAXIMUM FLOW RATE OF 1.8 GALLONS PER MINUTE AT 60 PSI.

NOTE: WHERE COMPLYING FAUCETS ARE UNAVAILABLE, AERATORS OR OTHER MEANS MAY BE USED TO ACHIEVE REDUCTION.

4.303.2 SUBMETERS FOR MULTIFAMILY BUILDINGS AND DWELLING UNITS IN MIXED-USE RESIDENTIAL/COMMERCIAL BUILDINGS
SUBMETERS SHALL BE INSTALLED TO MEASURE WATER USAGE OF INDIVIDUAL RENTAL DWELLING UNITS IN ACCORDANCE WITH THE CALIFORNIA PLUMBING CODE.

4.303.2 SUBMETERS FOR MULTIFAMILY BUILDINGS AND DWELLING UNITS IN MIXED-USE RESIDENTIAL/COMMERCIAL BUILDINGS
SUBMETER SHALL BE INSTALLED TO MEASURE WATER USAGE OF INDIVIDUAL RENTAL DWELLING UNITS IN ACCORDANCE WITH THE CALIFORNIA PLUMBING CODE.

4.303.3 STANDARDS FOR PLUMBING FIXTURES AND FITTINGS
PLUMBING FIXTURES AND FITTINGS SHALL BE INSTALLED IN ACCORDANCE WITH THE CALIFORNIA PLUMBING CODE, AND SHALL MEET THE APPLICABLE STANDARDS REFERENCED IN TABLE 1701.1 OF THE CALIFORNIA PLUMBING CODE.

NOTE:
THIS TABLE COMPILES THE DATA IN SECTION 4.303.1 AND IS INCLUDED AS A CONVENIENCE FOR THE USER.

| TABLE - MAXIMUM FIXTURE WATER USE | |
|---|--|
| FIXTURE TYPE | FLOW RATE |
| SHOWER HEADS (RESIDENTIAL) | 1.8 GMP @ 80 PSI |
| LAVATORY FAUCETS (RESIDENTIAL) | MAX. 1.2 GPM @ 60 PSI MIN. 0.8 GPM @ 20 PSI |
| LAVATORY FAUCETS IN COMMON & PUBLIC USE AREAS | 0.5 GPM @ 60 PSI |
| KITCHEN FAUCETS | 1.8 GPM @ 60 PSI |
| METERING FAUCETS | 0.2 GAL/CYCLE |
| WATER CLOSET | 1.28 GAL/FLUSH |
| URINALS | 0.125 GAL/FLUSH |

4.304 OUTDOOR WATER USE

4.304.1 OUTDOOR POTABLE WATER USE IN LANDSCAPE AREAS
RESIDENTIAL DEVELOPMENTS SHALL COMPLY WITH A LOCAL WATER EFFICIENT LANDSCAPE ORDINANCE OR THE CURRENT CALIFORNIA DEPARTMENT OF WATER RESOURCES' MODEL WATER EFFICIENT LANDSCAPE ORDINANCE (MWELO), WHICHEVER IS MORE STRINGENT.

NOTES:
1. THE MODEL WATER EFFICIENT LANDSCAPE ORDINANCE (MWELO) IS LOCATED IN THE CALIFORNIA CODE OF REGULATIONS, TITLE 23, CHAPTER 2.7, DIVISION 2.

MWELO AND SUPPORTING DOCUMENTS, INCLUDING A WATER BUDGET CALCULATOR, ARE AVAILABLE AT: [HTTPS://WWW.WATER.CA.GOV/](https://www.water.ca.gov/)

DIVISION 4.4 MATERIAL CONSERVATION AND RESOURCE EFFICIENCY

4.406 ENHANCED DURABILITY AND REDUCED MAINTENANCE

4.406.1 RODENT PROOFING
ANNUAL SPACES AROUND PIPES, ELECTRIC CABLES, CONDUITS OR OTHER OPENINGS IN SOLE/BOTTOM PLATES AT EXTERIOR WALLS SHALL BE PROTECTED AGAINST THE PASSAGE OF RODENTS BY LOCOSING SUCH OPENINGS WITH CEMENT MORTAR, CONCRETE MASONRY OR A SIMILAR METHOD ACCEPTABLE TO THE ENFORCING AGENCY.

4.408 CONSTRUCTION WASTE REDUCTION, DISPOSAL AND RECYCLING

4.408.1 CONSTRUCTION WASTE MANAGEMENT
RECYCLE AND/OR SALVAGE FOR REUSE A MINIMUM OF 65 PERCENT OF THE NONHAZARDOUS CONSTRUCTION AND DEMOLITION WASTE IN ACCORDANCE WITH EITHER SECTION 4.408.2, 4.408.3, OR 4.408.4, OR MEET A MORE STRINGENT LOCAL CONSTRUCTION AND DEMOLITION WASTE MANAGEMENT ORDINANCE.

EXCEPTIONS:
1. EXCAVATED SOIL AND LAND-CLEARING DEBRIS.
2. ALTERNATE WASTE REDUCTION METHODS DEVELOPED BY WORKING WITH LOCAL AGENCIES IF DIVERSION OR RECYCLE FACILITIES CAPABLE OF COMPLIANCE WITH THIS ITEM DO NOT EXIST OR ARE NOT LOCATED REASONABLY CLOSE TO THE JOBSITE.
3. THE ENFORCING AGENCY MAY MAKE EXCEPTIONS TO THE REQUIREMENTS OF THIS SECTION WHEN ISOLATED JOBSITES ARE LOCATED IN AREAS BEYOND THE HAUL BOUNDARIES OF THE DIVERSION FACILITY.

4.408.2 CONSTRUCTION WASTE MANAGEMENT PLAN
A CONSTRUCTION AND WASTE MANAGEMENT PLAN IN CONFORMANCE WITH ITEMS 1 THROUGH 5, THE CONSTRUCTION WASTE MANAGEMENT PLAN SHALL BE UPDATED AS NECESSARY AND SHALL BE AVAILABLE DURING CONSTRUCTION FOR EXAMINATION BY THE ENFORCING AGENCY.

1. IDENTIFY THE CONSTRUCTION AND DEMOLITION WASTE MATERIALS TO BE DIVERTED FROM DISPOSAL BY RECYCLING, REUSE ON THE PROJECT OR SALVAGE FOR FUTURE USE OR SALE.
2. SPECIFY IF CONSTRUCTION AND DEMOLITION WASTE MATERIALS WILL BE SORTED ON-SITE (SOURCE-SEPARATED) OR BULK MIXED (SINGLE STREAM).
3. IDENTIFY DIVERSION FACILITIES WHERE THE CONSTRUCTION AND DEMOLITION WASTE MATERIAL WILL BE TAKEN.
4. IDENTIFY CONSTRUCTION METHODS EMPLOYED TO REDUCE THE AMOUNT OF CONSTRUCTION AND DEMOLITION WASTE GENERATED.
5. SPECIFY THAT THE AMOUNT OF CONSTRUCTION AND DEMOLITION WASTE MATERIAL DIVERTED SHALL BE CALCULATED BY WEIGHT OR VOLUME, BUT NOT BY BOTH.

4.408.3 WASTE MANAGEMENT COMPANY.
UTILIZE A WASTE MANAGEMENT COMPANY, APPROVED BY THE ENFORCING AGENCY, WHICH CAN PROVIDE VERIFIABLE DOCUMENTATION THAT THE PERCENTAGE OF CONSTRUCTION AND DEMOLITION WASTE MATERIAL DIVERTED FROM THE LANDFILL COMPLIES WITH SECTION 4.408.1.
NOTE: THE OWNER OR CONTRACTOR MAY MAKE THE DETERMINATION IF THE CONSTRUCTION AND DEMOLITION WASTE MATERIALS WILL BE DIVERTED BY A WASTE MANAGEMENT COMPANY.

4.408.4 WASTE STREAM REDUCTION ALTERNATIVE (LR).
PROJECTS THAT GENERATE A TOTAL COMBINED WEIGHT OF CONSTRUCTION AND DEMOLITION WASTE DISPOSED OF IN LANDFILLS, WHICH DO NOT EXCEED 3.4 POUNDS PER SQUARE FOOT OF THE BUILDING AREA SHALL MEET THE MINIMUM 65 PERCENT CONSTRUCTION WASTE REDUCTION REQUIREMENT IN SECTION 4.408.1.


4.408.4.1 WASTE STREAM REDUCTION ALTERNATIVE.
PROJECTS THAT GENERATE A TOTAL COMBINED WEIGHT OF CONSTRUCTION AND DEMOLITION WASTE DISPOSED OF IN LANDFILLS, WHICH DO NOT EXCEED 2 POUNDS PER SQUARE FOOT OF THE BUILDING AREA, SHALL MEET THE MINIMUM 65-PERCENT CONSTRUCTION WASTE REDUCTION REQUIREMENT IN SECTION 4.408.1.

4.408.5 DOCUMENTATION
DOCUMENTATION SHALL BE PROVIDED TO THE ENFORCING AGENCY WHICH DEMONSTRATES COMPLIANCE WITH SECTION 4.408.2, ITEMS 1 THROUGH 5, SECTION 4.408.3 OR SECTION 4.408.4.

NOTES:
1. SAMPLE FORMS FOUND IN "A GUIDE TO THE CALIFORNIA GREEN BUILDING STANDARDS CODE (RESIDENTIAL)" LOCATED AT WWW.HCD.CA.GOV/CALGREEN.HTML MAY BE USED TO ASSIST IN DOCUMENTING COMPLIANCE WITH THIS SECTION.
2. MIXED CONSTRUCTION AND DEMOLITION DEBRIS (C&D) PROCESSORS CAN BE LOCATED AT THE CALIFORNIA DEPARTMENT OF RESOURCES RECYCLING AND RECOVERY (CALRECYCLE).

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

RESIDENTIAL MANDATORY MEASURES (SHEET 2)



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRIBUTE THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

4.410 BUILDING MAINTENANCE AND OPERATION

4.410.1 OPERATION AND MAINTENANCE MANUAL

AT THE TIME OF FINAL INSPECTION, A MANUAL, COMPACT DISC, WEB-BASED REFERENCE OR OTHER MEDIA ACCEPTABLE TO THE ENFORCING AGENCY WHICH INCLUDES ALL OF THE FOLLOWING SHALL BE PLACED IN THE BUILDING:

- DIRECTIONS TO THE OWNER OR OCCUPANT THAT THE MANUAL SHALL REMAIN WITH THE BUILDING THROUGHOUT THE LIFE CYCLE OF THE STRUCTURE.
- OPERATION AND MAINTENANCE INSTRUCTIONS FOR THE FOLLOWING:
 - EQUIPMENT AND APPLIANCES, INCLUDING WATER-SAVING DEVICES AND SYSTEMS, HVAC SYSTEMS, PHOTOVOLTAIC SYSTEMS, ELECTRIC VEHICLE CHARGERS, WATER-HEATING SYSTEMS AND OTHER MAJOR APPLIANCES AND EQUIPMENT.
 - ROOF AND YARD DRAINAGE, INCLUDING GUTTERS AND DOWNSPOUTS.
 - SPACE CONDITIONING SYSTEMS, INCLUDING CONDENSERS AND AIR FILTERS.
 - LANDSCAPE IRRIGATION SYSTEMS.
 - WATER REUSE SYSTEMS.
- INFORMATION FROM LOCAL UTILITY, WATER AND WASTE RECOVERY PROVIDERS ON METHODS TO FURTHER REDUCE RESOURCE CONSUMPTION, INCLUDING RECYCLE PROGRAMS AND LOCATIONS.
- PUBLIC TRANSPORTATION AND/OR CARPOOL OPTIONS AVAILABLE IN THE AREA.
- EDUCATIONAL MATERIAL ON THE POSITIVE IMPACTS OF AN INTERIOR RELATIVE HUMIDITY BETWEEN 30-60 PERCENT AND WHAT METHODS AN OCCUPANT MAY USE TO MAINTAIN THE RELATIVE HUMIDITY LEVEL IN THAT RANGE.
- INFORMATION ABOUT WATER-CONSERVING LANDSCAPE AND IRRIGATION DESIGN AND CONTROLLERS WHICH CONSERVE WATER. INSTRUCTIONS FOR MAINTAINING GUTTERS AND DOWNSPOUTS AND THE IMPORTANCE OF DIVERTING WATER AT LEAST 5 FEET AWAY FROM THE FOUNDATION.
- INFORMATION ON REQUIRED ROUTINE MAINTENANCE MEASURES, INCLUDING, BUT NOT LIMITED TO, CAULKING, PAINTING, GRADING AROUND THE BUILDING.
- INFORMATION ABOUT STATE SOLAR ENERGY AND INCENTIVE PROGRAMS AVAILABLE.
- A COPY OF ALL SPECIAL INSPECTION VERIFICATIONS REQUIRED BY THE ENFORCING AGENCY OR THIS CODE.
- INFORMATION FROM CAL FIRE ON MAINTENANCE OF DEFENSIBLE SPACE AROUND RESIDENTIAL STRUCTURES.
- INFORMATION AND/OR DRAWINGS IDENTIFYING THE LOCATION OF GRAB BAR REINFORCEMENTS.

4.410.2 RECYCLING BY OCCUPANTS

WHERE 5 OR MORE MULTIFAMILY DWELLING UNITS ARE CONSTRUCTED ON A BUILDING SITE, PROVIDE READILY ACCESSIBLE AREA(S) THAT SERVES ALL BUILDINGS ON THE SITE AND IS IDENTIFIED FOR THE DEPOSITING, STORAGE AND COLLECTION OF NON-HAZARDOUS MATERIALS FOR RECYCLING, INCLUDING AT A MINIMUM PAPER, CORRUGATED CARDBOARD, GLASS, PLASTICS, ORGANIC WASTE, AND METALS, OR MEET A LAWFULLY ENACTED LOCAL RECYCLING ORDINANCE, IF MORE RESTRICTIVE.

EXCEPTION:
RURAL JURISDICTIONS THAT MEET AND APPLY FOR THE EXEMPTION IN PUBLIC RESOURCES CODE SECTION 42649.82 (A)(2)(A) ET SEQ. ARE NOT REQUIRED TO COMPLY WITH THE ORGANIC WASTE PORTION OF THIS SECTION.

DIVISION 4.5 ENVIRONMENTAL QUALITY

4.501 GENERAL

4.501.1 SCOPE

THE PROVISIONS OF THIS CHAPTER SHALL OUTLINE MEANS OF REDUCING THE QUANTITY OF AIR CONTAMINANTS THAT ARE ODOROUS, IRRITATING AND/OR HARMFUL TO THE COMFORT AND WELL-BEING OF A BUILDING'S INSTALLERS, OCCUPANTS AND NEIGHBORS.

4.503 FIREPLACES

4.503.1 GENERAL

ANY INSTALLED GAS FIREPLACE SHALL BE A DIRECT-VENT SEALED-COMBUSTION TYPE. ANY INSTALLED WOODSTOVE OR PELLET STOVE SHALL COMPLY WITH U.S. EPA NEW SOURCE PERFORMANCE STANDARDS (NSPS) EMISSION LIMITS AS APPLICABLE, AND SHALL HAVE A PERMANENT LABEL INDICATING THEY ARE CERTIFIED TO MEET THE EMISSION LIMITS. WOODSTOVES, PELLET STOVES AND FIREPLACES SHALL ALSO COMPLY WITH APPLICABLE LOCAL ORDINANCES.

4.504 POLLUTANT CONTROL

4.504.1 COVERING OF DUCT OPENINGS AND PROTECTION OF MECHANICAL EQUIPMENT DURING CONSTRUCTION

AT THE TIME OF ROUGH INSTALLATION, DURING STORAGE ON THE CONSTRUCTION SITE AND UNTIL FINAL STARTUP OF THE HEATING, COOLING AND VENTILATING EQUIPMENT, ALL DUCT AND OTHER RELATED AIR DISTRIBUTION COMPONENT OPENINGS SHALL BE COVERED WITH TAPE, PLASTIC, SHEET METAL OR OTHER METHODS ACCEPTABLE TO THE ENFORCING AGENCY TO REDUCE THE AMOUNT OF WATER, DUST AND DEBRIS, WHICH MAY ENTER THE SYSTEM.

4.504.2 FINISH MATERIAL POLLUTANT CONTROL

FINISH MATERIALS SHALL COMPLY WITH THIS SECTION.

4.504.2.1 ADHESIVES, SEALANTS AND CAULKS

ADHESIVES, SEALANTS AND CAULKS USED ON THE PROJECT SHALL MEET THE REQUIREMENTS OF THE FOLLOWING STANDARDS UNLESS MORE STRINGENT LOCAL OR REGIONAL AIR POLLUTION OR AIR QUALITY MANAGEMENT DISTRICT RULES APPLY:

- ADHESIVES, ADHESIVE BONDING PRIMERS, ADHESIVE PRIMERS, SEALANTS, SEALANT PRIMERS, AND CAULKS SHALL COMPLY WITH LOCAL OR REGIONAL AIR POLLUTION CONTROL OR AIR QUALITY MANAGEMENT DISTRICT RULES WHERE APPLICABLE OR SCANNED RULE 1168 VOC LIMITS, AS SHOWN IN TABLE 4.504.1 OR 4.504.2, AS APPLICABLE. SUCH PRODUCTS ALSO SHALL COMPLY WITH THE RULE 1168 PROHIBITION ON THE USE OF CERTAIN TOXIC COMPOUNDS (CHLOROFORM, ETHYLENE DICHLORIDE, METHYLENE CHLORIDE, PERCHLOROETHYLENE AND TRICHLOROETHYLENE), EXCEPT FOR AEROSOL PRODUCTS, AS SPECIFIED IN SUBSECTION 2 BELOW.
- AEROSOL ADHESIVES, AND SMALLER UNIT SIZES OF ADHESIVES, AND SEALANT OR CAULKING COMPOUNDS (IN UNITS OF PRODUCT, LESS PACKAGING, WHICH DO NOT WEIGH MORE THAN 1 POUND AND DO NOT CONSIST OF MORE THAN 16 FLUID OUNCES) SHALL COMPLY WITH STATEWIDE VOC STANDARDS AND OTHER REQUIREMENTS, INCLUDING PROHIBITIONS ON USE OF CERTAIN TOXIC COMPOUNDS, OF CALIFORNIA CODE OF REGULATIONS, TITLE 17, COMMENCING WITH SECTION 94507.

4.504.2.2 PAINTS AND COATINGS

ARCHITECTURAL PAINTS AND COATINGS SHALL COMPLY WITH VOC LIMITS IN TABLE 1 OF THE ARB ARCHITECTURAL SUGGESTED CONTROL MEASURE, AS SHOWN IN TABLE 4.504.3, UNLESS MORE STRINGENT LOCAL LIMITS APPLY. THE VOC CONTENT LIMIT FOR COATINGS THAT DO NOT MEET THE DEFINITIONS FOR THE SPECIALTY COATINGS CATEGORIES LISTED IN TABLE 4.504.3 SHALL BE DETERMINED BY CLASSIFYING THE COATING AS A FLAT, NONFLAT OR NONFLAT-HIGH GLOSS COATING, BASED ON ITS GLOSS, AS DEFINED IN SUBSECTIONS 4.21, 4.36, AND 4.37 OF THE 2007 CALIFORNIA AIR RESOURCES BOARD, SUGGESTED CONTROL MEASURE, AND THE CORRESPONDING FLAT, NONFLAT OR NONFLAT-HIGH GLOSS VOC LIMIT IN TABLE 4.504.3 SHALL APPLY.

4.504.2.3 AEROSOL PAINTS AND COATINGS

AEROSOL PAINTS AND COATINGS SHALL MEET THE PRODUCT-WEIGHTED MIR LIMITS FOR ROC IN SECTION 94522(A)(2) AND OTHER REQUIREMENTS, INCLUDING PROHIBITIONS ON USE OF CERTAIN TOXIC COMPOUNDS AND OZONE DEPLETING SUBSTANCES, IN SECTIONS 94522(E)(1) AND (F)(1) OF CALIFORNIA CODE OF REGULATIONS, TITLE 17, COMMENCING WITH SECTION 94520; AND IN AREAS UNDER THE JURISDICTION OF THE BAY AREA AIR QUALITY MANAGEMENT DISTRICT ADDITIONALLY COMPLY WITH THE PERCENT VOC BY WEIGHT OF PRODUCT LIMITS OF REGULATION 8, RULE 49.

4.504.2.4 VERIFICATION

VERIFICATION OF COMPLIANCE WITH THIS SECTION SHALL BE PROVIDED AT THE REQUEST OF THE ENFORCING AGENCY. DOCUMENTATION MAY INCLUDE, BUT IS NOT LIMITED TO, THE FOLLOWING:

- MANUFACTURER'S PRODUCT SPECIFICATION.
- FIELD VERIFICATION OF ON-SITE PRODUCT CONTAINERS.

4.504.3 CARPET SYSTEMS

4.504.3.1 CARPET CUSHION

ALL CARPET CUSHION INSTALLED IN THE BUILDING INTERIOR SHALL MEET THE REQUIREMENTS OF THE CALIFORNIA DEPARTMENT OF PUBLIC HEALTH, "STANDARD METHOD FOR THE TESTING AND EVALUATION OF VOLATILE ORGANIC CHEMICAL EMISSIONS FROM INDOOR SOURCES USING ENVIRONMENTAL CHAMBERS," VERSION 1.2, JANUARY 2017 (EMISSION TESTING METHOD FOR CALIFORNIA SPECIFICATION 01350).

SEE CALIFORNIA DEPARTMENT OF PUBLIC HEALTH'S WEBSITE FOR CERTIFICATION PROGRAMS AND TESTING LABS.

HTTPS://WWW.CDPH.CA.GOV/PROGRAMS/CCDPHP/DEODCEHLBIAQ/PAGES/VOC.ASPX

4.504.3.2 CARPET ADHESIVE

ALL CARPET ADHESIVE SHALL MEET THE REQUIREMENTS OF TABLE 4.504.1.

4.504.4 RESILIENT FLOORING SYSTEMS

WHERE RESILIENT FLOORING IS INSTALLED, AT LEAST 80 PERCENT OF FLOOR AREA RECEIVING RESILIENT FLOORING SHALL MEET THE REQUIREMENTS OF THE CALIFORNIA DEPARTMENT OF PUBLIC HEALTH, "STANDARD METHOD FOR THE TESTING AND EVALUATION OF VOLATILE ORGANIC CHEMICAL EMISSIONS FROM INDOOR SOURCES USING ENVIRONMENTAL CHAMBERS," VERSION 1.2, JANUARY 2017 (EMISSION TESTING METHOD FOR CALIFORNIA SPECIFICATION 01350).

SEE CALIFORNIA DEPARTMENT OF PUBLIC HEALTH'S WEBSITE FOR CERTIFICATION PROGRAMS AND TESTING LABS.

HTTPS://WWW.CDPH.CA.GOV/PROGRAMS/CCDPHP/DEODCEHLBIAQ/PAGES/VOC.ASPX

4.504.5 COMPOSITE WOOD PRODUCTS

HARDWOOD PLYWOOD, PARTICLEBOARD AND MEDIUM DENSITY FIBERBOARD COMPOSITE WOOD PRODUCTS USED ON THE INTERIOR OR EXTERIOR OF THE BUILDING SHALL MEET THE REQUIREMENTS FOR FORMALDEHYDE AS SPECIFIED IN ARB'S AIR TOXICS CONTROL MEASURE FOR COMPOSITE WOOD (17 CCR 93120 ET SEQ.) AS SHOWN IN TABLE 4.504.5.

4.504.5.1 DOCUMENTATION

VERIFICATION OF COMPLIANCE WITH THIS SECTION SHALL BE PROVIDED AS REQUESTED BY THE ENFORCING AGENCY. DOCUMENTATION SHALL INCLUDE AT LEAST ONE OF THE FOLLOWING:

- PRODUCT CERTIFICATIONS AND SPECIFICATIONS.
- CHAIN OF CUSTODY CERTIFICATIONS.
- PRODUCT LABELED AND INVOICED AS MEETING THE COMPOSITE WOOD PRODUCTS REGULATION (SEE CCR, TITLE 17, SECTION 93120, ET SEQ.).
- EXTERIOR GRADE PRODUCTS MARKED AS MEETING THE PS-1 OR PS-2 STANDARDS OF THE ENGINEERED WOOD ASSOCIATION, THE AUSTRALIAN AS/NZS 2269, EUROPEAN 636 3S, AND CANADIAN CSA 0121, CSA 0151, CSA 0153 AND CSA 0325 STANDARDS.
- OTHER METHODS ACCEPTABLE TO THE ENFORCING AGENCY.

TABLE 4.504.1 - ADHESIVE VOC LIMIT
(LESS WATER AND LESS EXEMPT COMPOUNDS IN GRAMS PER LITER)

| ARCHITECTURAL APPLICATIONS | CURRENT VOC LIMIT |
|---|-------------------|
| INDOOR CARPET ADHESIVES | 50 |
| CARPET PAD ADHESIVES | 50 |
| OUTDOOR CARPET ADHESIVES | 150 |
| WOOD FLOORING ADHESIVES | 100 |
| RUBBER FLOORING ADHESIVES | 60 |
| SUBFLOOR ADHESIVES | 50 |
| CERAMIC TILE ADHESIVES | 65 |
| UVCT AND ASPHALT TILE ADHESIVES | 50 |
| DRYWALL AND PANEL ADHESIVES | 50 |
| COVE BASE ADHESIVES | 50 |
| MULTIPURPOSE CONSTRUCTION ADHESIVES | 70 |
| STRUCTURAL GLAZING ADHESIVES | 100 |
| SINGLE-PLY ROOF MEMBRANE ADHESIVES | 250 |
| OTHER ADHESIVES NOT SPECIFICALLY LISTED | 50 |
| SPECIALTY APPLICATIONS | CURRENT VOC LIMIT |
| PVC WELDING | 510 |
| CPVC WELDING | 490 |
| ABW WELDING | 325 |
| PLASTIC CEMENT WELDING | 250 |
| ADHESIVE PRIMER FOR PLASTIC | 550 |
| CONTACT ADHESIVE | 80 |
| SPECIAL PURPOSE CONTACT ADHESIVE | 250 |
| STRUCTURAL WOOD MEMBER ADHESIVE | 140 |
| TOP AND TRIM ADHESIVES | 250 |
| SUBSTRATE SPECIFIC APPLICATIONS | CURRENT VOC LIMIT |
| METAL TO METAL | 30 |
| PLASTIC FOAMS | 50 |
| POROUS MATERIAL (EXCEPT WOOD) | 50 |
| WOOD | 30 |
| FIBERGLASS | 80 |

- IF AN ADHESIVE IS USED TO BOND DISSIMILAR SUBSTRATES TOGETHER, THE ADHESIVE WITH THE HIGHEST VOC CONTENT SHALL BE ALLOWED.
- FOR ADDITIONAL INFORMATION REGARDING METHODS TO MEASURE THE VOC CONTENT SPECIFIED IN THIS TABLE, SEE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT RULE 1168.

TABLE 4.504.2 - SEALANT VOC LIMIT
(LESS WATER AND LESS EXEMPT COMPOUNDS IN GRAMS PER LITER)

| SEALANTS | CURRENT VOC LIMIT |
|--------------------------|-------------------|
| ARCHITECTURAL | 250 |
| MARINE DECK | 760 |
| NONMEMBRANE ROOF | 300 |
| ROADWAY | 250 |
| SINGLE-PLY ROOF MEMBRANE | 450 |
| OTHER | 420 |
| SEALANT PRIMERS | CURRENT VOC LIMIT |
| ARCHITECTURAL | |
| NONPOROUS | 250 |
| POROUS | 250 |
| MODIFIED BITUMINOUS | 500 |
| MARINE DECK | 760 |
| OTHER | 750 |

TABLE 4.504.3 - VOC CONTENT LIMITS FOR ARCHITECTURAL COATINGS^{2, 3}
(GRAMS OF VOC PER LITER OF COATING, LESS WATER AND LESS EXEMPT COMPOUNDS)

| COATING CATEGORY | CURRENT VOC LIMIT |
|---|-------------------|
| FLAT COATINGS | 50 |
| NONFLAT COATINGS | 100 |
| NONFLAT-HIGH GLOSS COATINGS | 150 |
| SPECIALTY COATINGS | CURRENT VOC LIMIT |
| ALUMINUM ROOF COATINGS | 400 |
| BASEMENT SPECIALTY COATINGS | 400 |
| BITUMINOUS ROOF COATINGS | 50 |
| BITUMINOUS ROOF PRIMERS | 350 |
| BOND BREAKERS | 350 |
| CONCRETE CURING COMPOUNDS | 350 |
| CONCRETE/MASONRY SEALERS | 100 |
| DRIVEWAY SEALERS | 50 |
| DRY FOG COATINGS | 150 |
| FAUX FINISHING COATINGS | 350 |
| FIRE RESISTIVE COATINGS | 350 |
| FLOOR COATINGS | 100 |
| FORM-RELEASE COMPOUNDS | 250 |
| GRAPHIC ARTS COATINGS (SIGN PAINTS) | 500 |
| HIGH TEMPERATURE COATINGS | 420 |
| INDUSTRIAL MAINTENANCE COATINGS | 250 |
| LOW SOLIDS COATINGS ¹ | 120 |
| MAGNESITE CEMENT COATINGS | 450 |
| MASTIC TEXTURE COATINGS | 100 |
| METALLIC PIGMENTED COATINGS | 500 |
| MULTICOLOR COATINGS | 250 |
| PRETREATMENT WASH PRIMERS | 420 |
| PRIMERS, SEALERS, AND UNDERCOATERS | 100 |
| REACTIVE PENETRATING SEALERS | 350 |
| RECYCLED COATINGS | 350 |
| ROOF COATINGS | 50 |
| RUST PREVENTATIVE COATINGS | 250 |
| SHELLACS | |
| GLEAR | 730 |
| OPAQUE | 550 |
| SPECIALTY PRIMERS, SEALERS AND UNDERCOATERS | 100 |
| STAINS | 250 |
| STONE CONSOLIDANTS | 450 |
| SWIMMING POOL COATINGS | 340 |
| TRAFFIC MARKING COATINGS | 100 |
| TUB AND TILE FINISH COATINGS | 420 |
| WATERPROOFING MEMBRANES | 250 |
| WOOD COATINGS | 275 |
| WOOD PRESERVATIVES | 350 |
| ZINC-RICH PRIMERS | 340 |

- GRAMS OF VOC PER LITER OF COATING, INCLUDING WATER AND INCLUDING EXEMPT COMPOUNDS.
- THE SPECIFIED LIMITS REMAIN IN EFFECT UNLESS REVISED LIMITS ARE LISTED IN SUBSEQUENT COLUMNS IN THE TABLE.
- VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY THE CALIFORNIA AIR RESOURCES BOARD, ARCHITECTURAL COATINGS SUGGESTED CONTROL MEASURE, FEBRUARY 1, 2008. MORE INFORMATION IS AVAILABLE FROM THE AIR RESOURCES BOARD.

TABLE 4.504.5 - FORMALDEHYDE LIMITS¹
(MAXIMUM FORMALDEHYDE EMISSIONS IN PARTS PER MILLION)

| PRODUCT | CURRENT LIMIT |
|---|---------------|
| HARDWOOD PLYWOOD VENEER CORE | 0.05 |
| HARDWOOD PLYWOOD COMPOSITE CORE | 0.05 |
| PARTICLEBOARD | 0.09 |
| MEDIUM DENSITY FIBERBOARD | 0.11 |
| THIN MEDIUM DENSITY FIBERBOARD ² | 0.13 |

- VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY THE CALIFORNIA AIR RESOURCES BOARD, AIR TOXICS CONTROL MEASURE FOR COMPOSITE WOOD AS TESTED IN ACCORDANCE WITH ASTM E1333. FOR ADDITIONAL INFORMATION, SEE CALIFORNIA CODE OF REGULATIONS, TITLE 17, SECTIONS 93120 THROUGH 93120.12.
- THIN MEDIUM DENSITY FIBERBOARD HAS A MAXIMUM THICKNESS OF 5/16 INCH (8MM).

DIVISION 4.5 ENVIRONMENTAL QUALITY CONTINUED

4.505 INTERIOR MOISTURE CONTROL

4.505.1 GENERAL

BUILDINGS SHALL MEET OR EXCEED THE PROVISIONS OF THE CALIFORNIA BUILDING STANDARDS CODE.

4.505.2 CONCRETE SLAB FOUNDATIONS

CONCRETE SLAB FOUNDATIONS REQUIRED TO HAVE A VAPOR RETARDER BY THE CALIFORNIA BUILDING CODE CHAPTER 19 OR CONCRETE SLAB-ON-GROUND FLOORS REQUIRED TO HAVE A VAPOR RETARDER BY THE CALIFORNIA RESIDENTIAL CODE, CHAPTER 5, SHALL ALSO COMPLY WITH THIS SECTION.

4.505.2.1 CAPILLARY BREAK

A CAPILLARY BREAK SHALL BE INSTALLED IN COMPLIANCE WITH AT LEAST ONE OF THE FOLLOWING:

- A 4-INCH-THICK (101.6 MM) BASE OF 1/2 INCH (12.7 MM) OR LARGER CLEAN AGGREGATE SHALL BE PROVIDED WITH A VAPOR RETARDER IN DIRECT CONTACT WITH CONCRETE AND A CONCRETE MIX DESIGN, WHICH WILL ADDRESS BLEEDING, SHRINKAGE, AND CURLING, SHALL BE USED. FOR ADDITIONAL INFORMATION, SEE AMERICAN CONCRETE INSTITUTE, ACI 302.2R-06.
- OTHER EQUIVALENT METHODS APPROVED BY THE ENFORCING AGENCY.
- A SLAB DESIGN SPECIFIED BY A LICENSED DESIGN PROFESSIONAL.

4.505.3 MOISTURE CONTENT OF A BUILDING

BUILDING MATERIALS WITH VISIBLE SIGNS OF WATER DAMAGE SHALL NOT BE INSTALLED. WALL AND FLOOR FRAMING SHALL NOT BE ENCLOSED WHEN THE FRAMING MEMBERS EXCEED 19-PERCENT MOISTURE CONTENT. MOISTURE CONTENT SHALL BE VERIFIED IN COMPLIANCE WITH THE FOLLOWING:

- MOISTURE CONTENT SHALL BE DETERMINED WITH EITHER A PROBE-TYPE OR CONTACT-TYPE MOISTURE METER. EQUIVALENT MOISTURE VERIFICATION METHODS MAY BE APPROVED BY THE ENFORCING AGENCY AND SHALL SATISFY REQUIREMENTS FOUND IN SECTION 101.8 OF THIS CODE.
- MOISTURE READINGS SHALL BE TAKEN AT A POINT 2 FEET (610 MM) TO 4 FEET (1219 MM) FROM THE GRADE STAMPED END OF EACH PIECE TO BE VERIFIED.
- AT LEAST THREE RANDOM MOISTURE READINGS SHALL BE PERFORMED ON WALL AND FLOOR FRAMING WITH DOCUMENTATION ACCEPTABLE TO THE ENFORCING AGENCY PROVIDED AT THE TIME OF APPROVAL TO ENCLOSE THE WALL AND FLOOR FRAMING.

INSULATION PRODUCTS WHICH ARE VISIBLY WET OR HAVE A HIGH MOISTURE CONTENT SHALL BE REPLACED OR ALLOWED TO DRY PRIOR TO ENCLOSURE IN WALL OR FLOOR CAVITIES. WET-APPLIED INSULATION PRODUCTS SHALL FOLLOW THE MANUFACTURERS' DRYING RECOMMENDATIONS PRIOR TO ENCLOSURE.

4.506 INDOOR AIR QUALITY AND EXHAUST

4.506.1 BATHROOM EXHAUST FANS

EACH BATHROOM SHALL BE MECHANICALLY VENTILATED AND SHALL COMPLY WITH THE FOLLOWING:

- FANS SHALL BE ENERGY STAR COMPLIANT AND BE DUCTED TO TERMINATE OUTSIDE THE BUILDING.
- UNLESS FUNCTIONING AS A COMPONENT OF A WHOLE HOUSE VENTILATION SYSTEM, FANS MUST BE CONTROLLED BY A HUMIDITY CONTROL.
 - HUMIDITY CONTROLS SHALL BE CAPABLE OF ADJUSTMENT BETWEEN A RELATIVE HUMIDITY RANGE OF 45 PERCENT TO A MAXIMUM OF 80 PERCENT. A HUMIDITY CONTROL MAY UTILIZE MANUAL OR AUTOMATIC MEANS OF ADJUSTMENT.
 - A HUMIDITY CONTROL MAY BE A SEPARATE COMPONENT TO THE EXHAUST FAN AND IS NOT REQUIRED TO BE INTEGRAL (I.E., BUILT-IN).

NOTES:

- FOR THE PURPOSES OF THIS SECTION, A BATHROOM IS A ROOM WHICH CONTAINS A BATHTUB, SHOWER, OR TUB/SHOWER COMBINATION.
- LIGHTING INTEGRAL TO BATHROOM EXHAUST FANS SHALL COMPLY WITH THE CALIFORNIA ENERGY CODE.

4.507 ENVIRONMENTAL COMFORT

4.507.1 RESERVED

4.507.2 HEATING AND AIR-CONDITIONING SYSTEM DESIGN

HEATING AND AIR-CONDITIONING SYSTEMS SHALL BE SIZED, DESIGNED AND HAVE THEIR EQUIPMENT SELECTED USING THE FOLLOWING METHODS:

- THE HEAT LOSS AND HEAT GAIN IS ESTABLISHED ACCORDING TO ANSIAACCA 2 MANUAL J-2016 (RESIDENTIAL LOAD CALCULATION), ASHRAE HANDBOOKS OR OTHER EQUIVALENT DESIGN SOFTWARE OR METHODS.
- DUCT SYSTEMS ARE SIZED ACCORDING TO ANSIAACCA 1 MANUAL D-2016 (EQUIVALENT DUCT SYSTEMS), ASHRAE HANDBOOKS OR OTHER EQUIVALENT DESIGN SOFTWARE OR METHODS.
- SELECT HEATING AND COOLING EQUIPMENT ACCORDING TO ANSIAACCA 3 MANUAL S-2016 (RESIDENTIAL EQUIPMENT SELECTION) OR OTHER EQUIVALENT DESIGN SOFTWARE OR METHODS.

EXCEPTION: USE OF ALTERNATE DESIGN TEMPERATURES NECESSARY TO ENSURE THE SYSTEMS FUNCTION ARE ACCEPTABLE.

CHAPTER 7 - INSTALLER & SPECIAL INSPECTOR QUALIFICATIONS

702 QUALIFICATIONS

702.1 INSTALLER TRAINING

HVAC SYSTEM INSTALLERS SHALL BE TRAINED AND CERTIFIED IN THE PROPER INSTALLATION OF HVAC SYSTEMS INCLUDING DUCTS AND EQUIPMENT BY A NATIONALLY OR REGIONALLY RECOGNIZED TRAINING OR CERTIFICATION PROGRAM. UNCERTIFIED PERSONS MAY PERFORM HVAC INSTALLATIONS WHEN UNDER THE DIRECT SUPERVISION AND RESPONSIBILITY OF A PERSON TRAINED AND CERTIFIED TO INSTALL HVAC SYSTEMS OR CONTRACTOR LICENSED TO INSTALL HVAC SYSTEMS. EXAMPLES OF ACCEPTABLE HVAC TRAINING AND CERTIFICATION PROGRAMS INCLUDE BUT ARE NOT LIMITED TO THE FOLLOWING:

- STATE CERTIFIED APPRENTICESHIP PROGRAMS.
- PUBLIC UTILITY TRAINING PROGRAMS.
- TRAINING PROGRAMS SPONSORED BY TRADE, LABOR OR STATEWIDE ENERGY CONSULTING OR VERIFICATION ORGANIZATIONS.
- PROGRAMS SPONSORED BY MANUFACTURING ORGANIZATIONS.
- OTHER PROGRAMS ACCEPTABLE TO THE ENFORCING AGENCY.

702.2 SPECIAL INSPECTION [HCD]

WHEN REQUIRED BY THE ENFORCING AGENCY, THE OWNER OR THE RESPONSIBLE ENTITY ACTING AS THE OWNER'S AGENT SHALL EMPLOY ONE OR MORE SPECIAL INSPECTORS TO PROVIDE INSPECTION OR OTHER DUTIES NECESSARY TO SUBSTANTIATE COMPLIANCE WITH THIS CODE. SPECIAL INSPECTORS SHALL DEMONSTRATE COMPETENCE TO THE SATISFACTION OF THE ENFORCING AGENCY FOR THE PARTICULAR TYPE OF INSPECTION OR TASK TO BE PERFORMED. IN ADDITION TO OTHER CERTIFICATIONS OR QUALIFICATIONS ACCEPTABLE TO THE ENFORCING AGENCY, THE FOLLOWING CERTIFICATIONS OR EDUCATION MAY BE CONSIDERED BY THE ENFORCING AGENCY WHEN EVALUATING THE QUALIFICATIONS OF A SPECIAL INSPECTOR:

- CERTIFICATION BY A NATIONAL OR REGIONAL GREEN BUILDING PROGRAM OR STANDARD PUBLISHER.
- CERTIFICATION BY A STATEWIDE ENERGY CONSULTING OR VERIFICATION ORGANIZATION, SUCH AS HERS RATERS, BUILDING PERFORMANCE CONTRACTORS, AND HOME ENERGY AUDITORS.
- SUCCESSFUL COMPLETION OF A THIRD PARTY APPRENTICE TRAINING PROGRAM IN THE APPROPRIATE TRADE.
- OTHER PROGRAMS ACCEPTABLE TO THE ENFORCING AGENCY.

NOTES:

- SPECIAL INSPECTORS SHALL BE INDEPENDENT ENTITIES WITH NO FINANCIAL INTEREST IN THE MATERIALS OR THE PROJECT THEY ARE INSPECTING FOR COMPLIANCE WITH THIS CODE.
- HERS RATERS ARE SPECIAL INSPECTORS CERTIFIED BY THE CALIFORNIA ENERGY COMMISSION (CEC) TO RATE HOMES IN CALIFORNIA ACCORDING TO THE HOME ENERGY RATING SYSTEM (HERS).

[BSC] WHEN REQUIRED BY THE ENFORCING AGENCY, THE OWNER OR THE RESPONSIBLE ENTITY ACTING AS THE OWNER'S AGENT SHALL EMPLOY ONE OR MORE SPECIAL INSPECTORS TO PROVIDE INSPECTION OR OTHER DUTIES NECESSARY TO SUBSTANTIATE COMPLIANCE WITH THIS CODE. SPECIAL INSPECTORS SHALL DEMONSTRATE COMPETENCE TO THE SATISFACTION OF THE ENFORCING AGENCY FOR THE PARTICULAR TYPE OF INSPECTION OR TASK TO BE PERFORMED. IN ADDITION, THE SPECIAL INSPECTOR SHALL HAVE A CERTIFICATION FROM A RECOGNIZED STATE, NATIONAL OR INTERNATIONAL ASSOCIATION, AS DETERMINED BY THE LOCAL AGENCY. THE AREA OF CERTIFICATION SHALL BE CLOSELY RELATED TO THE PRIMARY JOB FUNCTION, AS DETERMINED BY THE LOCAL AGENCY.

NOTES:

- SPECIAL INSPECTORS SHALL BE INDEPENDENT ENTITIES WITH NO FINANCIAL INTEREST IN THE MATERIALS OR THE PROJECT THEY ARE INSPECTING FOR COMPLIANCE WITH THIS CODE.

703 VERIFICATIONS

703.1 DOCUMENTATION

DOCUMENTATION USED TO SHOW COMPLIANCE WITH THIS CODE SHALL INCLUDE BUT IS NOT LIMITED TO, CONSTRUCTION DOCUMENTS, PLANS, SPECIFICATIONS, BUILDER OR INSTALLER CERTIFICATION, INSPECTION REPORTS, OR OTHER METHODS ACCEPTABLE TO THE ENFORCING AGENCY WHICH DEMONSTRATE SUBSTANTIAL CONFORMANCE. WHEN SPECIFIC DOCUMENTATION OR SPECIAL INSPECTION IS NECESSARY TO VERIFY COMPLIANCE, THAT METHOD OF COMPLIANCE WILL BE SPECIFIED IN THE APPROPRIATE SECTION OR IDENTIFIED APPLICABLE CHECKLIST.

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA

CAL GREEN RESIDENTIAL
REQUIREMENTS

APPROVED SET


DATE
09/28/2023

SHEET

G-202

SITE PLAN TO BE PROVIDED BY APPLICANT

SITE PLAN LEGEND

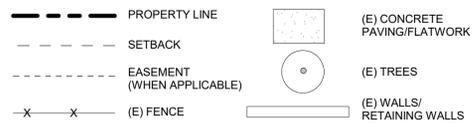

SITE PLAN GENERAL NOTES


- REFER TO GENERAL NOTES SHEET G-101 FOR ADDITIONAL REQUIREMENTS
- REFER TO STRUCTURAL PLANS FOR FURTHER INFORMATION.

SITE PLAN CHECKLIST

- ELECTRICAL PANEL:**
- OPTION 1 -** NEW ELECTRICAL MAIN PANEL WITH 225 AMP MINIMUM BUSBAR RATING
 - OPTION 2 -** A NEW ELECTRICAL SUBPANEL CONNECTS TO THE ELECTRICAL MAIN PANEL OF THE PRIMARY HOME WITH A 225 AMP MINIMUM BUSBAR RATING. A SEPARATE ELECTRICAL PERMIT SHALL BE PULLED FOR THE ELECTRICAL MAIN PANEL OF THE PRIMARY HOME. ELECTRICAL LOAD CALCULATIONS IS REQUIRED.
- IS THE NEW ADU IS 5' - 0" OR LESS TO ANY PROPERTY LINE AND/OR ADU IS 10' - 0" OR LESS FROM ANY ADJACENT BUILDING OR STRUCTURE?**
- NO** **YES; IF YES, 1-HR FIRE RATED WALL, 1-HR RATED ROOF, AND 1-HR RATED FIRE PROJECTS REQUIRED. SEE DETAILS: 21/A-903 & 24/A-903**
- NOTE: WHERE 1-HR FIRE-RESISTANCE RATED PROJECTIONS REQUIRED (NON-SPRINKLERED & FIRE SEPARATION DISTANCE ≥2'-0" <5'-0")**
TABLE 302.1(1)
A. THE FIRE-RESISTANCE RATING SHALL BE PERMITTED TO BE REDUCED TO 0 HOURS ON THE UNDERSIDE OF THE EAVE OVERHANG IF FIREBLOCKING IS PROVIDED FROM THE WALL TOP PLATE TO THE UNDERSIDE OF THE ROOF SHEATING
- NOTE:**
- A. A SEPARATE PERMIT FOR ONSITE WASTEWATER SYSTEM WILL BE REQ'D.**
 - B. SOILS REPORT TO BE PROVIDED BY OTHERS.**
 - C. UTILITY, GRADING, AND DRAINAGE PLAN TO BE PROVIDED BY OTHERS.**
 - D. PROVIDE WASTE RECYCLE FORM FILLED OUT AND SIGNED PRIOR TO ISSUANCE. THE OWNER/APPLICANT/CONTRACTOR/PERSON DOING THE WORK IS REQUIRED TO RECYCLE 75% OF ALL PROJECT CONSTRUCTION AND DEMOLITION DEBRIS.**
 - FOOTPRINT OF ALL EXISTING AND PROPOSED BUILDINGS**
PLOT THE PROPOSED ADU BUILDING FOOTPRINT ALONG WITH ANY OTHER EXISTING BUILDINGS ONSITE. THIS INCLUDES ALL STRUCTURES / PORCHES / GAZEBOS. IF AN OPTIONAL COVERED PATIO IS SELECTED, PLEASE PLOT THAT AS WELL.
 - AREA OF EXISTING BUILDING**
INDICATE THE SQUARE FOOTAGE OF THE EXISTING HOUSE.
 - FOOTPRINT OF PROPOSED ADU**
REFER TO LEGEND FOR FOOTPRINT AT 10'=1" SCALE
 - DRAWING SCALE**
SITE PLAN SHOULD BE DRAWN TO A MEASURABLE SCALE.
 - PROPERTY LINES**
SHOW OUTLINE OF PROPERTY USING DASHED LINE IN LEGEND. INDICATE THE BEARING AND DISTANCE OF THE PROPERTY LINE.
 - LABEL YARDS**
LABEL FRONT, REAR, SIDE YARDS, AS WELL AS DRIVEWAYS, PATHWAYS AND ANY OTHER HARDSCAPE.
 - SETBACKS**
DIMENSION THE DISTANCE BETWEEN BUILDINGS AND PROPOERTY LINES, AS WELL AS BUILDINGS TO OTHER STRUCTURES. SETBACKS TO SIDE AND REAR PROPERTY LINE SHALL BE A MINIMUM OF (4' - 0"). PROPOSED ADU SHALL BE LOCATED A MINIMUM OF (10' - 0") FROM EXISTING STRUCTURES.
 - EASEMENTS**
REFER TO LEGEND. MUST INCLUDE ALL APPLICABLE EASEMENTS. SETBACK PROPOSED STRUCTURE HSALL COMPLY WITH EASEMENT REQUIREMENTS.
 - LOCATION OF RAIN WATER LEADERS**
THE ROOF DRAINS SHOULD DRAIN AWAY FROM THE PROPERTY LINES AND INTO THE LANDSCAPE AREA.
 - LABEL STREETS & SIDEWALKS**
 - LABEL ADU AND ADDRESS LOCATION**
ADU SHALL HAVE THE SAME ADDRESS AS THE PRIMARY RESIDENCE. THE ADDRESS IDENTIFICATION SHALL BE LEGIBLE AND PLACED IN A POSITION THAT IS VISIBLE FROM THE STREET OR ROAD FRONTING THE PROPERTY. ADDRESS IDENTIFICATION CHARACTERS SHALL CONTRAST WITH THEIR BACKGROUND. ADDRESS SHALL COMPLY WITH CRC SECTION R319.
 - DIMENSION BUILDING SEPARATION**
DIMENSION THE DISTANCE BETWEEN THE PROPOSED ADU AND ANY EXISTING STRUCTURES
 - ALL EXISTING/PROPOSED PLANTINGS AND HARDSCAPE SHOWN**
 - LOT COVERAGE CALCULATION**
TOTAL FOOTPRINT AREA FOR STRUCTURES ON SITE / LOT AREA
 - SWIMMING POOLS**
ALL EXISTING SWIMMING POOLS SHALL BE SHOWN ON THE SITE PLAN AND SHALL HAVE 10' - 0" MINIMUM SETBACK TO THE NEW ADU STRUCTURE.
 - PORCHES**
THERE SHALL BE NO MORE THAN 30 INCHES MEASURED VERTICALLY TO THE FLOOR OR GRADE BELOW (INCLUDING FLOORS, STAIRS, RAMPS, AND LANDINGS) ANYWHERE MEASURED LESS THAN 36 INCHES HORIZONTALLY TO THE EDGE OF THE PORCH/SLAB/SURFACE OF THE RAIL. INSECT SCREENING SHALL NOT BE CONSIDERED AS A GUARD.
 - LOCATION OF EXISTING UTILITIES**
UTILITIES, POLES, SEWER, DRAINS, ELECTRICAL, GAS METERS AND LINES AND ANY PHOTOVOLTAIC.
 - LOCATION OF PROPOSED UTILITIES**
SANITARY SEWER FROM ADU TO EXISTING SEWER. SEWER LINE TO THE PROPOSED ADU SHALL BE CONNECTED TO THE MAIN LATERAL AT THE PROPERTY LINE OR BEHIND THE SIDEWALK. LATERAL POINT OF CONNECTION INCLUDING REQUIRED CLEANOUTS, WATER LINE TO ADU, ELECTRIC TO ADU INCLUDING ANY NEW METERS OR SUBPANELS, GAS LINE TO ADU.
 - A. TOTAL DEVELOPED LENGTH OF GAS SYSTEM FROM METER / REGULATOR TO MOST REMOTE GAS OUTLET.**
 - B. TOTAL DEVELOPED LENGTH FOR EACH GAS BRANCH AND ITS CORRESPONDING DEMAND.**
 - C. SHOW MECHANICAL, PLUMBING, AND KITCHEN GAS APPLIANCE LOCATION AND ITS DEMAND FACTORS.**
 - D. SHOW THE LOCATION AND AMPACITY OF THE ELECTRICAL PANEL SERVING THE ADU. VERIFY COMPLIANCE WITH ALL APPLICABLE REQUIREMENTS OF THE 2022 CEC.**



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONSTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

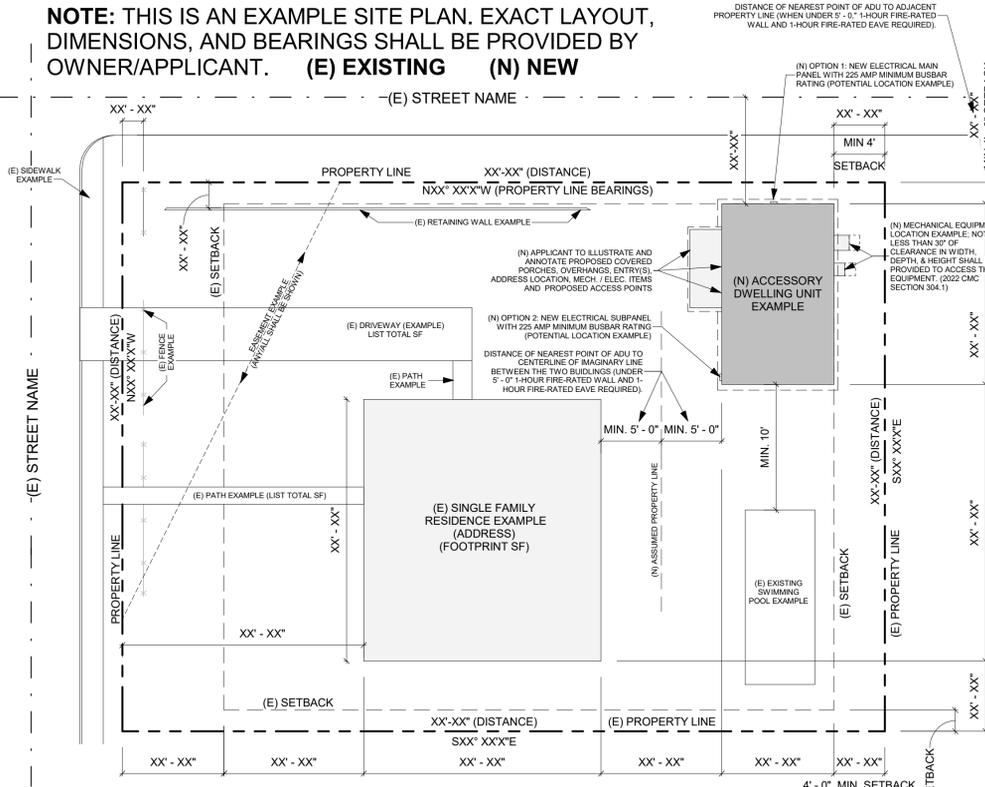

1 SITE PLAN EXAMPLE
SCALE: 1" = 20'-0"

FOR USE IN THE COUNTY OF SAN LUIS OBISPO
NOT FOR CONSTRUCTION

SITE PLAN


SCALE:




COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA
ARCHITECTURAL SITE PLAN
(EXAMPLE & INSTRUCTIONS)

APPROVED SET


DATE
09/28/2023
SHEET
AS-103



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL PERMITS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONSTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

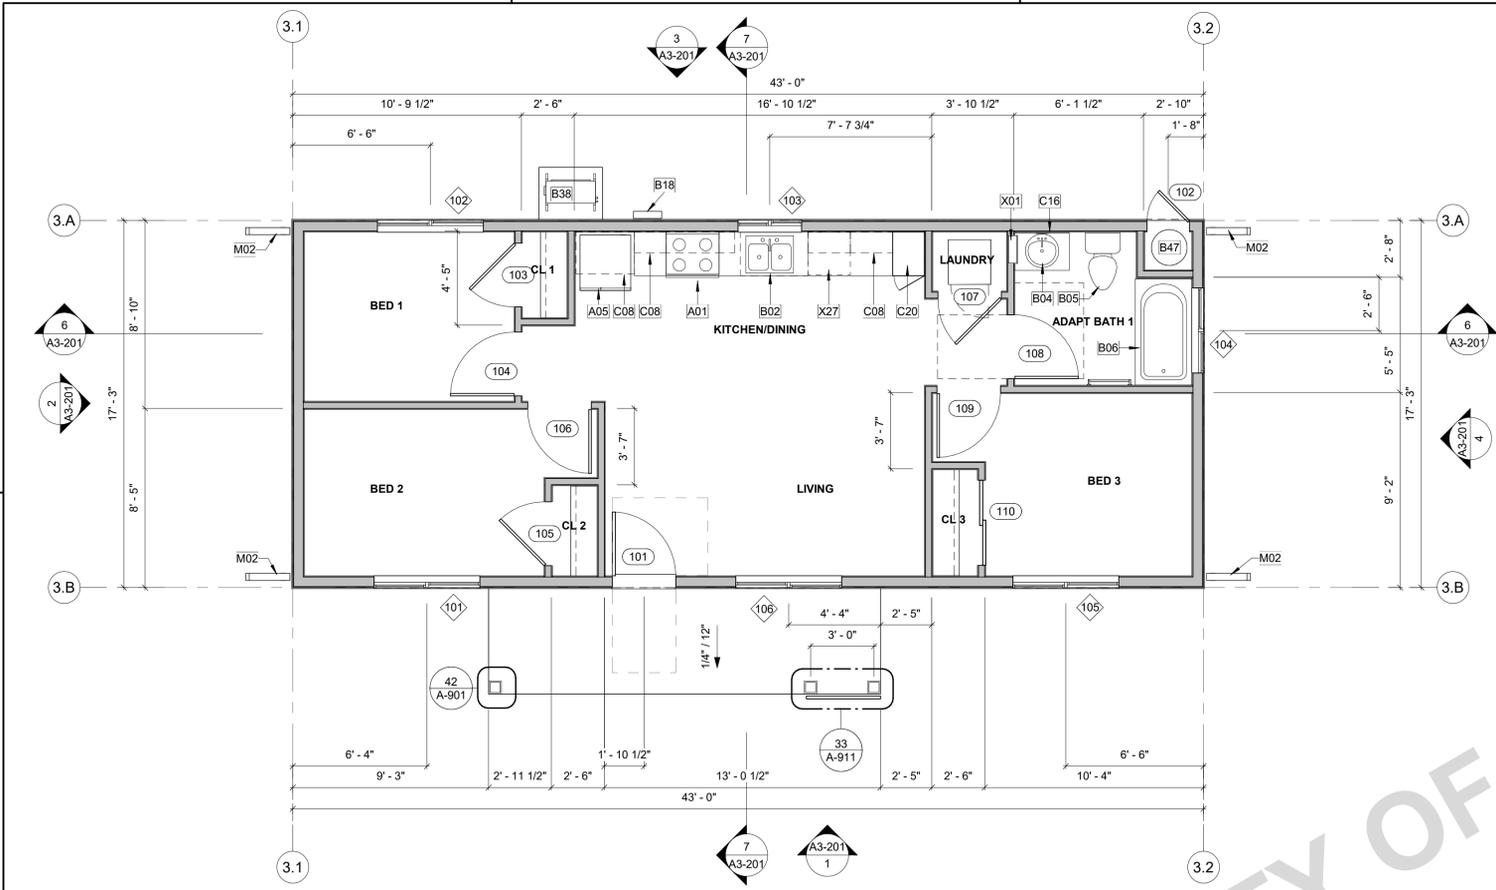

1 FLOOR PLAN
A1-201 | A3-101 SCALE: 1/4" = 1'-0"

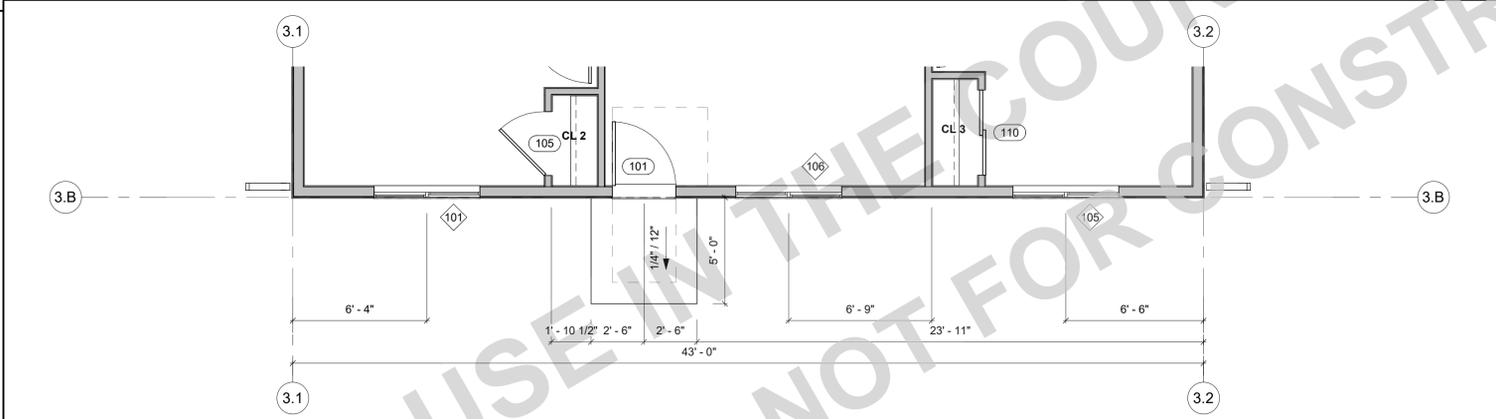

2 NO FRONT PORCH OPTION
A1-201 | A3-101 SCALE: 1/4" = 1'-0"

KEYNOTES

- A01 30" WIDE FREE STANDING ELECTRIC RANGE OVEN. VENT TO EXTERIOR. STAINLESS STEEL.
- A05 REFRIGERATOR LOCATION. PROVIDE 42" SPACE WITH ROUGH PLUMBING FOR ICE MAKER (RECESS IN WALL).
- B02 20" SINGLE COMPARTMENT UNDER-MOUNT KITCHEN SINK W/ GARBAGE DISPOSAL. REFER TO WATER EFFICIENCY REQUIREMENTS ON CALGREEN CODE NOTES SHEET.
- B04 LAVATORY SINK. REFER TO WATER EFFICIENCY REQUIREMENTS ON CALGREEN CODE NOTES SHEETS.
- B05 WATER CLOSET. REFER TO WATER EFFICIENCY REQUIREMENTS ON CALGREEN CODE NOTES SHEETS. REQ. AGING-IN-PLACE BLOCKING. SEE DETAIL 54/A-901.
- B06 32" x 60" x 72" TUB AND SHOWER COMBINATION. MODEL BY BULLDOZER. PROVIDE SHOWER ROD. REQ. AGING-IN-PLACE BLOCKING. SEE DETAIL 44/A-901.
- B18 ELECTRIC PANEL. 100AMP 240V.
- B38 MULTI-ZONE HEAT PUMP CONDENSER UNIT. REFER TO PLANS FOR LOCATION OF INDOOR FAN FAN COIL UNITS. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION. PROVIDE CONCRETE PAD MIN. 6" LARGER THAN UNIT IN EACH DIRECTION, 3" MIN. ABOVE GRADE.
- B47 40 GALLON HEAT PUMP WATER HEATER. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION.
- C08 12" DEEP UPPER CABINET
- C16 MIRROR. THE LENGTH OF THE VANITY OR PEDESTAL X 80" AFS. UNO. VERIFY WITH THE ELECTRICAL PLAN FOR LOCATION OF OUTLETS WHICH REQUIRE A CUT-OUT.. PROVIDE 2X6 BACKING AT BATHROOM WALL ATTACHMENTS
- C20 PANTRY CABINET. PAINTED OPEN WOOD SHELVING
- M02 DOWNSPOUT. CONNECT TO STORM DRAIN SYSTEM OR APPROVED DRAINAGE SYSTEM BY COUNTY.
- X01 OPTIONAL CABINET
- X27 OPTIONAL DISHWASHER

DOOR GENERAL NOTES

1. REFER TO GENERAL NOTES SHEET G-101 FOR ADDITIONAL REQUIREMENTS
2. REFER TO PLANS FOR LOCATION OF DOORS.
3. VERIFY ROUGH OPENING SIZE WITH DOOR MANUFACTURER SPECIFICATIONS PRIOR TO CONSTRUCTION.
4. CONTRACTOR TO VERIFY ACTUAL DOOR SIZE TO FIT FINISH OPENING PRIOR TO FABRICATION OF DOOR AND FINISH OPENING.
5. INSTALL PER MANUFACTURERS WRITTEN INSTRUCTIONS.
6. REFER TO DOOR TYPES LEGEND FOR GLAZING
7. REFER TO TABLE REPORT FOR GLAZING ENERGY REQUIREMENTS.
8. GLAZING IN DOORS SHALL BE TEMPERED PER SECTION R308.4.1. PANES INDICATED IN DOOR LEGEND WITH (T).

WINDOW GENERAL NOTES

1. REFER TO GENERAL NOTES ON SHEET G-101 FOR ADDITIONAL REQUIREMENTS.
2. REFER TO FLOOR PLANS FOR WINDOW LOCATIONS.
3. CONTRACTOR TO VERIFY EXACT ROUGH OPENING SIZES PRIOR TO FABRICATION OF ROUGH OPENINGS.
4. INSTALL PER MANUFACTURERS WRITTEN INSTRUCTIONS.
5. REFER TO ENERGY COMPLIANCE REPORTS FOR U-FACTOR, SHGC AND ADDITIONAL WINDOW REQUIREMENTS.
6. ALL GLAZING IS DOUBLE PANE WITH A MINIMUM OF ONE TEMPERED PANE UNLESS OTHERWISE NOTED.
7. EGRESS WINDOWS SHALL HAVE A CLEAR OPENING WITH A MAX. SILL HEIGHT OF 44" AFF. MIN NET CLEAR OPENING FOR EMERGENCY ESCAPE SHALL BE 5.7 S.F. EXCEPTION: MIN 5 S.F. AT GROUND FLOOR. MINIMUM NET CLEAR OPENING DIMENSIONS: HEIGHT: 24". WIDTH: 20"
8. GLAZING IN WALLS ADJACENT TO BATHTUB / SHOWER WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60" MEASURED VERTICALLY ABOVE ANY STANDING OR WALKING SURFACE SHALL BE SAFETY GLAZING. [CRC SEC. R308.4.5]

WINDOW REMARKS


1. REQUIRED EGRESS WINDOW. REFER TO GENERAL NOTE #7 FOR ADDITIONAL INFORMATION.
2. HAZARDOUS LOCATION. WINDOW INCLUDES BOTH PANES TEMPERED GLAZING.
3. MULLED WINDOW ASSEMBLY.
4. OPTIONAL WINDOW.
5. OBSCURE OPTIONAL. VERIFY WITH OWNER/APPLICANT.

WINDOW SCHEDULE

| NO. | TYPE | SIZE | | HEAD HEIGHT | REMARKS |
|-----|------|-------|--------|-------------|---------|
| | | WIDTH | HEIGHT | | |
| 101 | B | 5'-0" | 5'-0" | 6'-8" | 1 |
| 102 | B | 5'-0" | 5'-0" | 6'-8" | 1 |
| 103 | B | 3'-0" | 3'-0" | 6'-8" | |
| 104 | B | 4'-0" | 4'-0" | 6'-8" | 2, 5 |
| 105 | B | 5'-0" | 5'-0" | 6'-8" | 1 |
| 106 | B | 5'-0" | 5'-0" | 6'-8" | |

NOTE: PLEASE CROSS THROUGH THE CLIMATE ZONE THAT IS NOT APPLICABLE
CLIMATE ZONE 4 (CZ4) U-0.30 AND SHGC-0.23
CLIMATE ZONE 5 (CZ5) U-0.30 AND SHGC-0.35


WINDOW LEGEND

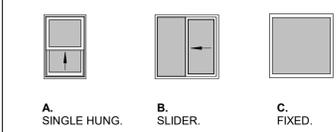

FLOOR PLAN GENERAL NOTES

1. REFER TO GENERAL NOTES SHEET G-101 FOR ADDITIONAL REQUIREMENTS.
2. REFER TO STRUCTURAL PLANS FOR FURTHER INFORMATION.
3. REFER TO ELECTRICAL PLANS FOR FURTHER INFORMATION IF PROVIDED.
4. REFER TO MECHANICAL PLANS, DRAWINGS OR REPORTS FOR FURTHER INFORMATION.
5. ALL FURNITURE AND EQUIPMENT IS BY OWNER AND IS SHOWN FOR COORDINATION PURPOSES ONLY.
6. DIMENSIONS ARE TO FACE OF FRAMING UNLESS SPECIFICALLY NOTED OTHERWISE.
7. PROVIDE ADEQUATE BLOCKING IN WALLS FOR CABINETS AND OTHER WALL MOUNTED ACCESSORIES INCLUDING BUT NOT LIMITED TO HANDRAILS, SHELVING AND BATHROOM FIXTURES.
8. DOOR AND WINDOW DIMENSIONS ARE CENTERED AT OPENINGS.
9. WHERE DOOR IS LOCATED WITHOUT DIMENSION AT THE CORNER OF A ROOM IT SHALL BE 4" FROM FACE OF FRAMING OF ADJACENT WALL TO ROUGH DOOR OPENING.
10. WHERE RECESSED FIXTURES OCCUR IN WALLS OR HORIZONTAL ASSEMBLIES, THE FIRE RATING OF THOSE ASSEMBLIES SHALL BE MAINTAINED.
11. AT ALL PENETRATIONS AND INTERSECTIONS OF FIRE-RATED PARTITIONS, PROVIDE FIRE SEALANT AND/OR FIRE STOPPING TO MAINTAIN CONTINUITY OF PARTITION RATING.
12. PER CRC R311.3 FLOORS OR LANDINGS AT EXTERIOR DOORS SHALL BE AT LEAST AS WIDE AS DOOR SERVED AND SHALL PROVIDE A LENGTH IN THE DIRECTION OF TRAVEL EQUAL TO 36 INCHES MINIMUM. SLOPE OF EXTERIOR LANDINGS SHALL NOT EXCEED 1/4" PER FOOT (2% SLOPE).
13. PER CRC 327.1.1 REINFORCEMENT FOR GRAB BARS SHALL BE PROVIDED IN AT LEAST ONE BATHROOM. 1. REINFORCEMENT SHALL BE SOLID LUMBER OR OTHER CONSTRUCTION MATERIALS APPROVED BY THE ENFORCING AGENCY. 2. REINFORCEMENT SHALL NOT BE LESS THAN 2X8 INCH NOMINAL LUMBER OR OTHER MATERIAL PROVIDING EQ. HT. AND CAPACITY. REINFORCEMENT ABOVE THE FINISHED FLOOR FLUSH WITH THE WALL FRAMING. 3. WATER CLOSET REINFORCEMENT SHALL BE INSTALLED ON BOTH SIDE WALLS OF THE FIXTURE, OR ONE SIDE WALL AND THE BACK WALL. 4. SHOWER REINFORCEMENT SHALL BE CONTINUOUS WHERE WALL FRAMING IS PROVIDED. 5. BATHTUB AND COMBINATION BATHTUB/SHOWER REINFORCEMENT SHALL BE CONTINUOUS ON EACH END OF THE BATHTUB AND THE BACK WALL. ADDITIONALLY, BACK WALL REINFORCEMENT FOR A LOWER GRAB BAR SHALL BE PROVIDED WITH THE BOTTOM EDGE LOCATED NO MORE THAN 6 INCHES ABOVE THE BATHTUB RIM.

WALL LEGEND



NOTE: SEE MANUFACTURER'S PRODUCT LISTINGS FOR IMPROVED SOUND AND/OR MOISTURE/MOLD/MILDEW-RESISTANT PERFORMANCE. VISIT GYPSUM.ORG FOR MORE INFORMATION.


DOOR REMARKS

1. EXTERIOR DOOR.
2. GLAZING PER DOOR TYPES. REFER TO GENERAL DOOR NOTE #8
3. PROVIDE 100 SQ INCHES OF VENTING IN DOOR OR BY OTHER APPROVED MEANS.
4. OPTIONAL DOOR.

DOOR SCHEDULE

| NO. | TYPE | DOOR | | REMARKS |
|-----|------|-------|--------|---------|
| | | WIDTH | HEIGHT | |
| 101 | A1 | 3'-0" | 6'-8" | 1, 2 |
| 102 | A2 | 2'-0" | 6'-8" | 1, 3 |
| 103 | C | 3'-0" | 6'-8" | |
| 104 | C | 3'-0" | 6'-8" | |
| 105 | C | 3'-0" | 6'-8" | |
| 106 | C | 3'-0" | 6'-8" | |
| 107 | E | 3'-0" | 6'-8" | |
| 108 | C | 3'-0" | 6'-8" | |
| 109 | C | 3'-0" | 6'-8" | |
| 110 | D | 4'-0" | 6'-8" | |

DOOR LEGEND

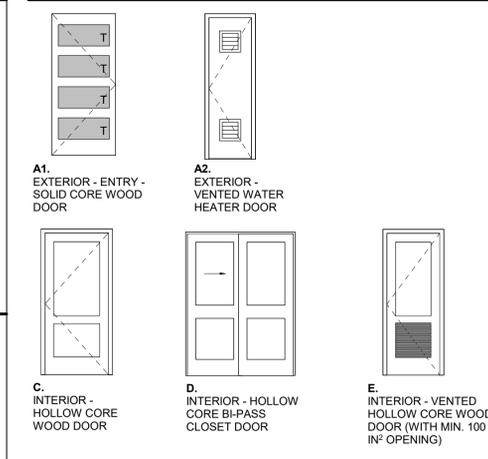


COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA

FLOOR PLAN

APPROVED SET

DATE
09/28/2023
SHEET
A3-101




THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRIBUTE THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

GENERAL MEP NOTES

- REFER TO ELECTRICAL NOTES ON SHEET G-101.
- REFER TO MECHANICAL NOTES ON SHEET G-101.
- REFER TO PLUMBING NOTES ON SHEET G-101.
- REFER TO TITLE 24 COMPLIANCE NOTES ON SHEET G-101.
- EXTERNALLY MOUNTED HEATING/COOLING UNITS SHALL BE SCREENED IF THEY ARE VISIBLE FROM A PUBLIC STREET.
- ALL SMOKE ALARMS TO BE HARD-WIRED WITH A BATTERY BACK-UP, AND ALL SMOKE ALARMS MUST BE INTERCONNECTED AND SOUND AN ALARM CLEARLY AUDIBLE IN ALL BEDROOMS.
- ALL CARBON MONOXIDE ALARMS TO BE HARD-WIRED WITH A BATTERY BACK-UP, AND ALL CARBON MONOXIDE ALARMS MUST BE INTERCONNECTED AND SOUND AN ALARM CLEARLY AUDIBLE IN ALL BEDROOMS.


KEYNOTES

- A01 30" WIDE FREE STANDING ELECTRIC RANGE OVEN. VENT TO EXTERIOR, STAINLESS STEEL.
- A05 REFRIGERATOR LOCATION. PROVIDE 42" SPACE WITH ROUGH PLUMBING FOR ICE MAKER (RECESS IN WALL).
- B04 LAVATORY SINK. REFER TO WATER EFFICIENCY REQUIREMENTS ON CALGREEN CODE NOTES SHEETS.
- B18 ELECTRIC PANEL, 100AMP 240V.
- B38 MULTI-ZONE HEAT PUMP CONDENSER UNIT. REFER TO PLANS FOR LOCATION OF INDOOR FAN FAN COIL UNITS. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION. PROVIDE CONCRETE PAD MIN. 6" LARGER THAN UNIT IN EACH DIRECTION, 3" MIN. ABOVE GRADE.
- B47 40 GALLON HEAT PUMP WATER HEATER. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION.
- B48 FAN COIL. REFER TO PLANS FOR LOCATION OF OUTDOOR CONDENSING UNIT. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION. PROVIDE OUTLET.
- X27 OPTIONAL DISHWASHER

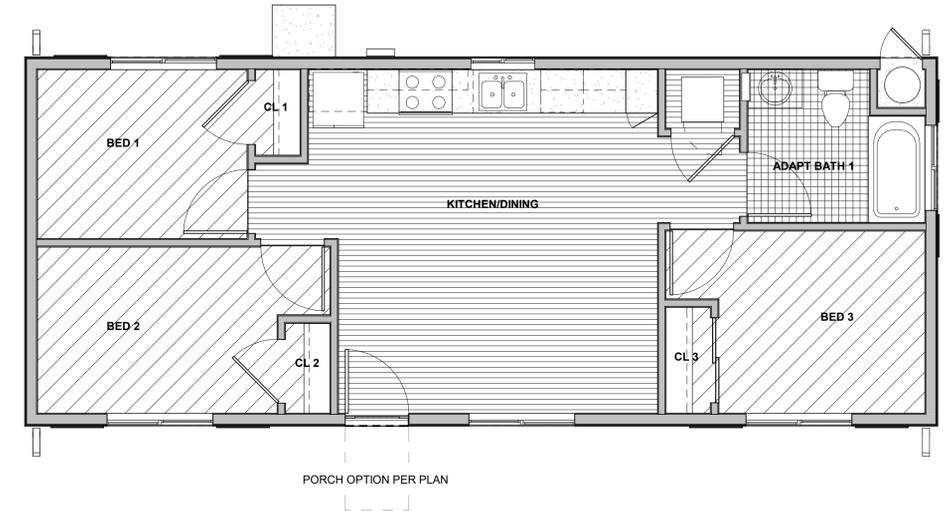

2 FINISH PLAN

A1-201 | A3-111 | SCALE: 1/4" = 1'-0"

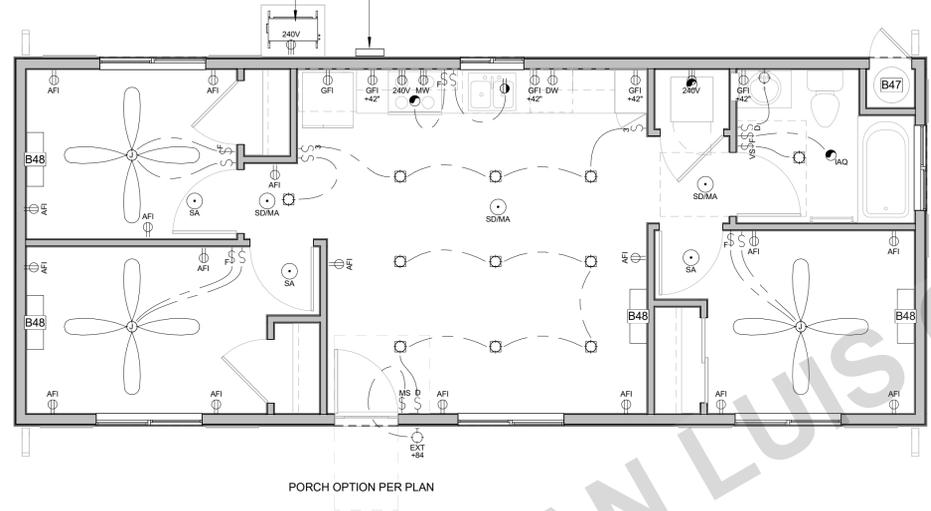

1 ELECTRICAL PLAN


A1-201 | A3-111 | SCALE: 1/4" = 1'-0"

FINISH PLAN GENERAL NOTES

- REFER TO GENERAL NOTES SHEET G-101 FOR ADDITIONAL REQUIREMENTS.
- REFER TO ELECTRICAL PLANS FOR FURTHER INFORMATION.
- REFER TO PLUMBING PLANS FOR FURTHER INFORMATION.
- REFER TO DETAILS FOR FLOOR/CEILING ASSEMBLIES AND INTERIOR FINISH DETAILS.
- ALL HARD SURFACE FLOORING SHALL BE SLIP RESISTANT AND MEET THE ANSI A326.3 STANDARD FOR MEASURING THE DYNAMIC COEFFICIENT OF FRICTION (DCOF).
- ALL FLOORING MATERIALS SHALL COMPLY WITH CBC SEC. 804.1.
- ALL WALL AND CEILING FINISHES SHALL COMPLY WITH CBC TABLE 803.13 FOR MAXIMUM FLAME SPREAD AND SMOKE DENSITY.

| FINISH SCHEDULE PLAN 3 | | | | |
|------------------------|-------|--------|---------|--|
| NAME | FLOOR | WALL | CEILING | NOTES |
| KITCHEN/DINING | LVP | GWB | GWB | WR GWB BEHIND KITCHEN COUNTER |
| ADAPT BATH 1 | CT | WR GWB | WR GWB | AT CERAMIC TILE IN TUB/SHOWER AREAS. PROVIDE BACKER BOARD PER CRC TABLE R702.4.2 |
| BED 2 | CPT | GWB | GWB | |
| CL 2 | CPT | GWB | GWB | |
| CL 1 | CPT | GWB | GWB | |
| BED 3 | CPT | GWB | GWB | |
| CL 3 | CPT | GWB | GWB | |
| WH | EC | GWB | GWB | |

FINISH LEGEND

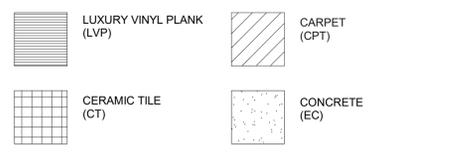

VENTILATION SUMMARIES


| 1) LOCAL EXHAUST VENTILATION | | | |
|---|-----------|-------------|--|
| BATHROOM | OPTION A | OPTION B | |
| BATHROOM FAN FLOW (cfm) | 50 CFM | 50 CFM | |
| DUCT TYPE | FLEX DUCT | SMOOTH DUCT | |
| DUCT SIZE (in) | 4" | 4" | |
| MAX. ALLOWABLE DUCT LENGTH (ft) | 70' | 105' | |
| THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 3 SONES. | | | |
| KITCHEN | OPTION A | OPTION B | |
| KITCHEN FAN FLOW (cfm) | 100 CFM | 80 CFM | |
| DUCT TYPE | FLEX DUCT | SMOOTH DUCT | |
| DUCT SIZE (in) | 5" | 5" | |
| MAX. ALLOWABLE DUCT LENGTH (ft) | 35' | 85' | |
| THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 3 SONES. | | | |
| 2) WHOLE BUILDING VENTILATION | | | |
| PER ASHRAE STANDARD 62.2, CEC EQUATION 150.0-B | | | |
| BUILDING FAN FLOW (cfm) | 80 CFM | 80 CFM | |
| DUCT TYPE | FLEX DUCT | SMOOTH DUCT | |
| DUCT SIZE (in) | 4" | 4" | |
| MAX. ALLOWABLE DUCT LENGTH (ft) | 70' | 35' | |
| THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 1 SONE. | | | |
| THIS EXHAUST FAN IS REQUIRED TO OPERATE CONTINUOUSLY TO ENSURE CONTINUOUSLY TO ENSURE INDOOR AIR QUALITY. | | | |

WHOLE DWELLING UNIT MECHANICAL VENTILATION
 PER SECTION 150.0(O)(C)(i) [ASHRAE 62.2-4.1.2]
3 BED - MINIMUM CUBIC FEET PER MINUTE (CFM) (Equation 150.0-B)
 $Q_{tot} = 0.03A_{floor} + 7.5(N_{br} + 1)$ $0.03(748 \text{ sf}) + 7.5(4) = 52.4 \text{ CFM} < 80 \text{ CFM}$

EFFECTIVE ANNUAL AVERAGE INFILTRATION RATE
 PER SECTION 150.0(O)(C)(ii)
 a. 1. (Equation 150.0-C) $Q_{50} = Vdu(x) 2 \text{ ACH50} / 60 \text{ minutes}$
 a. 2. (Equation 150.0-D) $Q_{50} = Vdu(x) \text{ Verified ACH50} / 60 \text{ minutes}$
 b. (Equation 150.0-E) $Q_{50} = 0.052(x) Q_{50} \times wsf \times [H/H]^{0.7}$ [ASHRAE 62.2-4.1.2.1]

REQUIRED MECHANICAL VENTILATION RATE
 AND REQUIRED MECHANICAL VENTILATION RATE PER 150.0(O)(C)(iii)
 [ASHRAE 62.2-4.1.2]
 (Equation 150.0-F) $Q_{fan} = Q_{tot}(\phi) \phi (Q_{inf}(x) A_{ext})$


NOTE: SIZE, DESIGN, AND SELECTION OF HVAC EQUIPMENT SHALL BE PROVIDED FOR PROJECT BY ONE OF THE FOLLOWING:
 A. HEAT LOSS AND GAIN PER "RESIDENTIAL LOAD CALCULATION" [ANSI/ACCA 2 MANUAL J - 2011, ASHRAE]
 B. DUCT SIZING PER "RESIDENTIAL DUCT SYSTEMS" [ANSI/ACCA 1 MANUAL D - 2014, ASHRAE]
 C. SELECTION PER "RESIDENTIAL EQUIPMENT SELECTION" [ANSI/ACCA 3 MANUAL S - 2014]

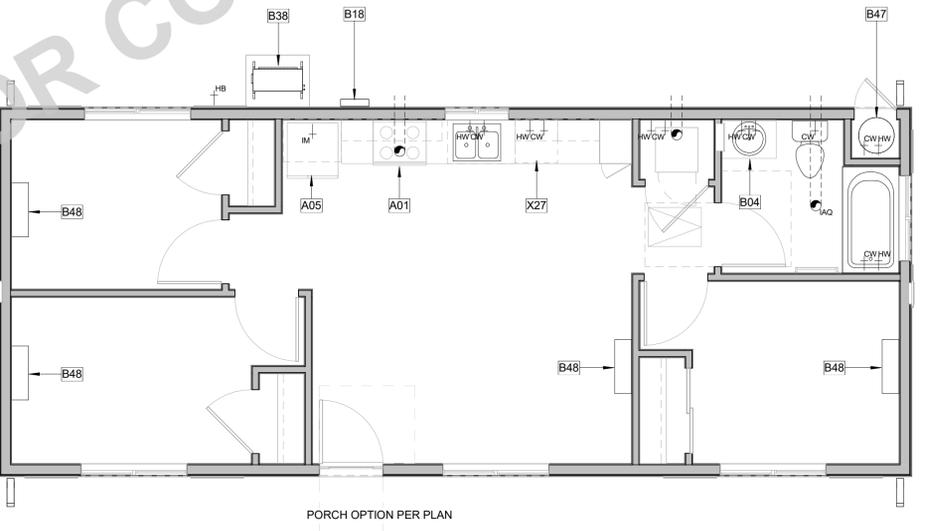

3 MECHANICAL PLAN

A1-201 | A3-111 | SCALE: 1/4" = 1'-0"


LEGEND

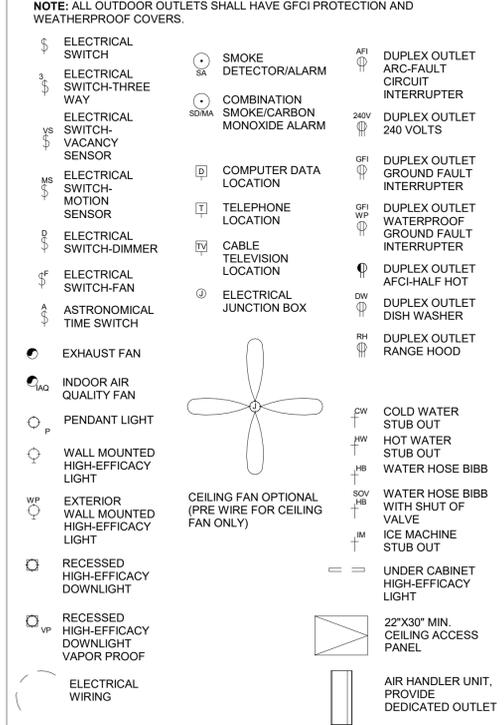

COUNTY OF SAN LUIS OBISPO
 ACCESSORY DWELLING UNIT
 SAN LUIS OBISPO, CA
 FINISH, MECHANICAL, &
 ELECTRICAL PLANS

APPROVED SET

DATE
 09/28/2023
 SHEET
 A3-111



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRIBUTE THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA

ROOF PLAN & REFLECTED
CEILING PLAN

APPROVED SET

DATE
09/28/2023

SHEET

A3-121

ROOF PLAN GENERAL NOTES

- REFER TO GENERAL NOTES SHEET G-101 FOR ADDITIONAL REQUIREMENTS
- REFER TO STRUCTURAL PLANS FOR ROOF FRAMING INFORMATION INCLUDING MEMBER SIZES AND CONNECTION HARDWARE.
- REFER TO MECHANICAL/ELECTRICAL SHEETS FOR ROOF PENETRATION LOCATIONS.
- PROVIDE A MINIMUM OF 1 INCH OF AIRSPACE BETWEEN THE INSULATION AND ROOF SHEATHING.
- WHERE THE ROOF PROFILE ALLOWS A SPACE BETWEEN THE ROOF COVERING AND DECKING, THE SPACES SHALL BE CONSTRUCTED TO PREVENT THE INTRUSION OF FLAMES AND EMBERS. BE FIRESTOPPED WITH APPROVED MATERIALS OR HAVE ONE LAYER OF MINIMUM 72 POUND MINERAL-SURFACED NONPERFORATED GAP SHEET OVER THE COMBUSTIBLE DECKING.
- ALL ROOFING MATERIALS TO BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS.
- OVERHANG DIMENSIONS ARE FROM FACE OF EXTERIOR WALL FRAMING TO ROOF EDGE
- ROOF COVERINGS AND UNDERLAYMENT SHALL BE APPLIED IN ACCORDANCE WITH (CRC R805), AND MANUFACTURER'S INSTALLATION INSTRUCTIONS
- ROOF VENTS SHALL BE APPLIED PER MANUFACTURER'S SPECIFICATIONS
- FURNISHED DIMENSIONS FOR VENTS ARE GUIDES ONLY. INSTALL PER MANUFACTURER'S SPECIFICATIONS AND ADJUST TO ACCOMMODATE TRUSS LOCATIONS, PLUMBING VENTS, AND SOLAR COLLECTORS.
- ENCLOSED ATTICS AND ENCLOSED RAFTER SPACES FORMED WHERE CEILINGS ARE APPLIED DIRECTLY TO THE UNDERSIDE OF ROOF RAFTERS SHALL HAVE CROSS VENTILATION FOR EACH SEPARATE SPACE BY VENTILATING OPENINGS PROTECTED AGAINST THE ENTRANCE OF RAIN OR SNOW. VENTILATION OPENINGS SHALL HAVE A LEAST DIMENSION OF 1/16 INCH MINIMUM AND 1/4 INCH MAXIMUM. OPENINGS IN ROOF FRAMING MEMBERS SHALL CONFORM TO THE REQUIREMENTS OF SECTION R802.7. REQUIRED VENTILATION OPENINGS SHALL OPEN DIRECTLY TO THE OUTSIDE AIR AND SHALL BE PROTECTED TO PREVENT THE ENTRY OF BIRDS, RODENTS, SNAKES AND OTHER SIMILAR CREATURES.
- THE MINIMUM NET FREE VENTILATING AREA SHALL COMPLY WITH CRC R806.2.
- IN THE INSTANCE OF UPPER VENTS, VENTS SHALL BE LOCATED NO MORE THAN 3 FT BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE, MEASURED VERTICALLY. CRC R806.2.
- FOR VENTED ROOF ASSEMBLIES: PROVIDE A MINIMUM OF 1 INCH OF AIRSPACE BETWEEN THE INSULATION AND ROOF SHEATHING.
- FOR UN-VENTED ROOF ASSEMBLIES: ROOF ASSEMBLY TO MEET CODE REQUIREMENTS OF CRC R806.5. PROVIDE MINIMUM 2" HIGH DENSITY CLOSE CELL INSULATION. PROVIDE ADDITIONAL INSULATION AS NEEDED TO MEET MINIMUM ROOF ASSEMBLY R-VALUE REQUIRED BY TITLE-24.
- ALL ROOFING TO BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS.
- OVERHANG DIMENSIONS ARE FROM FACE OF EXTERIOR WALL FRAMING TO ROOF EDGE

RCP GENERAL NOTES

- REFER TO GENERAL NOTES SHEET G-102 FOR ADDITIONAL REQUIREMENTS.
- HEIGHT OF CEILINGS SHALL BE MEASURED FROM TOP OF SLAB OR FLOOR TO FINISH FACE OF GWB, U.N.O.
- REFER TO ELECTRICAL PLANS FOR LIGHT FIXTURE AND EXHAUST LOCATIONS.
- DIMENSIONS ARE TO THE FACE OF FRAMING UNLESS OTHERWISE NOTED.
- LABEL MATERIAL SELECTIONS ON ALL RAKES, EAVES, PORCH SOFFITS, & OVERHANGS (A, B, C...).

KEYNOTES

- F03 22" X 30" MINIMUM ATTIC ACCESS. PROVIDED SWITCH AND OUTLET AT ATTIC FOR FAU. PERMANENTLY ATTACH R-38 OR GREATER INSULATION TO ATTIC ACCESS DOOR USING ADHESIVE OR MECHANICAL FASTENERS CIRC 150.0 (a). PROVIDE GASKETED ATTIC ACCESS TO PREVENT AIR LEAKAGE CIRC 150.0 (a)1.
- H07 BUILDING LINE BELOW.
- H12 ATTIC VENT (LOW). PAINT OR FINISH TO MATCH ROOF COLOR. SEE VENTING CALCS.
- H13 ATTIC VENT (HIGH). PAINT OR FINISH TO MATCH ROOF COLOR. SEE VENTING CALCS.
- M01 GUTTER. CONNECT TO DOWNSPOUT. PROVIDE MEANS TO PREVENT ACCUMULATION OF LEAVES AND DEBRIS IN GUTTER PER CRC R337.5.4
- M02 DOWNSPOUT. CONNECT TO STORM DRAIN SYSTEM OR APPROVED DRAINAGE SYSTEM BY COUNTY.

MATERIALS LEGEND


GRAPHICS LEGEND: OWNER/APP. TO PROVIDE MANUFACTURER, COLOR/FINISH SPECIFICATIONS, & WUI (WHEN REQ.) PRODUCT LISTINGS:

- ROOFING: SEE MATERIALS LEGEND ON ELEVATION SHEET FOR MORE INFORMATION. CLASS A ROOF REQ. BY WUI.
- INTERIOR CEILING FINISH, TYP. 5/8" GYP. INSTALL PER MFR RECOMMENDATIONS
NOTE: SEE MANUFACTURER'S PRODUCT LISTINGS FOR IMPROVED SOUND AND/OR MOISTURE/MOLD/MILDEW-RESISTANT PERFORMANCE PRODUCTS. VISIT GYPSUM.ORG FOR MORE INFORMATION.
- EXTERIOR EAVES, PORCH SOFFITS, & OVERHANGS
 - A) 2X TOUNGE & GROOVED (SOLID SAWN LUMBER)
 - B) FIBER CEMENT SOFFIT PANELS
 - C) HARDBOARD SOFFIT PANELS
 - D) EXT. GRADE FIRE RETARDANT TREATED SHEATHING (LABEL SELECTION ON REFLECTED CEILING PLAN)

- NOTES:**
- SOFFIT MATERIALS TO MEET REQ. OF CRC 337 & CRC 704.
 - INSTALL ALL MATERIALS, FASTENERS, & COMPONENTS PER MANUFACTURER'S SPECIFICATIONS & RECOMMENDATIONS
 - INSTALL ADDITIONAL BLOCKING AS NEEDED TO MEET ATTACHMENT REQUIREMENTS PER CRC TABLE R702.3.5
 - A PROJECT SITE WITHIN THE WILDLAND-URBAN INTERFACE FIRE AREA SHALL COMPLY WITH THE CRC SECTION R337. IF WUI APPROVED PRODUCTS ARE REQUIRED, PROVIDE SELECTED PRODUCT LISTINGS IN THE SPACES PROVIDED.


ROOF PLAN & RCP LEGEND

- XX'-X" CEILING HEIGHT (SEE PLAN FOR ACTUAL HEIGHTS)
- X : 12 ROOF SLOPE (REFER TO PLANS FOR ACTUAL SLOPE)
- X : 12 CEILING SLOPE (REFER TO PLANS FOR ACTUAL SLOPE)
- 22"X30" MIN. ATTIC ACCESS PANEL (WHERE REQ.)
- DORMER STYLE ROOF VENT. SEE ROOF VENTING CALCULATIONS
- OUTLINE OF WALL BELOW
- GUTTER. CONNECT TO DOWNSPOUT; SEE DETAIL: 12/A-901
- APPROXIMATE LOCATION OF DOWNSPOUT/LEADER TO ROOF OR SPLASHBLOCK BELOW; SEE DETAILS:
- XX SF AVAILABLE SOLAR ZONE LOCATIONS; PV SYSTEM UNDER SEPARATE PERMIT. SEE TITLE 24 REPORT FOR MORE INFORMATION
- AREA OF ATTIC WITH 30" HEIGHT OR GREATER. 22" X 30" CLEAR OPENING ACCESS REQUIRED IF TOTAL AREA GREATER THAN 30 SQ. FT. PER CRC R807.1

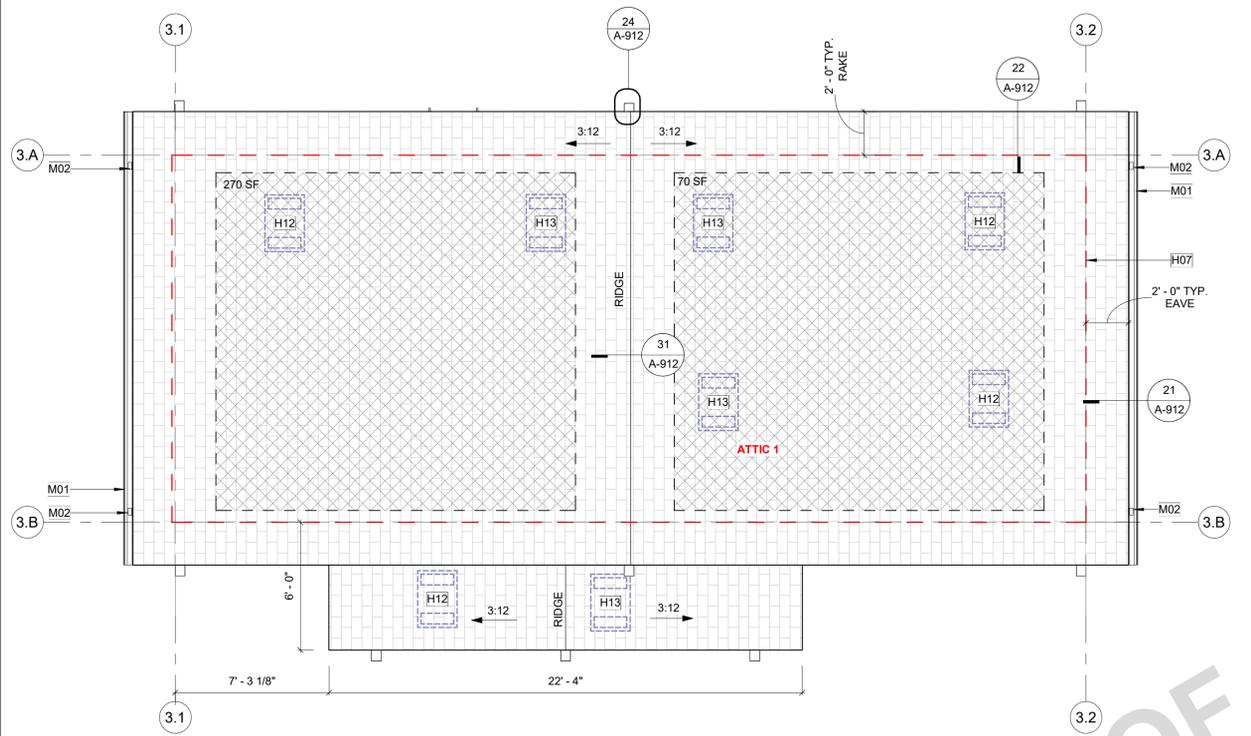

1 ROOF PLAN

A1-201 | A3-121 | SCALE: 1/4" = 1'-0"

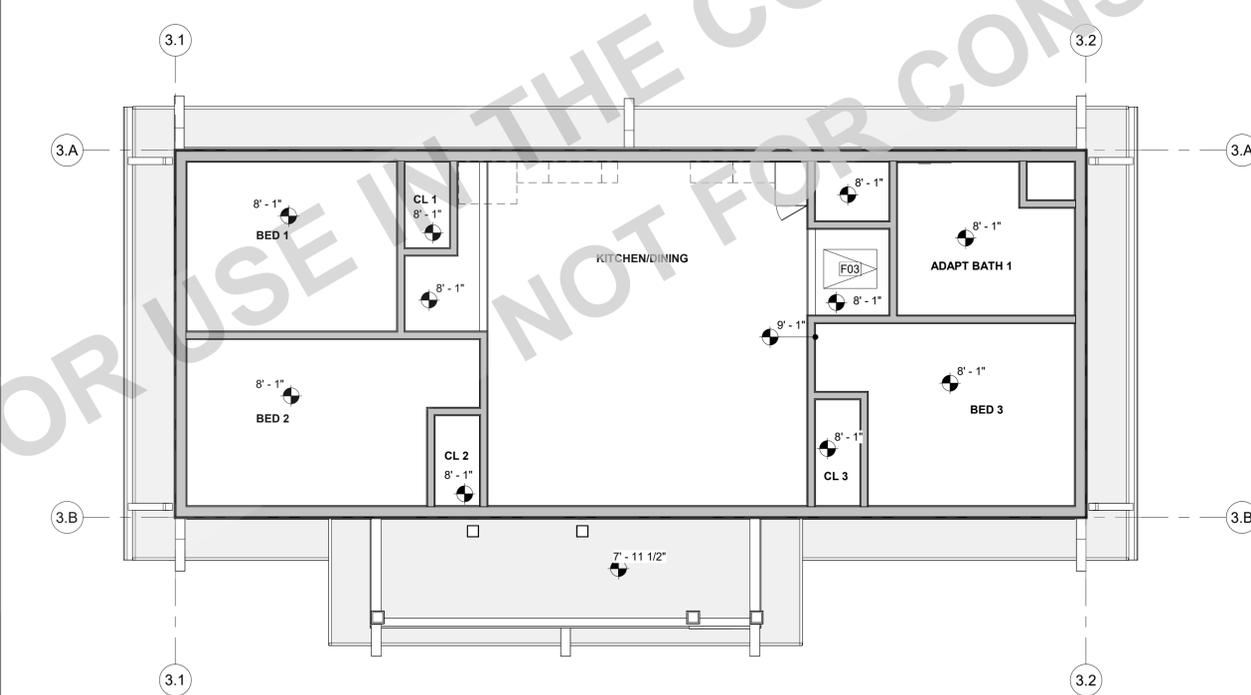

2 REFLECTED CEILING PLAN

A1-201 | A3-121 | SCALE: 1/4" = 1'-0"

ROOF VENTING CALCULATIONS

UPPER & LOWER VENTS:

O'HAGIN TAPERED LOW PROFILE FIRE & ICE COMPOSITION SHINGLE
FINISH TO MATCH ROOF
72.0 SQ. IN. OF AIR MOVEMENT PER VENT = 72. SQ. IN. / 144 = 0.5 SF

"UPPER VENTS PROVIDED" = (TOTAL ATTIC AREA/300) * (0.5) / (0.5 SF)


"LOWER VENTS PROVIDED" = (TOTAL ATTIC AREA/300) * (0.5) / (0.5 SF)

NOTE: ROOF VENTING SHALL COMPLY WITH CRC R806 & CRC 337.

- A) ENCLOSED ATTICS AND ENCLOSED RAFTER SPACES FORMED WHERE CEILINGS ARE APPLIED DIRECTLY TO THE UNDERSIDE OF ROOF RAFTERS SHALL HAVE CROSS VENTILATION FOR EACH SEPARATE SPACE BY VENTILATING OPENINGS PROTECTED AGAINST THE ENTRANCE OF RAIN OR SNOW. VENTILATION OPENINGS SHALL HAVE A LEAST DIMENSION OF 1/16 INCH MINIMUM AND 1/4 INCH MAXIMUM. OPENINGS IN ROOF FRAMING MEMBERS SHALL CONFORM TO THE REQUIREMENTS OF SECTION R802.7. REQUIRED VENTILATION OPENINGS SHALL OPEN DIRECTLY TO THE OUTSIDE AIR AND SHALL BE PROTECTED TO PREVENT THE ENTRY OF BIRDS, RODENTS, SNAKES AND OTHER SIMILAR CREATURES.
- B) THE MINIMUM NET FREE VENTILATING AREA SHALL COMPLY WITH CRC R806.2.
- C) PER CRC R802.1.3 ROOFING REQUIREMENTS FOR STRUCTURES LOCATED IN A WILDLAND-URBAN INTERFACE (WUI) FIRE AREA SHALL COMPLY WITH SECTION R337.5.
- D) THE PRODUCT ABOVE CAN BE FOUND IN THE CAL-FIRE STATE FIRE MARSHAL LISTED WILDLAND URBAN INTERFACE (WUI) PRODUCT HANDBOOK.

| ATTIC | AREA | REQUIRED ATTIC VENTING (NFA) | UPPER VENTING REQUIRED (NFA) | LOWER VENTING REQUIRED (NFA) |
|------------------|--------|------------------------------|------------------------------|------------------------------|
| ATTIC 1 - PLAN 3 | 742 SF | 2.47 SF | 1.24 SF | 1.24 SF |

| VENT TYPE | COUNT | VENT LENGTH | NET FREE AREA PER VENT | PROVIDED NET FREE AREA |
|---|-------|-------------|------------------------|------------------------|
| LOWER O'HAGIN SHINGLE ROOF VENT (LOWER) | 3 | 2' - 8" | 0.50 SF | 1.50 SF |
| UPPER O'HAGIN SHINGLE ROOF VENT (UPPER) | 3 | 2' - 8" | 0.50 SF | 1.50 SF |
| | | | | 1.50 SF |



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRIBUTE THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

GENERAL ELEVATION NOTES


1. REFER TO GENERAL NOTES SHEET G-102 FOR ADDITIONAL REQUIREMENTS
2. SEE DETAILS FOR ADDITIONAL INFORMATION AND REQUIREMENTS.
3. REFER TO ROOF PLAN FOR OVERHANGS, FASCIA PER DETAILS. PROVIDE ALUMINUM GUTTER. SEE ROOF PLAN FOR APPROXIMATE DOWNSPOUT LOCATIONS UNLGO.
4. REFER TO DOOR AND WINDOW SCHEDULES AND TYPES FOR DOOR AND WINDOW INFORMATION.
5. THE NOMINAL THICKNESS AND ATTACHMENT OF EXTERIOR WALL COVERINGS SHALL BE IN ACCORDANCE WITH CRC TABLE R703.3(1).
6. GYPSUM SHEATHING SHALL BE ATTACHED TO EXTERIOR WALLS IN ACCORDANCE WITH CRC TABLE R602.3.

SECTIONS GENERAL NOTES


1. THE PURPOSE OF THESE DRAWINGS IS TO SHOW CONSTRUCTION MATERIALS/ASSEMBLIES. FOR SPECIFIC SIZES AND DETAILS REFER TO ARCHITECTURAL PLANS, ELEVATIONS, DETAILS, AND STRUCTURAL PLANS. KEYNOTES ONLY APPLY IF REFERENCED ON PLANS.
2. WALL ASSEMBLIES TO BE PER FLOOR PLAN.
3. DOORS AND WINDOWS TO BE PER APPLICABLE SCHEDULE. REFER TO FLOOR PLANS FOR IDENTIFICATION.
4. INSULATION: REFER TO TITLE 24 REPORT AND "INSULATION" NOTES ON SHEET FOR ADDITIONAL RATINGS, REQUIREMENTS, AND INFORMATION.
5. FIREBLOCKING TO BE LOCATED AT THE FOLLOWING LOCATIONS PER 2022 CRC SECTION R302.11:
 - A. SECTION R302.11 - FIREBLOCKING SHALL BE PROVIDED IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES AND PARALLEL ROWS OF STUDS OR STAGGERED STUDS, AS FOLLOWS:
 1. VERTICALLY AT CEILING AND FLOOR LEVELS
 2. HORIZONTALLY AT INTERVALS NOT EXCEEDING 10 FEET.
 - AT INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS SOFFITS, DROP CEILINGS AND COVE CEILINGS
 - IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. ENCLOSED SPACES UNDER STAIRS SHALL COMPLY WITH SECTION R302.7.
 - AT OPENINGS AROUND VENTS, PIPES, DUCTS, CABLES AND WIRES AT CEILINGS AND FLOOR LEVEL. WITH AN APPROVED MATERIAL TO RESIST THE FREE PASSAGE OF FLAME PRODUCTS OF COMBUSTION. THE MATERIAL FILLING THIS ANNULAR SPACE SHALL NOT BE REQUIRED TO MEET THE ASTM E136 REQUIREMENTS.
 - FOR THE FIREBLOCKING OF CHIMNEYS AND FIREPLACES, SEE SECTION R1002.12
 - FIREBLOCKING OF CORNICES OF A TWO-FAMILY DWELLING IS REQUIRED AT THE LINE OF DWELLING-UNIT SEPARATION.
 - A. SECTION R302.11.1 - FIREBLOCKING MATERIALS SHALL CONSIST OF FOLLOWING MATERIALS:
 1. TWO-INCH NOMINAL LUMBER
 2. TWO THICKNESSES OF ONE-INCH NOMINAL LUMBER WITH BROKEN LAP JOINTS
 3. THE THICKNESS OF 0.719-INCH WOOD STRUCTURAL PANELS WITH JOINTS BACKED BY 0.719-INCH WOOD STRUCTURAL PANELS
 4. THE THICKNESS OF 0.75-INCH PARTICLE BOARD WITH JOINTS BACKED BY 0.75-INCH PARTICLE BOARD
 5. ONE-HALF-INCH GYPSUM BOARD
 6. ONE-FOURTH-INCH CEMENT-BASED MILLBOARD
 7. BATTS OR BLANKETS OF MINERAL WOOL, MINERAL FIBER OR OTHER APPROVED MATERIAL INSTALLED IN SUCH A MANNER AS TO BE SECURELY RETAINED IN PLACE
 8. CELLULOSE INSULATION INSTALLED AS TESTED IN ACCORDANCE WITH ASTM E119 OR UL 263, FOR THE SPECIFIC APPLICATION.
- PER 2022 CRC SECTION R317 SLEEPERS AND SILLS ON A CONCRETE OR MASONRY SLAB THAT IS IN DIRECT CONTACT WITH GROUND, UNLESS SEPARATED BY AN IMPERVIOUS MOISTURE BARRIER SHALL BE NATURALLY DURABLE OR PRESERVATIVE-TREATED WOOD IN ACCORDANCE WITH AWPA U1.

KEYNOTES


- B18 ELECTRIC PANEL, 100AMP 240V.
- B38 MULTI-ZONE HEAT PUMP CONDENSER UNIT. REFER TO PLANS FOR LOCATION OF INDOOR FAN COIL UNITS. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION. PROVIDE CONCRETE PAD MIN. 6" LARGER THAN UNIT IN EACH DIRECTION, 3" MIN. ABOVE GRADE.
- H05 ROOF EDGE/FASCIA. SEE DETAILS FOR FASCIA TYPE.
- H07 BUILDING LINE BELOW.
- H12 ATTIC VENT (LOW). PAINT OR FINISH TO MATCH ROOF COLOR. SEE VENTING CALC'S.
- H13 ATTIC VENT (HIGH). PAINT OR FINISH TO MATCH ROOF COLOR. SEE VENTING CALC'S.
- K03 EXTERIOR WALL COVERING. SEE TITLE SHEET & MATERIALS LEGEND FOR SELECTIONS & MORE INFO.
- K05 COMPOSITE ROOF SHINGLES. SEE MATERIALS LEGEND FOR MORE INFO.
- L14 LIGHT FIXTURE LOCATION. SEE DETAILS & ELECTRIC PLAN FOR MORE INFO.
- L20 BUILDING SHALL HAVE ADDRESS NUMBERS PLACED IN A POSITION THAT IS PLAINLY LEGIBLE AND VISIBLE FROM STREET, MINIMUM OF 4" HIGH WITH A MIN. STROKE OF 1/2" (EXACT LOCATION PER OWNER/APPLICANT).
- M01 GUTTER. CONNECT TO DOWNSPOUT. PROVIDE MEANS TO PREVENT ACCUMULATION OF LEAVES AND DEBRIS IN GUTTER PER CRC R337.5.4
- M02 DOWNSPOUT. CONNECT TO STORM DRAIN SYSTEM OR APPROVED DRAINAGE SYSTEM BY COUNTY.
- S03 ROOF INSULATION. R-38 MIN.
- S04 2X6 WALL INSULATION. R-19 MIN.
- U11 WOOD BEAM / HEADER. REFER TO STRUCTURAL.
- U13 FAUX OUTRIGGER. SEE STRUCTURAL AND DETAILS FOR MORE INFORMATION.

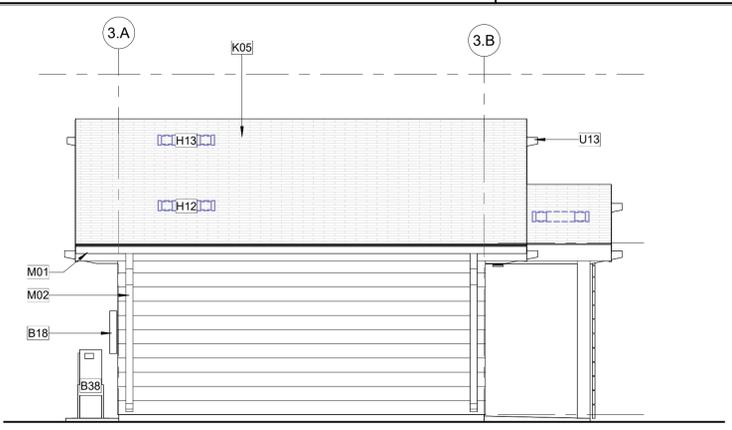


2 LEFT ELEVATION
A3-101 | A3-201 SCALE: 1/4" = 1'-0"

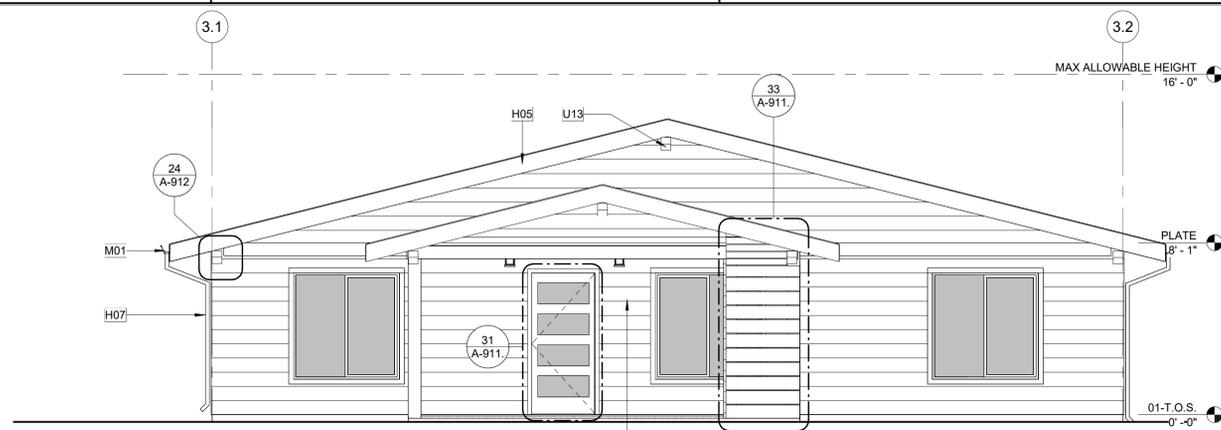


1 FRONT ELEVATION
A3-101 | A3-201 SCALE: 1/4" = 1'-0"

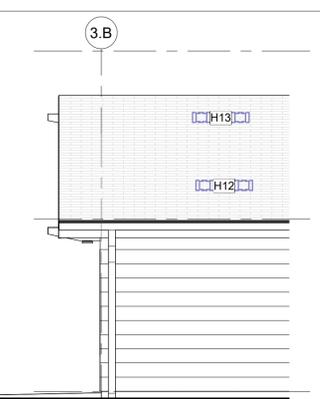


5 RIGHT ELEV. NO PORCH OPT.
A3-201 SCALE: 1/4" = 1'-0"

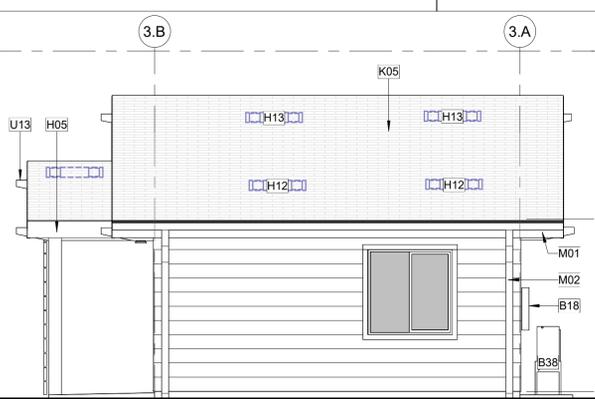


4 RIGHT ELEVATION
A3-101 | A3-201 SCALE: 1/4" = 1'-0"

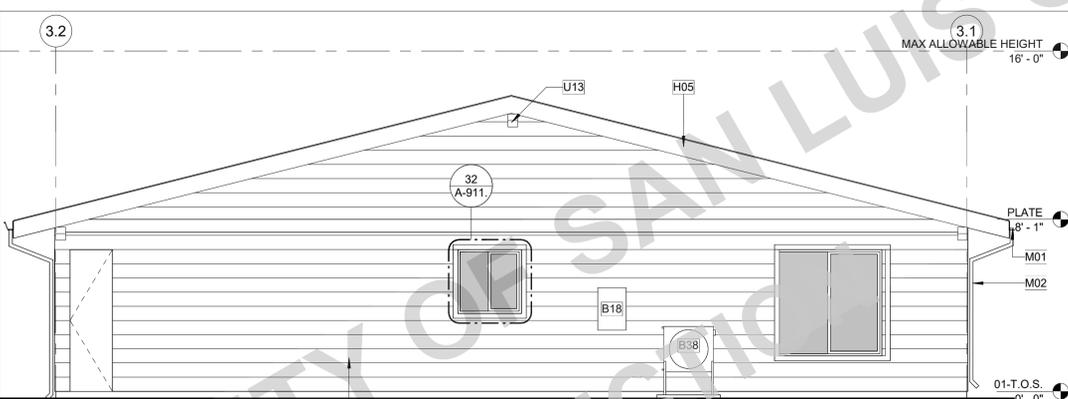


3 REAR ELEVATION
A3-101 | A3-201 SCALE: 1/4" = 1'-0"

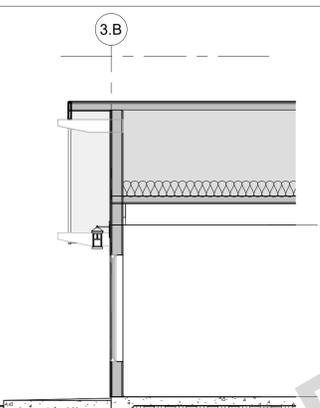


8 SECTION 02 NO PORCH OPT.
A3-201 SCALE: 1/4" = 1'-0"

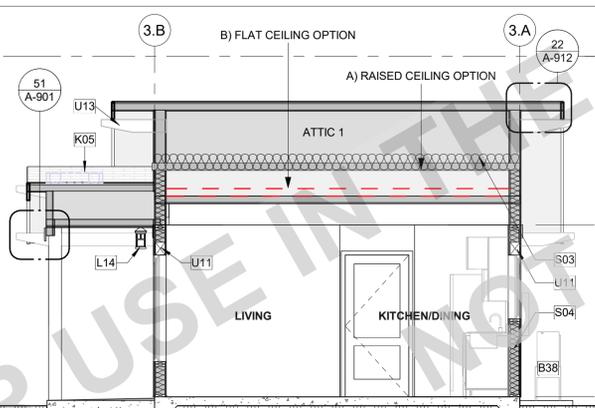

7 SECTION 02
A3-101 | A3-201 SCALE: 1/4" = 1'-0"

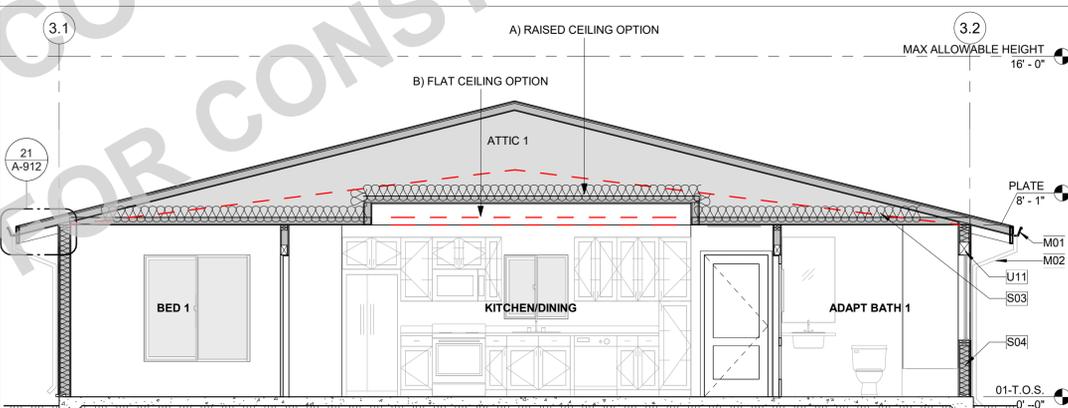

6 SECTION 01
A3-101 | A3-201 SCALE: 1/4" = 1'-0"

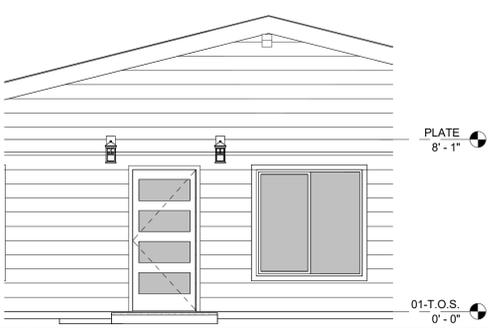

9 FRONT ELEVATION NO PORCH OPTION
A3-201 SCALE: 1/4" = 1'-0"

MATERIALS LEGEND

1. COLOR SCHEMES AND FINISH OF PRODUCT SELECTIONS RECOMMENDED TO MATCH PRIMARY RESIDENCE. INSTALL ALL MATERIAL SELECTIONS PER MANUFACTURER'S RECOMMENDATIONS.
2. A PROJECT SITE WITHIN THE WILDLAND-URBAN INTERFACE FIRE AREA SHALL COMPLY WITH THE CRC SECTION R337. IF WUI APPROVED PRODUCTS ARE REQUIRED, PROVIDE SELECTED PRODUCT LISTINGS IN THE SPACES PROVIDED. WHEN NOT REQUIRED, WRITE "NOT APPLICABLE."
3. APPROVED PRODUCT LISTINGS CAN BE FOUND IN THE (CURRENT) CAL-FIRE STATE FIRE MARSHAL LISTED WILDLAND URBAN INTERFACE WUI PRODUCT HANDBOOK.
4. IF PROJECT SITE REQUIRES WUI COMPLIANCE, IN THE CASE THAT PRODUCT SELECTIONS ARE NOT BML LISTED, NOR IN THE HANDBOOK, MATERIALS SHALL COMPLY WITH THE PRESCRIPTIVE STANDARDS OF CHAPTER 7A.

GRAPHICS LEGEND:

- E) FIBER CEMENT HORIZONTAL LAP SIDING (SHALL MEET ALL REQ. OF CRC 337 & CRC R703.10.2)
- F) EXT. GRADE WOOD HORIZONTAL LAP SIDING (SHALL MEET ALL REQ. OF CRC 337 & CRC R703.5.3)

OWNER/APP. TO PROVIDE MANUFACTURER, COLOR/FINISH SPECIFICATIONS, & WUI (WHEN REQ.) PRODUCT LISTINGS:

GRAPHICS LEGEND:


- ASPHALT COMPOSITE ROOF SHINGLES (SHALL COMPLY WITH CRC 337 & CRC R905.2.4 & ASTM D3462)
- CLASS-A ROOF ASSEMBLY REQ. PER WUI:
 - YES
 - NO

OWNER/APP. TO PROVIDE MANUFACTURER, COLOR/FINISH SPECIFICATIONS, & WUI (WHEN REQ.) PRODUCT LISTINGS:


APPROVED SET

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA
ELEVATIONS & BUILDING SECTIONS


DATE
09/28/2023
SHEET
A3-201

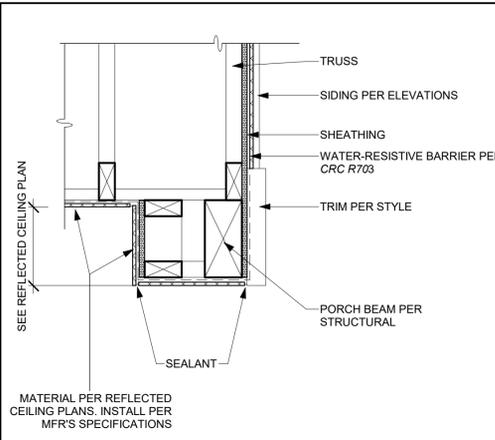


51 TYP. PORCH BEAM @ SOFFIT
SCALE: 1/12" = 1'-0"

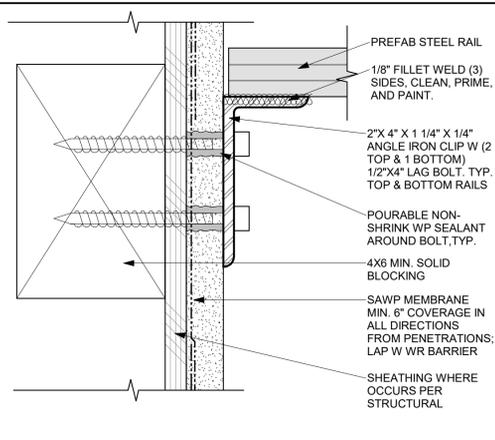


41 RAILING CONNECTION DETAIL
SCALE: 6" = 1'-0"

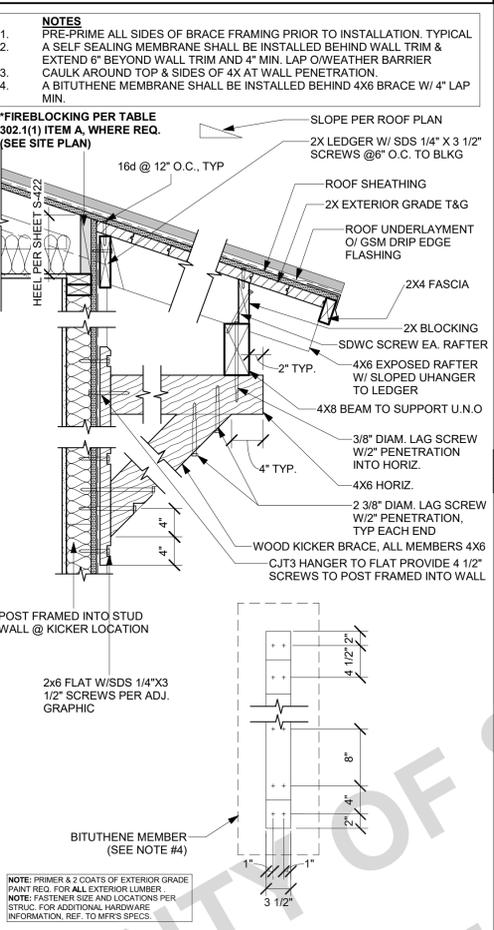


32 SHED ROOF WITH KICKER (CONT. ROOF)
SCALE: 1" = 1'-0"

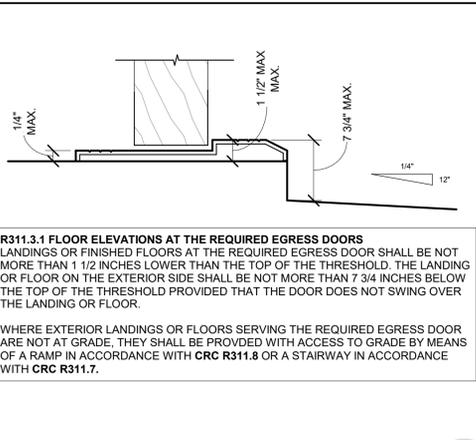


21 EXTERIOR DOOR THRESHOLD - TYPICAL
SCALE: 6" = 1'-0"

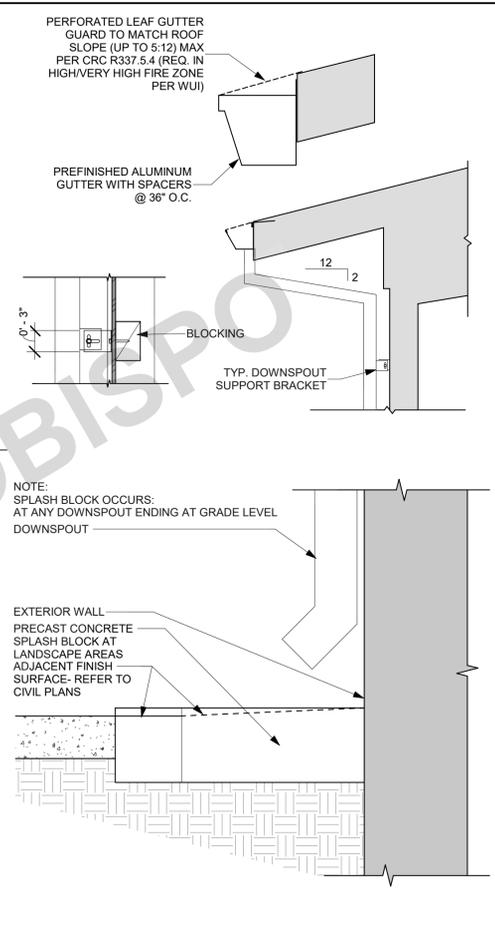


12 TYP. GUTTER TO EXT. DOWNSPOUT
SCALE: 1/2" = 1'-0"




42 TYPICAL POST
SCALE: 3/4" = 1'-0"

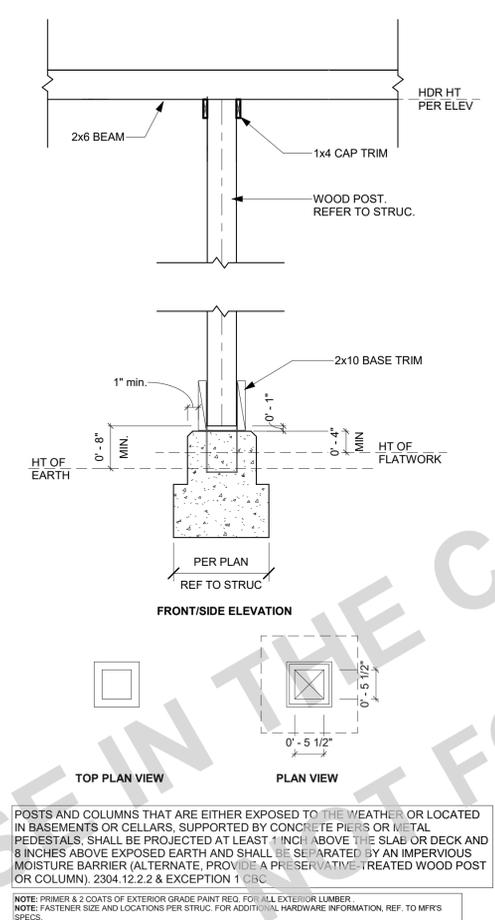


34 SHED ROOF WITH KICKER
SCALE: 1" = 1'-0"

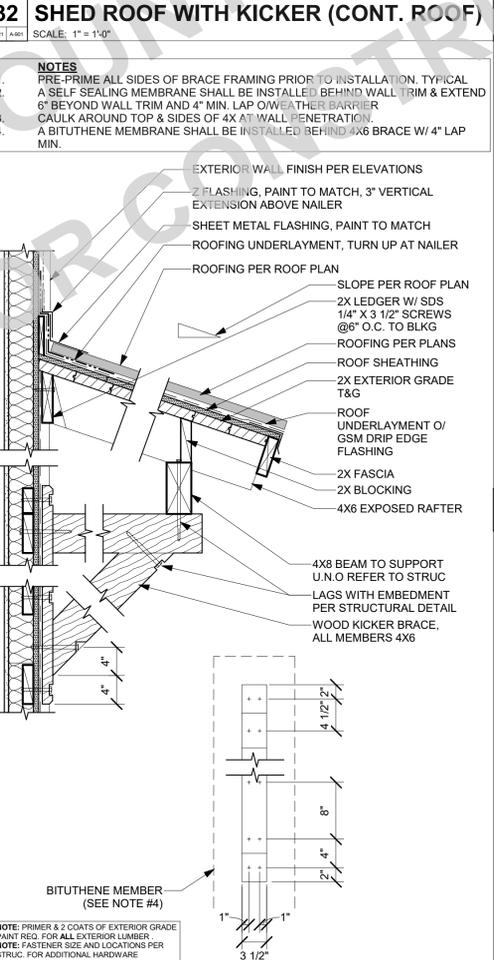


23 TYP. FOUNDATION
SCALE: 3" = 1'-0"

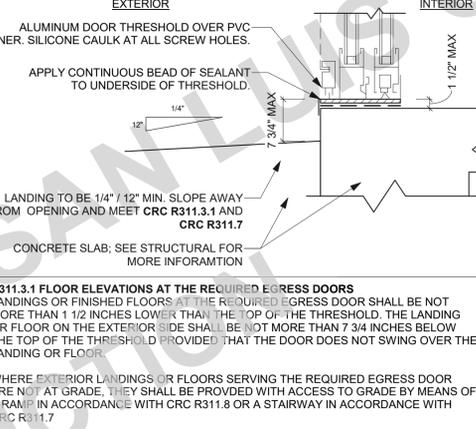


22 DOOR-SLIDING GLASS - THRESHOLD
SCALE: 3" = 1'-0"

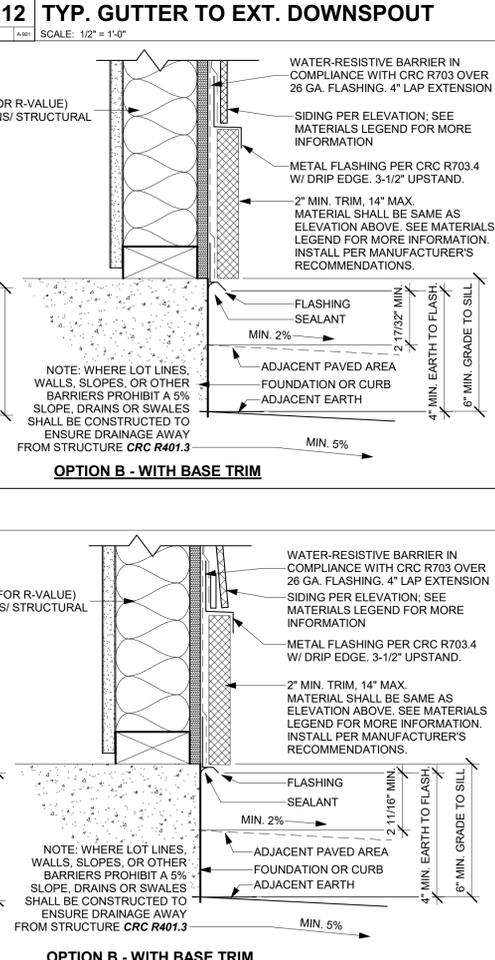


24 TYP. FOUNDATION @ HORIZONTAL LAP SIDING
SCALE: 3" = 1'-0"

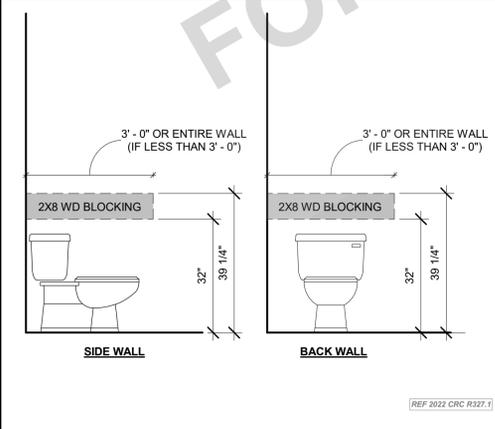

54 TOILET BLOCKING - AGING-IN-PLACE
SCALE: 1/2" = 1'-0"

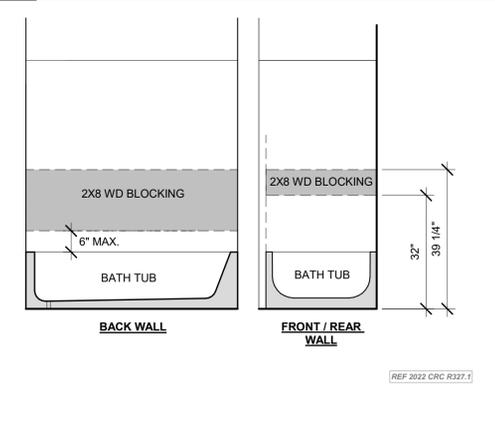

44 TUB BLOCKING - AGING-IN-PLACE
SCALE: 1/2" = 1'-0"



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONSTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.


COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA

ARCHITECTURAL DETAILS



APPROVED SET

DATE
09/28/2023



SHEET
A-901





THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRIBUTE THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

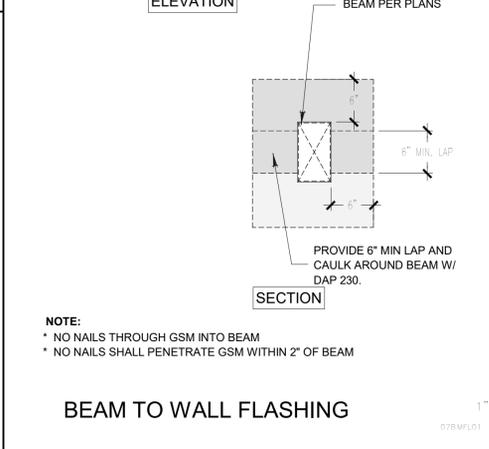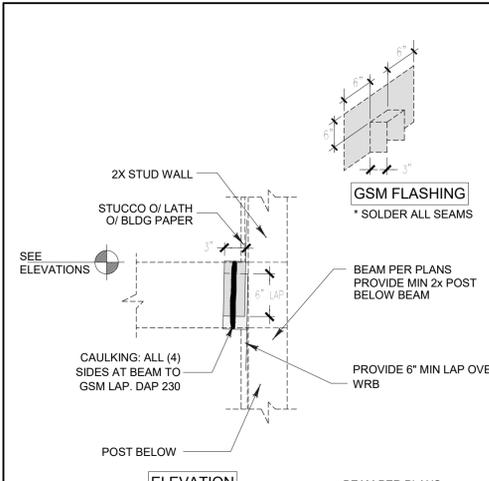



52 BEAM TO WALL FLASHING
SCALE: 1" = 1'-0"

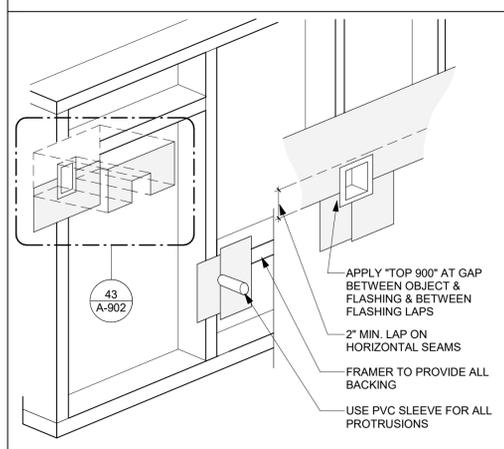



43 FLASHING - PROTRUSIONS
SCALE: 1 1/2" = 1'-0"

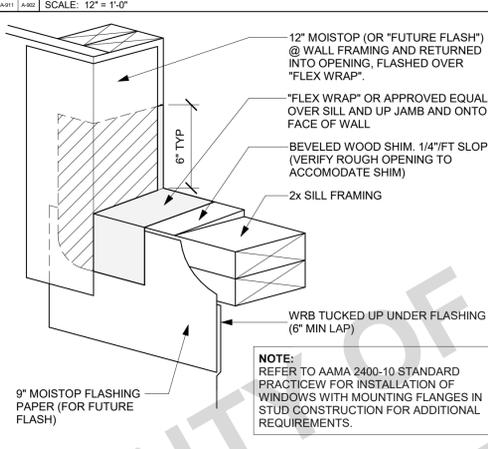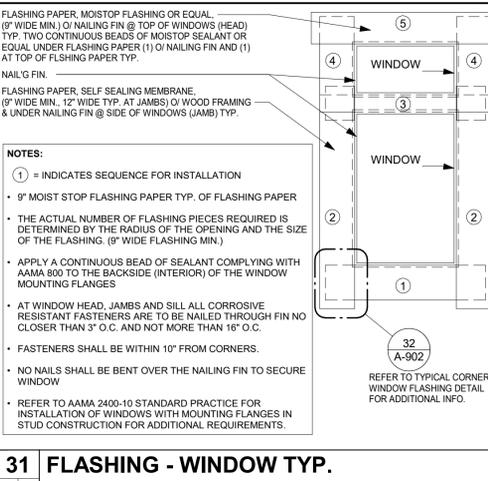


33 FLASHING - DOOR AT GRADE
NTS

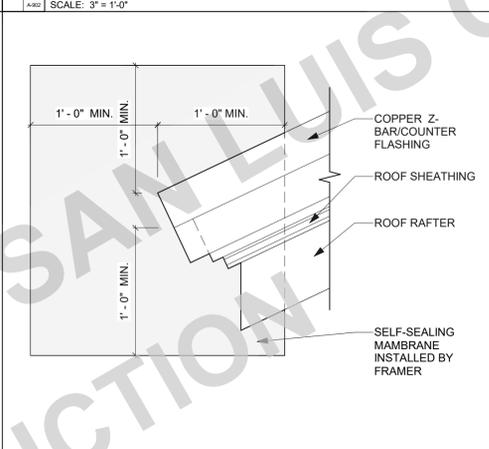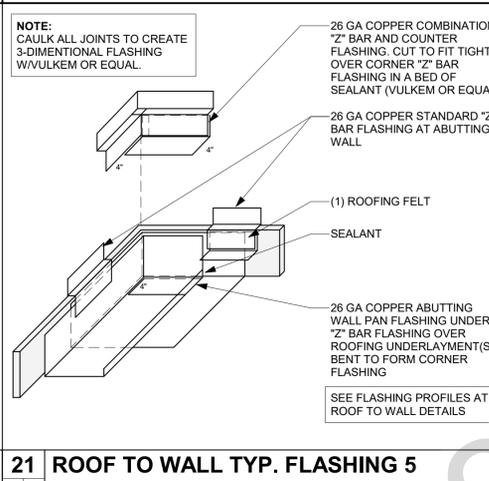


22 FLASHING - FASCIA TO WALL TYP.
SCALE: 1 1/2" = 1'-0"

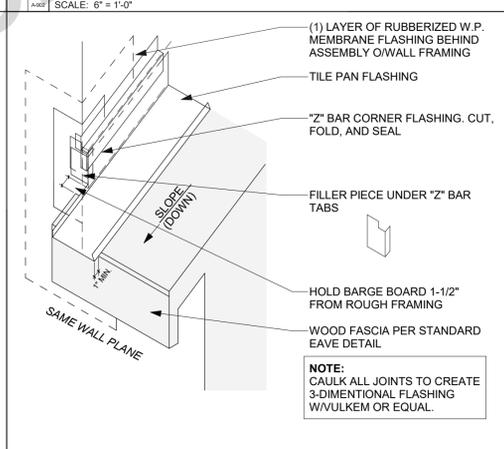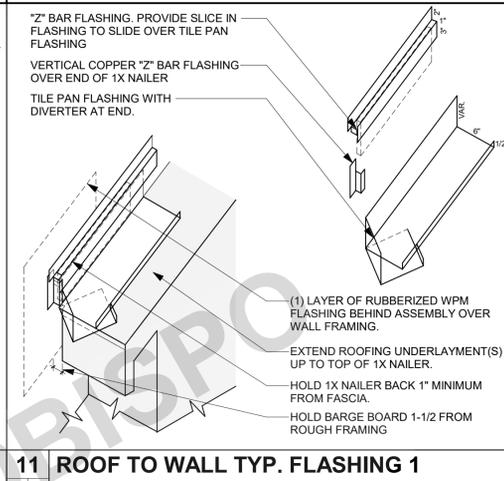


12 ROOF TO WALL TYP. FLASHING 2
SCALE: 3\"/>

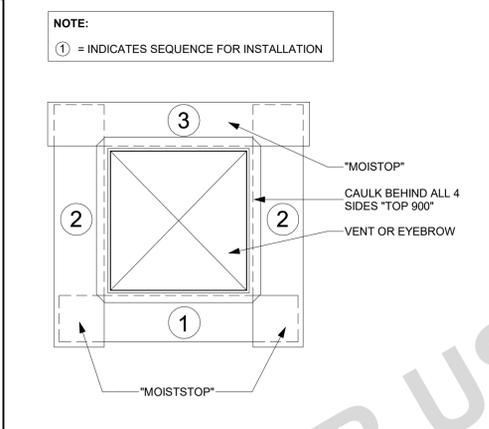


53 FLASHING - G.I. VENT
SCALE: 1" = 1'-0"

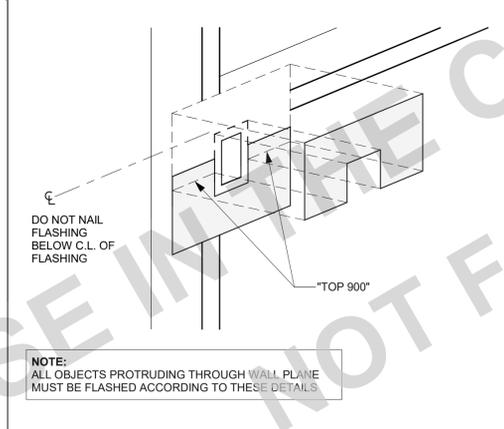


42 FLASHING - PROTRUSIONS
SCALE: 1 1/2" = 1'-0"

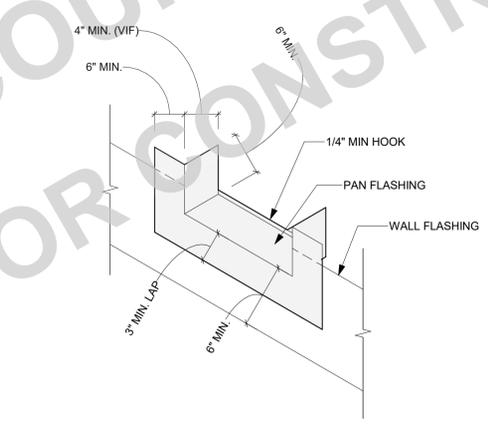






34 FLASHING - DOOR AT W.P. DECK2
NTS

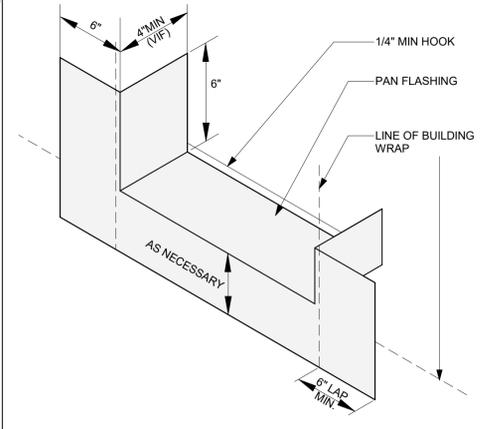

23 FLASHING PAN @ DOOR THRESHOLD
SCALE: 3\"/>

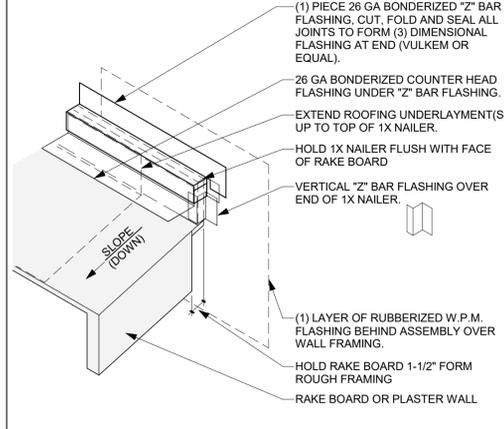

13 ROOF TO WALL TYP. FLASHING 3
SCALE: 3\"/>

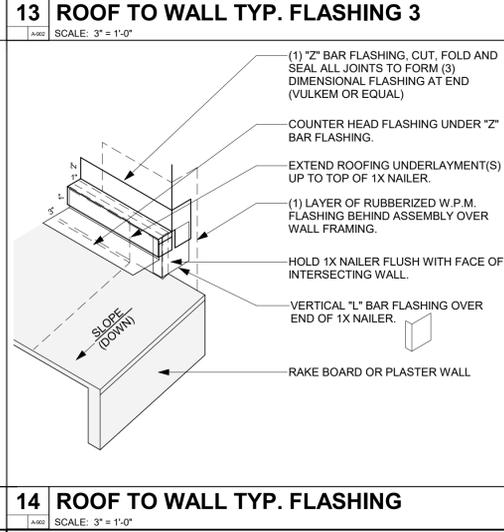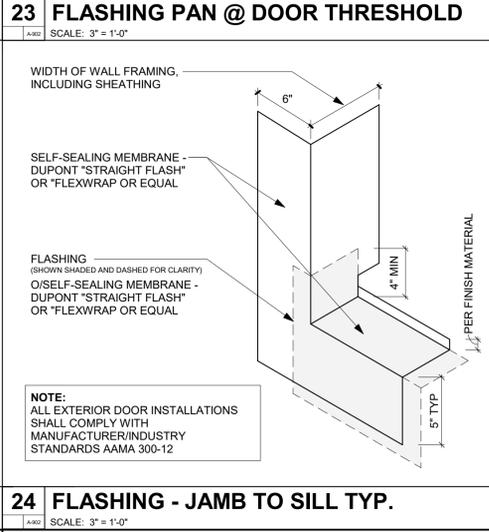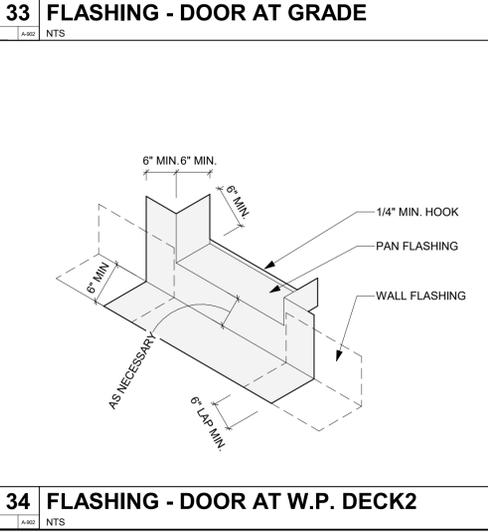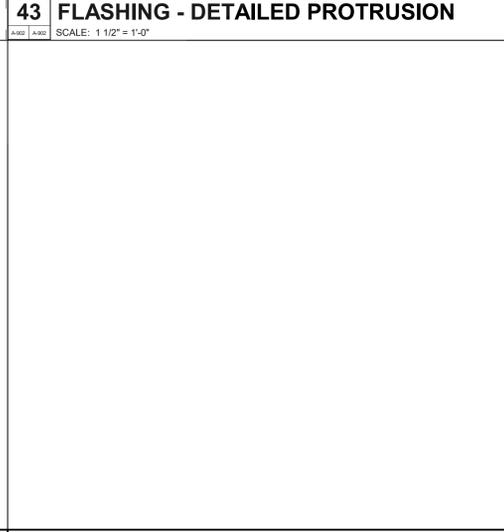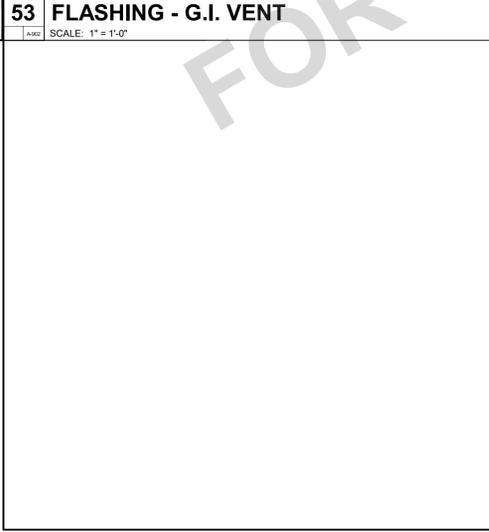

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA


ARCHITECTURAL DETAILS

APPROVED SET

DATE
09/28/2023


SHEET
A-902

9/28/2023 3:52:01 PM
C:\Users\amartinez\Documents\2727-01 SLO County ADU_CD_CENTRAL_2022_amartinez\35FGU.rvt



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

XHEZ.W-L-1166 WALL SYSTEM PENETRATION
F RATING - 1 AND 2 HR (SEE ITEM 1B)
T RATING - 0 HR

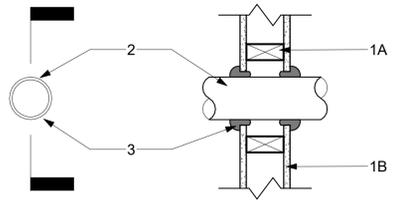

1. WALL ASSEMBLY
THE 1 OR 2 HR. FIRE RATED GYPSUM WALLBOARD/STUD WALL ASSEMBLY SHALL BE CONSTRUCTED OF THE MATERIALS AND IN THE MANNER SPECIFIED IN THE INDIVIDUAL U300 OR U400 SERIES WALL AND PARTITION DESIGNS IN THE UL FIRE RESISTANCE DIRECTORY AND SHALL INCLUDE THE FOLLOWING CONSTRUCTION FEATURES:

A. STUDS-
WALL FRAMING MAY CONSIST OF EITHER WOOD STUDS OR STEEL CHANNEL STUDS. WOOD STUDS TO CONSIST OF NOM. 2 IN. BY 4 IN. LUMBER SPACED 16 IN. O.C. STEEL STUDS TO BE MIN. 3 1/2 IN. WIDE AND SPACED MAX. 24 IN. O.C.

B. GYPSUM BOARD (BEARING THE UL CLASSIFICATION MARKING)-
THICKNESS, TYPE, NUMBER OF LAYERS AND FASTENERS AS REQUIRED IN THE INDIVIDUAL WALL AND PARTITION DESIGN. MAX. DIAM. OF OPENING IS 5 IN.

THE HOURLY F RATING OF THE FIRESTOP SYSTEM IS EQUAL TO THE HOURLY FIRE RATING OF THE WALL ASSEMBLY IN WHICH IT IS INSTALLED.

2. THROUGH-PENETRANTS
ONE METALLIC PIPE, CONDUIT OR TUBING INSTALLED EITHER CONCENTRICALLY OR ECCENTRICALLY WITHIN THE FIRESTOP SYSTEM. THE ANNULAR SPACE BETWEEN THE PIPE, CONDUIT OR TUBING AND PERIPHERY OF THE OPENING SHALL BE MIN. OF 0 IN. (POINT CONTACT) TO A MAX. 1/8 IN. PIPE, CONDUIT OR TUBING TO BE RIGIDLY SUPPORTED ON BOTH SIDES OF WALL ASSEMBLY. THE FOLLOWING TYPES AND SIZES OF METALLIC PIPES, CONDUITS OR TUBING MAY BE USED:

A. COPPER TUBING-
NOM. 4 IN. DIAM. (OR SMALLER) TYPE M (OR HEAVIER) COPPER TUBING.

B. COPPER PIPE-
NOM. 4 IN. DIAM. (OR SMALLER) REGULAR (OR HEAVIER) COPPER PIPE.

C. STEEL PIPE-
NOM. 4 IN. DIAM. (OR SMALLER) SCHEDULE 5 (OR HEAVIER) STEEL PIPE.

D. CONDUIT-
NOM. 4 IN. DIAM. (OR SMALLER) STEEL ELECTRICAL METALLIC TUBING OR RIGID STEEL CONDUIT


E. IRON PIPE-
NOM. 4 IN. DIAM. (OR SMALLER) CAST OR DUCTILE IRON PIPE.

3. FILL, VOID OR CAVITY MATERIALS (BEARING THE UL CLASSIFICATION MARKING) -
CAULK OR PUTTY-MIN. 1/2 IN. DIAMETER BEAD CAULK OR PUTTY APPLIED CONTINUOUSLY AROUND THE PENETRANT ON THE WALL SURFACES ON BOTH SIDES OF THE WALL.

3M COMPANY - CP 25WB+ CAULK OR MPS-2+ PUTTY

32 THROUGH PENETRATION @ WALL
SCALE: 1 1/2" = 1'-0"

GA FILE NO. RC 2606 1-HOUR FIRE RATED

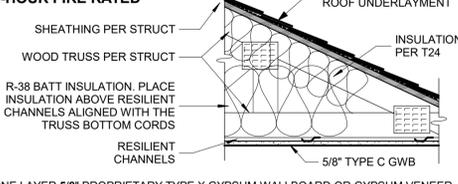


SHEATHING PER STRUCT
WOOD TRUSS PER STRUCT
R-38 BATT INSULATION. PLACE INSULATION ABOVE RESILIENT CHANNELS ALIGNED WITH THE TRUSS BOTTOM CORDS
RESILIENT CHANNELS
ASPHALT SHINGLES OVER ROOF UNDERLAYMENT
INSULATION PER T24
5/8" TYPE C GWB

ONE LAYER 5/8" PROPRIETARY TYPE X GYPSUM WALLBOARD OR GYPSUM VENEER BASE APPLIED AT RIGHT ANGLES TO RESILIENT FIRRING CHANNELS 16" O.C. (12" O.C. WHEN INSULATION IS DRAPED OVER CHANNELS) WITH 1" TYPE S DRYWALL SCREWS 12" O.C. GYPSUM BOARD END JOINTS ATTACHED WITH SCREWS 8" O.C. TO ADDITIONAL PIECES OF CHANNEL 60" LONG LOCATED 3" BACK ON EITHER SIDE OF END JOINT. RESILIENT CHANNELS APPLIED AT RIGHT ANGLES TO BOTTOM CHORD OF PITCHED WOOD TRUSSES 24" O.C. WITH 1/4" TYPE S OR W SCREWS. GLASS FIBER INSULATION SECURED TO WOOD STRUCTURAL PANELS OR DRAPED OVER CHANNELS. TRUSSES SUPPORTING 15/32" WOOD STRUCTURAL PANELS APPLIED AT RIGHT ANGLES TO TRUSSES WITH CONSTRUCTION ADHESIVE AND 6D RING SHANK NAILS 12" O.C. OPTIONAL CEILING DAMPER (REFER TO MANUFACTURER FOR INFORMATION ON THE TYPE OF DAMPER).


PROPRIETARY GYPSUM BOARD
UNITED STATES GYPSUM COMPANY - 5/8" SHEETROCK® BRAND FIRECODE® C CORE GYPSUM PANELS

21 ROOF ASSEMBLY (1-HOUR)
SCALE: 1" = 1'-0"

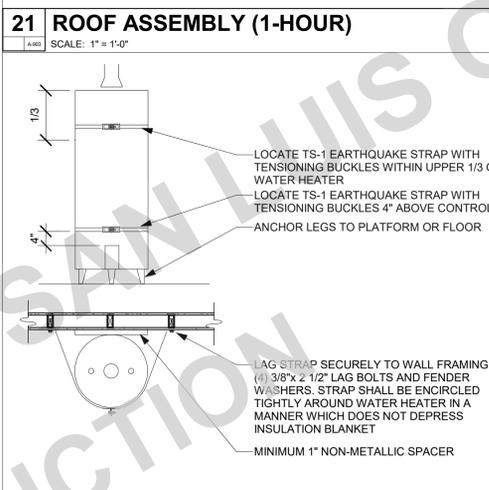

22 WATER HEATER MOUNTING
SCALE: 1 1/2" = 1'-0"

UL DESIGN NO. U 305 REFER TO DETAIL: FOR THROUGH WALL PENETRATIONS

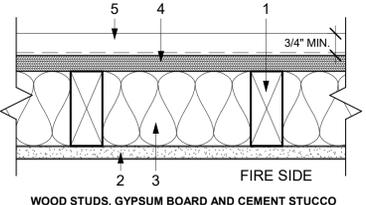

1. WOOD STUDS
NOMINAL 2X6 SPACED 16" O.C. WITH (2) 2X6 TOP PLATES (1) 2X6 BOTTOM PLATE. STUDS LATERALLY-BRACED BY WOOD STRUCTURAL PANEL SHEATHING (ITEM 5) AND EFFECTIVELY FIRE STOPPED AT TOP AND BOTTOM OF WALL.

2. GYPSUM BOARD
ANY CLASSIFIED 5/8" THICK, 48" WIDE, APPLIED VERTICALLY AND NAILED TO STUDS AND BEARING PLATES 7" O.C. WITH 6D CEMENT-COATED NAILS, 1 7/8" LONG WITH 1/4" DIAM. HEAD.

JOINTS AND NAILHEADS (NOT SHOWN) - WALLBOARD JOINTS COVERED WITH TAPE AND JOINT COMPOUND. NAIL HEADS COVERED WITH JOINT COMPOUND.

3. BATTS AND BLANKETS
MINERAL FIBER OR GLASS INSULATION, 3 1/2" THICK. PRESSURE FIT TO FILL WALL CAVITIES BETWEEN STUDS AND PLATES. MINERAL FIBER INSULATION TO BE UNFACED AND TO HAVE A MIN. DENSITY OF 3 PCF. GLASS FIBER INSULATION TO BE FACED WITH ALUMIUM FOIL OR FRAFT PAPER AND TO HAVE A MIN. DENSITY OF 0.9 PCF (MIN. R-13 THERMAL INSULATION RATING). FIBER SPRAYED - AS AN ALTERNATE TO BATTS AND BLANKETS (ITEM 4) - SPRAY APPLIED CELLULOSE INSULATION MATERIAL. THE FIBER IS APPLIED WITH WATER TO COMPLETELY FILL THE ENCLOSED CAVITY IN ACCORDANCE WITH THE APPLICATION INSTRUCTIONS SUPPLIED WITH THE PRODUCT. NOMINAL DRY DENSITY OF 3.0 LB/CU.FT.



4. WOOD STRUCTURAL PANEL SHEATHING
MIN 7/16" THICK, 4 FT. WIDE WOOD STRUCTURAL PANELS, MIN. GRADE "C-D" OR "SHEATHING". INSTALLED WITH LONG DIMENSION OF SHEET (STRENGTH AXIS) OR FACE GRAIN OF PLYWOOD PARALLEL WITH OR PERPENDICULAR TO STUDS. VERTICAL JOINTS CENTERED ON STUDS. HORIZONTAL JOINTS BACKED WITH NOMINAL 2X4 WOOD BLOCKING, ATTACHED TO STUDS ON EXTERIOR SIDE OF WALL WITH 6D CEMENT COATED BOX NAILS SPACED 6" O.C. AT PERIMETER OF PANELS AND 12" O.C. ALONG INTERIOR STUDS.

5. EXTERIOR FACING
INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTION. ONE OF THE FOLLOWING EXTERIOR FACINGS IS TO BE APPLIED OVER THE SHEATHING. REFER TO PLAN FOR INFOEMATION:
FIBER-CEMENT SIDING - FIBER-CEMENT EXTERIOR SIDING INCLUDING SMOOTH AND PATTERNED PANEL OR LAP SIDING.


UL DES U305
AT INTERIOR WALL USE:
5/8" SHEETROCK® FIRECODE CORE PANELS,
5/8" SHEETROCK® ULTRALIGHT PANELS FIRE CODE X OR
5/8" FIBEROCK PANELS
2 X 6 WOOD STUD 16" OR 24" O.C.

24 1-HR EXTERIOR RATED WALL ASSEMBLY
SCALE: 3" = 1'-0"


11 DETAILED HEAD FLASHING
SCALE: 12" = 1'-0"

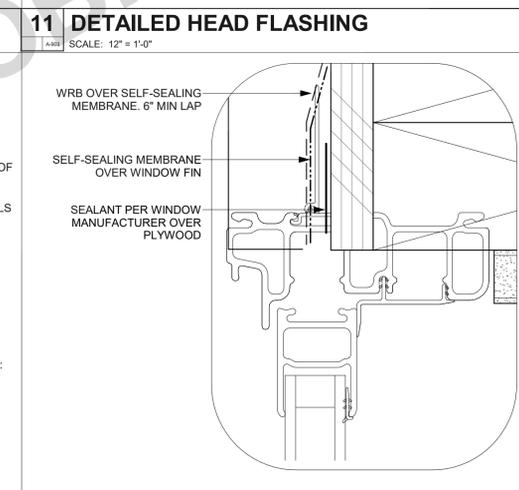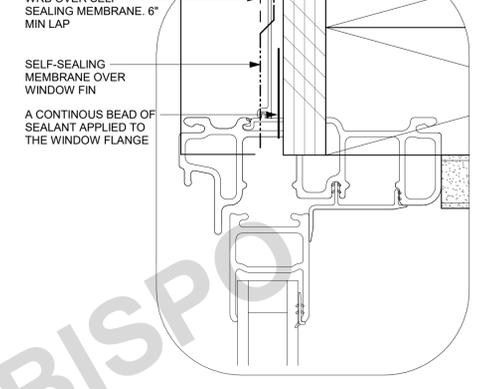

12 DETAILED JAMB FLASHING
SCALE: 12" = 1'-0"

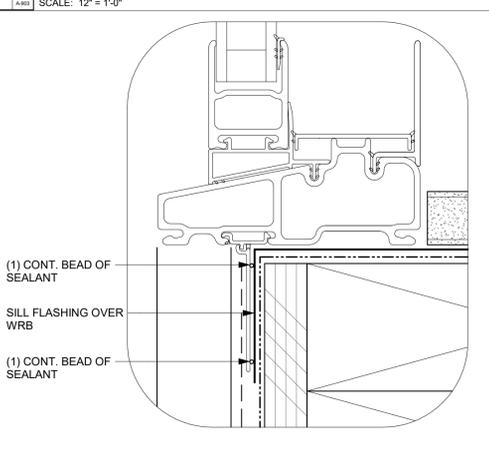

13 DETAILED SILL FLASHING
SCALE: 12" = 1'-0"

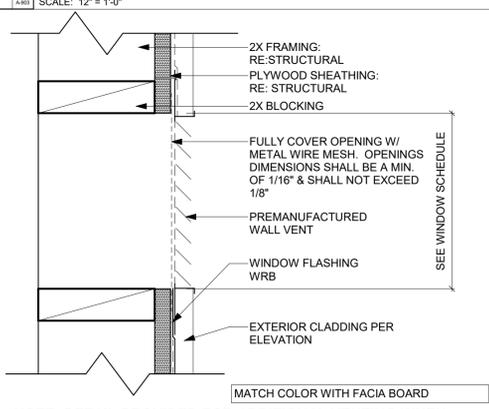

NOTE: DETAIL PROVIDED FOR ADDITIONAL VENTING WHEN REQUIRED BY SPECIAL CIRCUMSTANCES

14 WALL VENT
SCALE: 3" = 1'-0"


COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA
ARCHITECTURAL DETAILS

APPROVED SET

DATE
09/28/2023
SHEET

A-903

FOR USE IN THE COUNTY OF SAN LUIS OBISPO NOT FOR CONSTRUCTION



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONSTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

LNC - MODERN FROSTED BLACK PORCH OUTER WALL SCONCE WITH MUSHROOM CLEAR SEEDED GLASS SHADE (VAFNYAHD13356V6) OR EQUAL

FRONT SIDE ABOVE




LIGHT OPTION A

LUTEC - BLACK SOLAR OUTDOOR BARN LIGHT SCONCE WITH DUSK TO DAWN (6940002012) OR EQUAL

FRONT SIDE ABOVE

LIGHT OPTION B

NOTE: ALL EXTERIOR LIGHTING MUST BE DARK SKY COMPLIANT PER ZONING REGULATIONS SECTION 17.70.100.


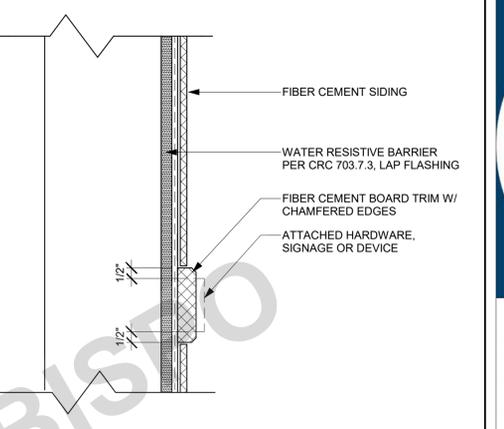
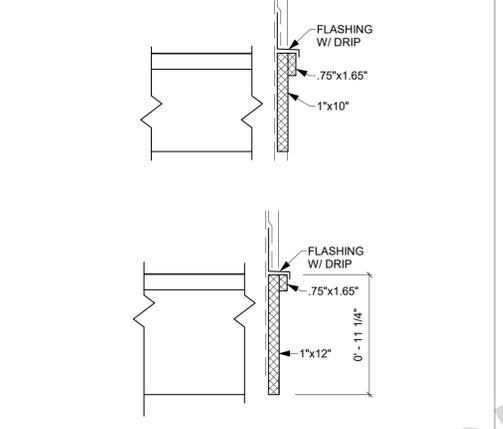
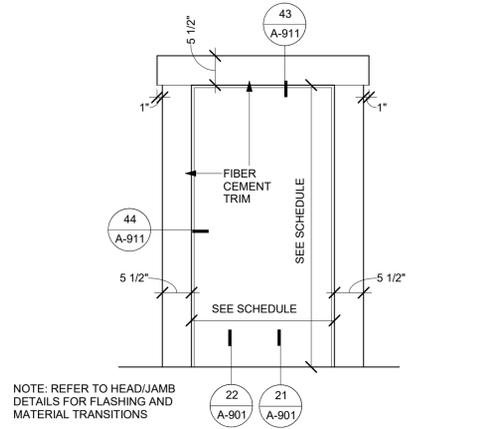


41 TYP. LIGHT FIXTURES
SCALE: 1 1/2" = 1'-0"

31 DOOR TRIM
SCALE: 3/4" = 1'-0"

21 TRIM PROFILES
SCALE: 1 1/2" = 1'-0"

11 TYP. MOUNTIN PAD
SCALE: 3" = 1'-0"

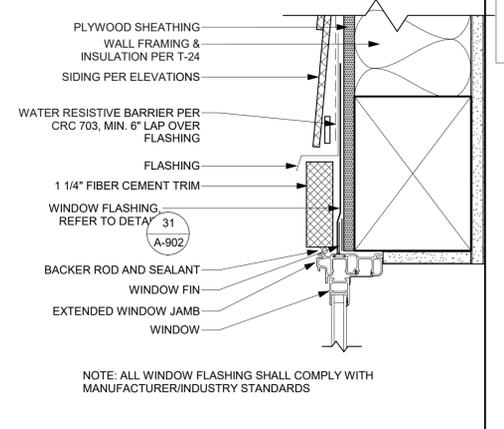
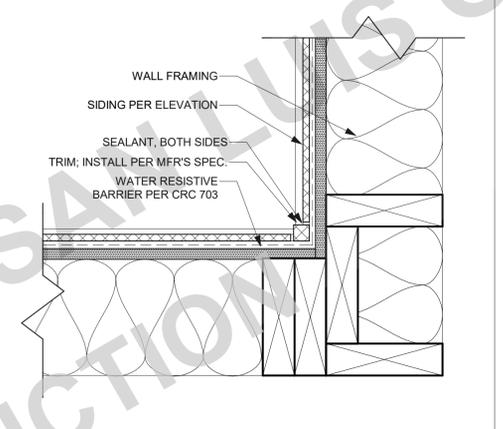
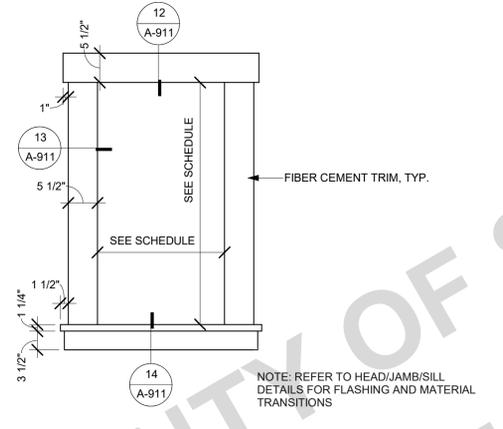
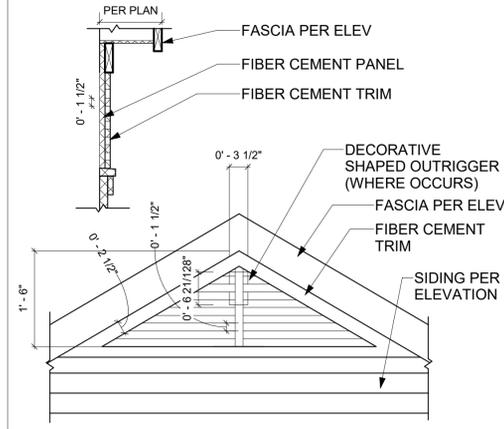


42 DECORATIVE FAUX GABLE VENT (OPT.)
SCALE: 3/4" = 1'-0"

32 WINDOW TRIM
SCALE: 3/4" = 1'-0"

22 TYP. INSIDE CORNER
SCALE: 3" = 1'-0"

12 TYP. WINDOW HEAD
SCALE: 3" = 1'-0"

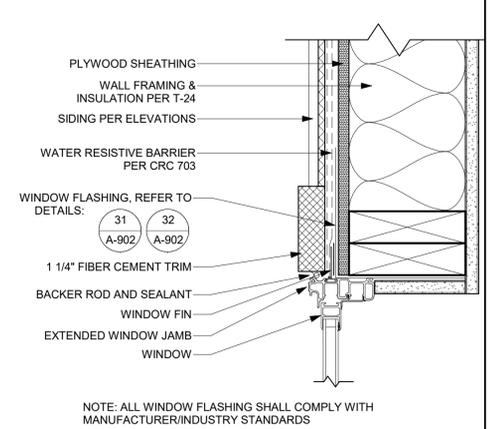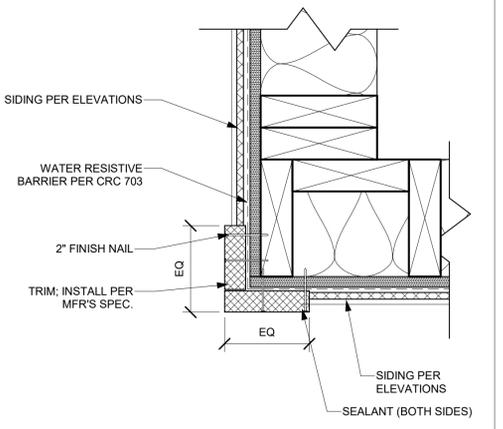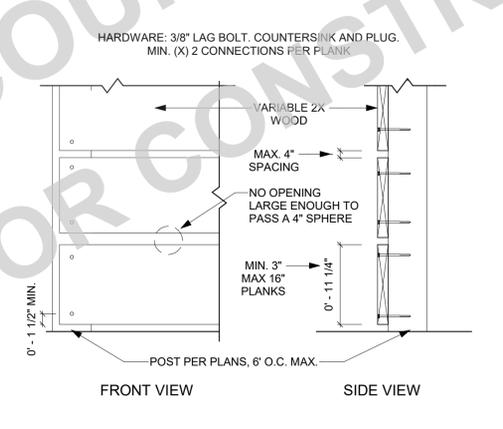
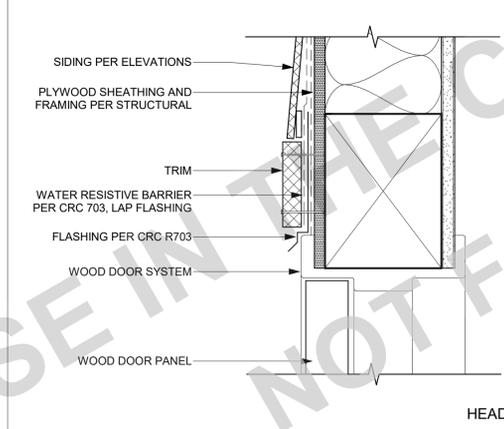


43 TYP. DOOR HEAD
SCALE: 3" = 1'-0"

33 SCREENING ELEMENT
SCALE: 1" = 1'-0"

23 TYP. OUTSIDE CORNER
SCALE: 3" = 1'-0"

13 TYP. WINDOW JAMB
SCALE: 3" = 1'-0"

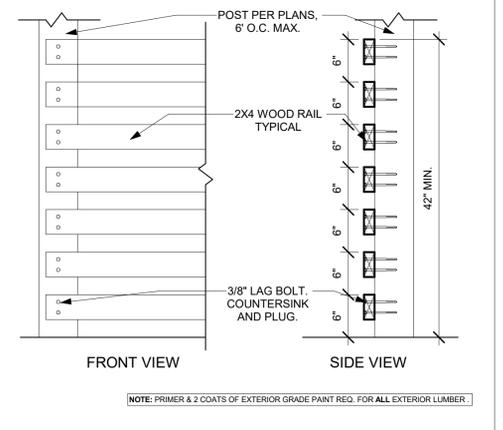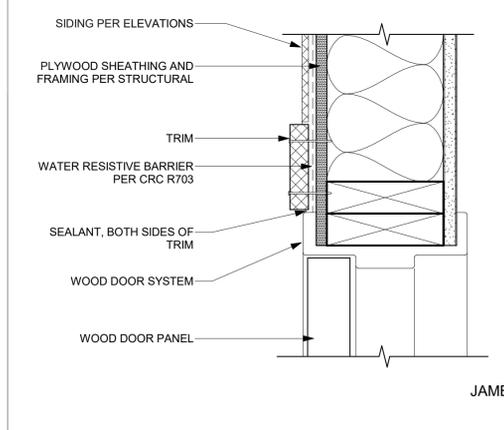

44 TYP. DOOR JAMB
SCALE: 3" = 1'-0"

24 DECORATIVE PORCH RAILING
SCALE: 1" = 1'-0"

14 TYP. WINDOW SILL
SCALE: 3" = 1'-0"


COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA

ARCHITECTURAL DETAILS


APPROVED SET

DATE
09/28/2023


SHEET
A-911




THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

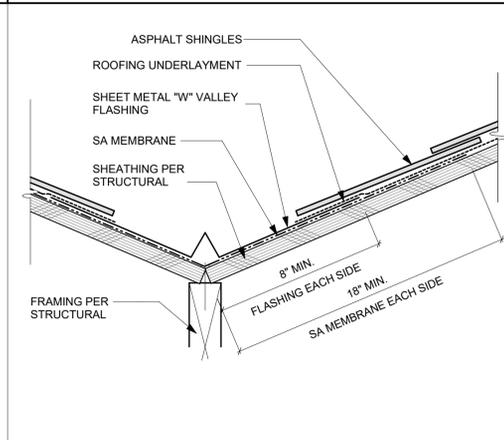


41 TYPICAL VALLEY DETAIL
SCALE: 3" = 1'-0"

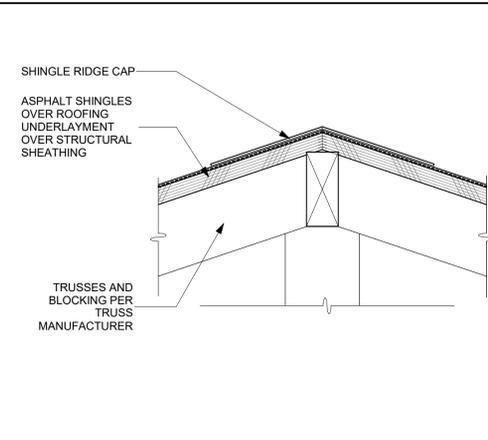

31 TYPICAL RIDGE/HIP DETAIL
SCALE: 3" = 1'-0"

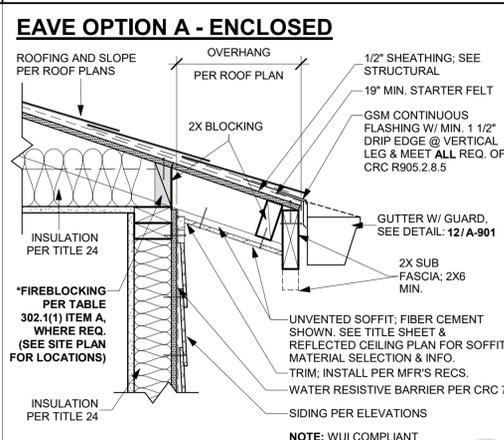


21 TYP. EAVE
SCALE: 1 1/2" = 1'-0"

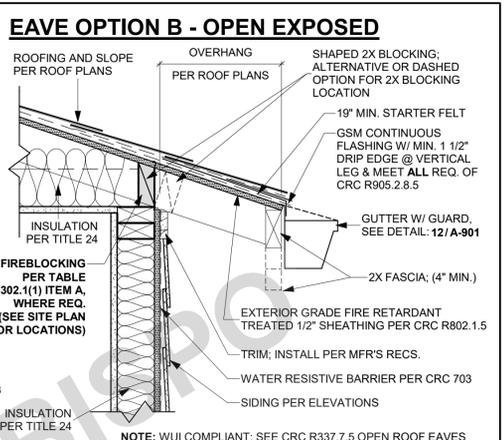


NOTE: WUI COMPLIANT; SEE CRC R337.7.5 OPEN ROOF EAVES




32 O'HAGEN ROOF VENT
SCALE: 3" = 1'-0"

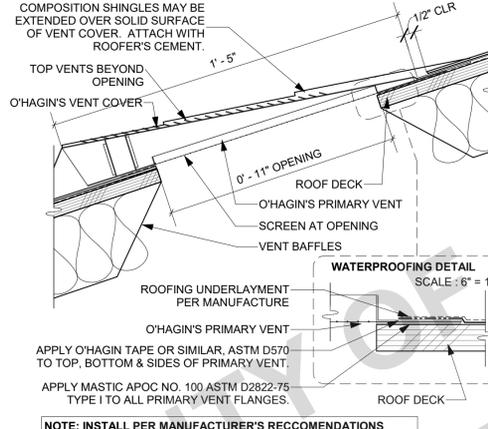

22 TYP. RAKE
SCALE: 1 1/2" = 1'-0"

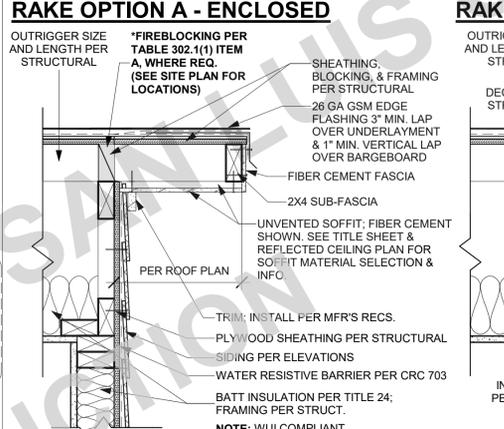

NOTE: WUI COMPLIANT; SEE CRC R337.7.5 OPEN ROOF EAVES

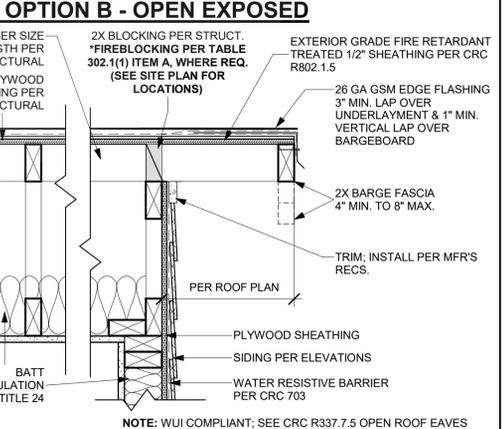


13 HEADWALL
SCALE: 3" = 1'-0"




24 DECORATIVE OUTRIGGER
SCALE: 1 1/2" = 1'-0"



14 SIDE WALL
SCALE: 3" = 1'-0"

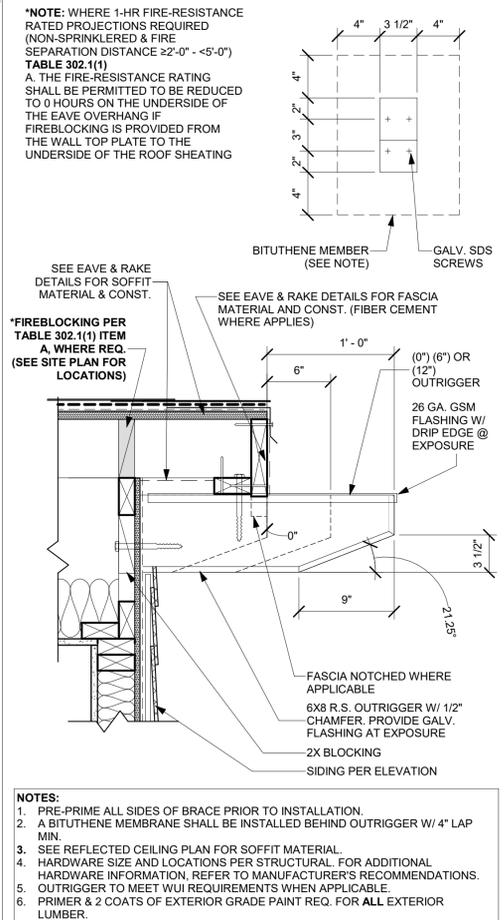

NOTE: WUI COMPLIANT

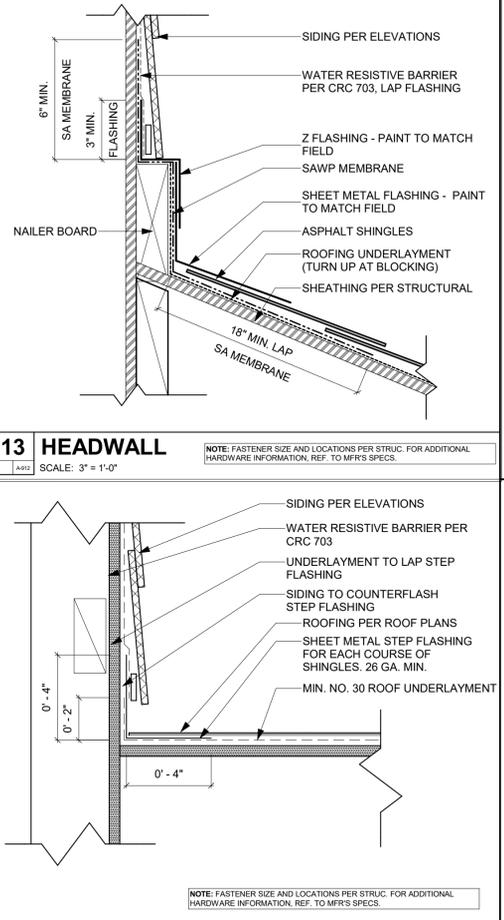

NOTE: WUI COMPLIANT; SEE CRC R337.7.5 OPEN ROOF EAVES

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA

ARCHITECTURAL DETAILS - ROOF

APPROVED SET

DATE
09/28/2023

SHEET
A-912

FOR USE IN THE COUNTY OF SAN LUIS OBISPO
NOT FOR CONSTRUCTION

SYMBOLS

WALL TYPES

SHEET INDEX

| | | | | | |
|--|-------------------------------------|--|---|--|--|
| | DETAIL REFERENCE BUBBLE WITH LEADER | | INDICATES SHEAR WALL TYPE AND LENGTH. PER SHEAR WALL SCHEDULE | | INDICATES TOP PLATE SPLICE NAILING PER SCHEDULE |
| | DETAIL REFERENCE BUBBLE | | INDICATES SPAN AND DIRECTION OF PREFABRICATED ROOF TRUSS (BY OTHERS) | | INDICATES SHEAR WALL STRAP / HOLD-DOWN TYPE PER SCHEDULE |
| | FULL HEIGHT SECTION INDICATOR | | INDICATES SPAN AND DIRECTION OF ROOF RAFTER OR FLOOR JOIST WITH WEB STIFFENER | | INDICATES PAD FOOTING TYPE PER SCHEDULE |
| | ELEVATION OF WALL OR FRAME | | INDICATES SPAN AND DIRECTION OF ROOF RAFTER OR FLOOR JOIST | | INDICATES CONTINUOUS FOOTING TYPE PER SCHEDULE |
| | NORTH ARROW | | INDICATES EXTENTS OF FRAMING OR OTHER STRUCTURAL ELEMENT | | ANGLE BRACE |
| | TOP/BOTTOM OF ELEVATIONS | | INDICATES HEADER @ OPENING PER HEADER SCHEDULE | | DOUBLE ANGLE BRACE |
| | SLOPE | | EARTH LAYER | | DRAG STRUT CONNECTION |
| | WELDED WIRE FABRIC (WWF LAYER) | | INDICATES SAND OR GROUT | | FULL HEIGHT STIFFENER CONNECTION |
| | STEPPED SURFACE: FLOOR DEPRESSION | | INDICATES GRAVEL | | MOMENT CONNECTION |
| | SLOPED SURFACE | | STEEL IN CROSS SECTION | | MEMBER SPLICE |
| | STEPPED FOOTING | | INDICATES BEARING WALL | | TOP OF STEEL ± ELEVATION |
| | BOTTOM STEPPED FOOTING | | SHADED AREA INDICATES CALIFORNIA FRAMING | | NUMBER OF EVENLY SPACED SHEAR STUDS |
| | | | SHADED AREA INDICATES FOOTPRINT OF FLOOR ABOVE | | SPECIAL STUD SPACING SEE TYPICAL STEEL DETAILS |
| | | | STEEL HSS TUBE COLUMN | | BEAM CAMBER AT MID-SPAN |
| | | | STEEL HSS OR PIPE COLUMN | | |
| | | | WIDE FLANGE STEEL COLUMN | | |
| | | | WOOD POST | | |

| | |
|--|--|
| | INDICATES PLYWOOD SIDE FOR SHEAR WALL |
| | INDICATES BEARING WOOD WALL BELOW |
| | INDICATES BEARING WOOD WALL ABOVE |
| | INDICATES NON-BEARING WOOD WALL BELOW |
| | INDICATES NON-BEARING WOOD WALL ABOVE |
| | INDICATES EXISTING BEARING WOOD WALL |
| | INDICATES EXISTING NON-BEARING WOOD WALL |
| | INDICATES BEARING CMU WALL BELOW |
| | INDICATES BEARING CMU WALL ABOVE |
| | INDICATES NON-BEARING CMU WALL BELOW |
| | INDICATES NON-BEARING CMU WALL ABOVE |
| | INDICATES EXISTING BEARING CMU WALL |
| | INDICATES EXISTING NON-BEARING CMU WALL |
| | INDICATES BEARING CONCRETE WALL BELOW |
| | INDICATES BEARING CONCRETE WALL ABOVE |
| | INDICATES NON-BEARING CONCRETE WALL BELOW |
| | INDICATES NON-BEARING CONCRETE WALL ABOVE |
| | INDICATES EXISTING BEARING CONCRETE WALL |
| | INDICATES EXISTING NON-BEARING CONCRETE WALL |

| | |
|-------|---|
| S-101 | SHEET INDEX, ABBREVIATION & SYMBOLS |
| S-102 | GENERAL NOTES |
| S-103 | GENERAL NOTES, SPECIAL INSPECTION & TESTS |
| S-201 | FOUNDATION PLAN - MID CENTURY MODERN |
| S-202 | ROOF FRAMING PLAN - MID CENTURY MODERN |
| S-301 | TYPICAL CONCRETE DETAILS |
| S-311 | CONCRETE DETAILS |
| S-312 | CONCRETE DETAILS |
| S-401 | TYPICAL WOOD DETAILS |
| S-402 | TYPICAL WOOD DETAILS |
| S-403 | TYPICAL WOOD DETAILS |
| S-404 | TYPICAL WOOD DETAILS |
| S-421 | ROOF FRAMING DETAILS |
| S-422 | ROOF FRAMING DETAILS |

ABBREVIATIONS

| | | | | | | | | | |
|-----------|---|--------------|-------------------------|------------|----------------------------------|------------|--------------------------------|------------|------------------------------|
| A & B | ABOVE AND BELOW | d | PENNY (NAIL OR BAR DIA) | HDR | HEADER | PA | POST ABOVE | T & B | TOP AND BOTTOM |
| AB | ANCHOR BOLT | DBL | DOUBLE | HGR | HANGER | PARA OR // | PARALLEL | T & G | TONGUE & GROOVE |
| ABV | ABOVE | DEPT | DEPTH | HP | HIGH POINT | PC | PRECAST PIECE | TO | TOP OF |
| ACI | AMERICAN CONCRETE INSTITUTE | DET | DETAIL | HSR | HORIZONTALLY SLOTTED HOLES | PERP | PERPENDICULAR | TOC | TOP OF CURB; TOP OF CONCRETE |
| ADDL | ADDITIONAL | DF | DOUGLAS FIR/LARCH | HT | HEIGHT | PLY | PLYWOOD INDEX | TOF | TOP OF FOOTING |
| ADJ | ADJACENT | DIA OR Ø | DIAMETER | ID | INSIDE DIAMETER | R OR PL | PLATE | TEMP | TEMPERATURE: TEMPORARY |
| AESS | ARCHITECTURAL EXPOSED STRUCTURAL STEEL | DIAG | DIAPHRAGM | IF | INSIDE FACE | PL | PROPERTY LINE | THRU | THROUGH |
| AISC | AMERICAN INSTITUTE OF STEEL CONSTRUCTION | DIAPH | DIAPHRAGM | I-JST | I-JOIST | PLF | PONDS PER LINEAL FOOT | THK | THICKNESS/HICK |
| ALT | ALTERNATE | DIM | DIMENSION | IN | INCH | PLCS | PLACES | THR | THREADED |
| ALUM | ALUMINIUM | DN | DOWN | INCL | INCLUDE | PLY | PLYWOOD | TOP or 1 | TOP |
| ANCH | ANCHOR | DO | DO COVER | INFO | INFORMATION | PROP | PROPERTY | TOS | TOP OF STEEL/TOP OF SLAB |
| ANSI | AMERICAN NATIONAL STANDARDS INSTITUTE | DWG | DRAWING | INSP | INSPECTION | PT | PRESSURE TREATED | TOW | TOP OF WALL |
| APA | ENGINEERED WOOD ASSOCIATION [FORMERLY THE AMERICAN PLYWOOD ASSOCIATION] | DWL | DOWEL | INT | INTERIOR | PW | PLATE WASHER | TS | TRIMMER STUD |
| APPVD | APPROVED | EA | EACH | JST | JOIST | PJP | PARTIAL JOINT PENETRATION WELD | TYP | TYPICAL |
| APPROX | APPROXIMATE | EF | EACH FACE | JT | JOINT | PREFAB | PREFABRICATED | UNO | UNLESS NOTED OTHERWISE |
| ARCH | ARCHITECTURAL; ARCHITECT | EJ | EXPANSION JOINT | K | KIPS | PSF | POUNDS PER SQUARE FOOT | UT | ULTRA-SONIC TEST |
| AWPA | AMERICAN WOOD PRESERVERS ASSOCIATION | EL | ELEVATION | KS | KING STUD | PSI | POUNDS PER SQUARE INCH | VERT | VERTICAL |
| AWS | AMERICAN WELDING SOCIETY | ELEC | ELECTRICAL | KP | KING POST | PSL | PARALLEL STRAND LUMBER | VSH | VERTICAL SLOTTED HOLES |
| AITC | AMERICAN INSTITUTE OF TIMBER CONSTRUCTION | ELEV | ELEVATOR | KSI | KIPS PER SQUARE INCH | PVMT | PAVEMENT | W/ | WITH |
| ASTM | AMERICAN SOCIETY FOR TESTING MATERIALS | EMBED | EMBEDMENT | LB(S) OR # | POUND(S) | # | POUND; NUMBER | W/O | WITHOUT |
| BLDG | BUILDING | EN | EDGE NAIL | LN | LINEAL FOOT | REF | REFERENCE | WO | WHERE OCCURS |
| BLK | BLOCK | ENGR | ENGINEER | LH | LINEAL: LINEAR | REINF | REINFORCE: REINFORCING | WD | WOOD |
| BLKG | BLOCKING | EQ | EQUAL OR EQUIVALENT | LLH | LONG LEG HORIZONTAL | REQD | REQUIRED | WP | WORK POINT; WATERPROOF |
| BM | BEAM | EQUIP | EQUIPMENT | LLV | LONG LEG VERTICAL | RF | ROOF | WWF | WELDED WIRE FABRIC |
| BN | BOUNDARY NAIL | ES | EACH SIDE | LP | LOW POINT | RR | ROOF RAFTER | | |
| BOT OR B | BOTTOM | EW | EACH WAY | LSH | LONG SLOTTED HOLES | Ø | ROUND; DIAMETER | | |
| BRC | BRACE | EXIST or [E] | EXISTING | LSL | LAMINATED STRAND LUMBER | SCHED | SCHEDULE | W | W SHAPE |
| BRG | BEARING | EXT | EXTERIOR | LT WT | LIGHTWEIGHT | SEC | SCHEDULE SECTION | C | AMERICAN STD CHANNEL SHAPE |
| BTWN | BETWEEN | FDN | FOUNDATION | LVL | LEVEL OR LAMINATED VENEER LUMBER | SEP | SEPARATION | MC | MISC CHANNEL SHAPE |
| CANT | CANTILEVER | FIN | FINISH | MAS | MASONRY | SHT | SHEET | L | ANGLE SHAPE |
| CAMR OR C | CAMBER | FJ | FLOOR JOIST | MATL | MATERIAL | SHTG | SHEATHING | WT, ST, MT | STRUCT TEE SHAPE |
| CC | CENTER TO CENTER | FLG | FLANGE | MAX | MAXIMUM | SIM | SMILAR | PIPE | STANDARD PIPE SHAPE |
| CG | CENTER OF GRAVITY | FLR | FLOOR | MB | MACHINE BOLT | SOG | SLAB ON GRADE | PIPE-X | EXTRA STRONG PIPE SHAPE |
| CP | CAST-IN-PLACE | FN | FIELD NAIL | MECH | MECHANICAL | SN | SHEAR NAIL | PIPE-XX | DBL EXTRA STRONG PIPE SHAPE |
| CJ | CONSTRUCTION JOINT; CONTROL JOINT | FOC | FACE OF CONCRETE | MFR | MANUFACTURER | SPCG | SPACING | HSS | HOLLOW STRUCTURAL SECTION |
| CL | CENTER LINE | FOM | FACE OF MASONRY | MIN | MINIMUM; MINUTE | SPECS | SPECIFICATIONS | | |
| CLR | CLEARANCE; CLEAR | FOS | FACE OF STUD | MISC | MISCELLANEOUS | SQ | SQUARE | | |
| CMU | CONCRETE MASONRY UNIT | FOV | FACE OF WALL | [N] | NEW | SS | STAINLESS STEEL | | |
| COL | COLUMN | FRMG | FRAMING | N | NORTH | SSL | SHORT SLOTTED HOLES | | |
| COMP | COMPRESSION | FT | FOOT; FEET | NO or # | NUMBER | STD | STANDARD | | |
| CONC | CONCRETE | FTA | FLOOR TIE ABOVE | NTS | NOT TO SCALE | STGR | STAGGER | | |
| CONN | CONNECTION; CONNECT | FTG | FOOTING | OC | ON CENTER | STIFF | STIFFENERS | | |
| CONSTR | CONSTRUCTION | GA | GAUGE | OD | OUTSIDE DIAMETER | STIRR | STIRRUP | | |
| CONT | CONTINUE; CONTINUOUS | GALV | GALVANIZED | OF | OUTSIDE FACE | STL | STEEL | | |
| CONTR | CONTRACTOR | GB | GRADE BEAM | OH | OPPOSITE HAND | STRUCT | STRUCTURAL | | |
| CJP | COMPLETE JOINT PENETRATION WELD | GLB | GLUED LAMINATED BEAM | OPNG | OPENING | SW | SHEAR WALL | | |
| CTR | CENTER | GR | GRADE | OPP | OPOSITE | SYM | SYMMETRICAL | | |
| CTS&K | COUNTERSINK; COUNTERSUNK | GRND | GROUND | ORIG | ORIGINAL | TB | TIE BEAM | | |
| CU FT | CUBIC FOOT | H or HORIZ | HORIZONTAL | OSB | ORIENTED STRAND BOARD | | | | |



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONSTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

COUNTY OF SAN LUIS OBISPO
 ACCESSORY DWELLING UNIT
 SAN LUIS OBISPO, CA
 SHEET INDEX,
 ABBREVIATION & SYMBOLS

N:\2000\2727-01\cuz29-alc-county\adul\structural\ConDoc\Sheet\Plan_3\mid century\2727-01_CUZ27-110.dwg, PL AN 3-110, Sep 28, 2023, 4:37pm, dlpent



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRACT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT

SAN LUIS OBISPO, CA

GENERAL NOTES

DATE
09/28/2023

SHEET

S-102

GENERAL

- ALL WORK SHALL CONFORM TO THE MINIMUM STANDARDS OF THE FOLLOWING CODES AND STANDARDS:
 - 2022 CALIFORNIA BUILDING CODE, PART 2, VOLUME 2 OF 2, AND TITLE 24 C.C.R. 2022 EDITION AND LATEST REGULATIONS (INCLUDING SUPPLEMENTS AND ERRATA) HEREIN REFERRED TO AS "THE CODE".
 - ANY OTHER REGULATING AGENCIES WHICH HAVE AUTHORITY OVER ANY PORTION OF THE WORK, INCLUDING THE STATE OF CALIFORNIA DIVISION OF OCCUPATIONAL SAFETY AND HEALTH (CAL/OSHA).
 - CODES & STANDARDS REFERENCED IN THE CODE OR LISTED IN THESE NOTES AND SPECIFICATIONS.
- ALL DRAWINGS ARE CONSIDERED TO BE A PART OF THE CONTRACT DOCUMENTS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REVIEW AND COORDINATION OF ALL DRAWINGS AND SPECIFICATIONS PRIOR TO THE START OF CONSTRUCTION. ANY DISCREPANCIES THAT OCCUR SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT PRIOR TO START OF CONSTRUCTION SO THAT A CLARIFICATION CAN BE ISSUED. ANY WORK PERFORMED IN CONFLICT WITH THE CONTRACT DOCUMENTS OR ANY CODE REQUIREMENTS SHALL BE CORRECTED BY THE CONTRACTOR AT THEIR OWN EXPENSE AND AT NO EXPENSE TO THE OWNER OR ARCHITECT.
- NOTES AND DETAILS ON DRAWINGS SHALL TAKE PRECEDENCE OVER GENERAL NOTES AND TYPICAL DETAILS, WHERE NO DETAILS ARE GIVEN. CONSTRUCTION SHALL BE AS SHOWN FOR SIMILAR WORK.
- THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS PRIOR TO STARTING CONSTRUCTION. THE ARCHITECT SHALL BE NOTIFIED OF ANY DISCREPANCIES OR INCONSISTENCIES. IN NO INSTANCE SHALL DIMENSIONS BE SCALED FROM THE DRAWINGS.
- SEE ARCHITECTURAL DRAWINGS FOR THE FOLLOWING:
 - SIZE AND LOCATION OF ALL DOOR AND WINDOW OPENINGS, EXCEPT AS NOTED
 - SIZE AND LOCATION OF ALL INTERIOR AND EXTERIOR NON-BEARING PARTITIONS UNLESS NOTED AND/OR DETAILED ON THE STRUCTURAL DRAWINGS
 - SIZE AND LOCATION OF ALL CONCRETE CURBS, EQUIPMENT PADS, PITS, FLOOR DRAINS, SLOPES, DEPRESSED AREAS, CHANGE IN LEVEL, CHAMFERS, GROOVES, INSERTS, ETC
 - SIZE AND LOCATION OF ALL FLOOR AND ROOF OPENINGS EXCEPT AS SHOWN
 - FLOOR AND ROOF FINISHES
 - MISCELLANEOUS DRAINAGE AND WATERPROOFING
 - ALL FIREPROOFING REQUIREMENTS INCLUDING FIREPROOFING OF STRUCTURAL STEEL
 - DIMENSIONS NOT SHOWN ON STRUCTURAL DRAWINGS
- SEE MECHANICAL, PLUMBING AND ELECTRICAL DRAWINGS FOR THE FOLLOWING:
 - PIPE RUNS, SLEEVES, HANGERS, TRENCHES, WALL AND SLAB OPENINGS, ETC., EXCEPT AS SHOWN OR NOTED.
 - ELECTRICAL CONDUIT RUNS, BOXES, OUTLETS IN WALLS AND SLABS.
 - CONCRETE INSERTS FOR ELECTRICAL, MECHANICAL OR PLUMBING FIXTURES.
 - SIZE AND LOCATION OF MACHINE OR EQUIPMENT BASES, ANCHOR BOLTS FOR MOTOR MOUNTS.
- SEE CIVIL DRAWINGS FOR THE FOLLOWING:
 - HEIGHT AND/OR ELEVATION OF:
 - FINISHED SURFACE
 - TOP OF WALL
 - TOP OF GRADE
 - FINISHED GRADE
 - SLOPE
 - SITE CONCRETE WALKWAYS, CURBS & PAVING
- THE CONTRACT STRUCTURAL DRAWINGS AND SPECIFICATIONS REPRESENT THE FINISHED STRUCTURE. THEY DO NOT INDICATE THE METHOD OF CONSTRUCTION. THE CONTRACTOR SHALL PROVIDE ALL MEASURES NECESSARY TO PROTECT THE STRUCTURE DURING CONSTRUCTION. SUCH MEASURES SHALL INCLUDE, BUT NOT BE LIMITED TO, BRACING, SHORING FOR LOADS DUE TO CONSTRUCTION EQUIPMENT ETC. THE CONTRACTOR IS RESPONSIBLE FOR PROVISION OF TEMPORARY SHORING AND OTHER CONSTRUCTION AIDS, INCLUDING ALL ENGINEERING OF SUCH SYSTEMS, FOR TEMPORARY SUPPORT OF NEW AND/OR EXISTING STRUCTURAL ELEMENTS AS REQUIRED FOR ERECTION AND OTHER CONTRACTORS MEANS AND METHODS OF CONSTRUCTION (UNO). OBSERVATION VISITS TO THE SITE BY THE STRUCTURAL ENGINEER SHALL NOT INCLUDE INSPECTION OF THE ABOVE ITEMS OR CONCERN CONSTRUCTION MEANS AND METHODS OR CONSTRUCTION SAFETY.
- BACKFILL SHALL NOT BE PLACED BEHIND EXTERIOR AND INTERIOR RETAINING WALLS UNTIL THE CONCRETE / CMU HAS ACHIEVED FULL DESIGN STRENGTH. FOR BRACED WALLS SUPPORTED BY STRUCTURAL DIAPHRAGMS, BACKFILL SHALL NOT BE PLACED BEHIND THE WALL UNTIL THE DIAPHRAGM HAS BEEN INSTALLED, AND FOR CONCRETE DIAPHRAGMS, HAS ACHIEVED FULL DESIGN STRENGTH.
- THE CONTRACT STRUCTURAL DRAWINGS SHOW THE BUILDING IN ITS FINAL INTENDED POSITION. CONTRACTOR SHALL MAKE PROVISIONS IN THE LAYOUT OF THE BUILDING TO TAKE INTO ACCOUNT SHRINKAGE, CREEP, SHORTENING, ETC.
- ASTM SPECIFICATIONS ON THE DRAWINGS SHALL BE THE VERSION REFERENCED IN CHAPTER 35 OF THE CODE OR AS REFERENCED IN THE APPLICABLE DESIGN STANDARD.
- CONTRACTOR SHALL INVESTIGATE SITE DURING CLEARING AND EARTHWORK OPERATIONS FOR FILLED EXCAVATIONS OR BURIED STRUCTURES, SUCH AS CESSPOOLS, CISTERNS, FOUNDATIONS, ETC. IF ANY SUCH STRUCTURES ARE FOUND, THE STRUCTURAL ENGINEER AND GEOTECHNICAL ENGINEER SHALL BE NOTIFIED IMMEDIATELY.
- CONSTRUCTION MATERIAL SHALL BE SPREAD OUT IF PLACED ON FRAMED ROOF OR FLOOR. LOAD SHALL NOT EXCEED THE DESIGN LIVE LOAD PER SQUARE FOOT. THE CONTRACTOR TO INSURE AND PROVIDE ADEQUATE SHORING AND/OR BRACING WHERE STRUCTURE HAS NOT ATTAINED DESIGN STRENGTH.
- CONTRACTOR SHALL COORDINATE SHORING WITH DRAWINGS OF RECORD TO INSURE PROVISIONS FOR POCKETS, BLOCKOUTS, OFFSETS, STEPPED FOOTINGS AND ANY OTHER ITEMS AFFECTED BY THE SHORING
- AN UNDERGROUND SERVICE ALERT INQUIRY IDENTIFICATION NUMBER MUST BE OBTAINED AT LEAST TWO WORKING DAYS BEFORE STARTING WORK WITH THIS PERMIT.
 - FOR PROJECTS IN SOUTHERN CALIFORNIA TELEPHONE NO. 1-800-422-4133.
 - FOR PROJECTS IN NORTHERN CALIFORNIA TELEPHONE NO. 1-800-227-2600.
- EDGE OF SLAB DIMENSIONS TO BE COORDINATED AND VERIFIED BY THE GENERAL CONTRACTOR PRIOR TO FABRICATION.

DIMENSIONS

- DIMENSIONS SHALL BE DEFINED TO INCLUDE BOTH HORIZONTAL DIMENSIONS AND VERTICAL DIMENSIONS (ELEVATIONS).
- WRITTEN DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALED DRAWINGS.
- SEE ARCHITECTURAL DRAWINGS FOR DIMENSION NOT NOTED ON STRUCTURAL ENGINEER WHEN DRAWINGS ARE FOUND, THE STRUCTURAL ENGINEER AND GEOTECHNICAL ENGINEER SHALL BE NOTIFIED IMMEDIATELY.
- SEE ARCHITECTURAL AND/OR CIVIL DRAWINGS FOR FINISH FLOOR ELEVATIONS.
- SEE ARCHITECTURAL DRAWINGS FOR ALL TOP OF SHEATHING AND/OR ROOF ELEVATIONS.
- THE CONTRACTOR SHALL REVIEW AND VERIFY ALL DIMENSIONS PRIOR TO STARTING CONSTRUCTION. THE ARCHITECT SHALL BE NOTIFIED IMMEDIATELY OF ANY DISCREPANCIES OR INCONSISTENCIES.

DESIGN INFORMATION

FLOOR LIVE LOADS (2022 CBC SECTION 1603.1.1)

| OCCUPANCY OR USE | UNIFORM (PSF) | CONC. (LBS) | REFERENCE |
|---|----------------------|-------------|-----------------------|
| RESIDENTIAL ONE- AND TWO- FAMILY DWELLINGS UNINHABITABLE ATTICS WITHOUT STORAGE UNINHABITABLE ATTICS WITH STORAGE HABITABLE ATTICS AND SLEEPING AREAS ALL OTHER AREAS | 10 20 30 40 | — | 2022 CBC TABLE 1607.1 |

ROOF LIVE LOADS (2022 CBC SECTION 1603.1.2)

| OCCUPANCY OR USE | UNIFORM (PSF) | CONC. (LBS) | REFERENCE |
|--|---------------|-------------|-----------------------|
| ROOF ORDINARY FLAT, PITCHED AND CURVED ROOFS (THAT ARE NOT OCCUPIABLE) | 20 | — | 2022 CBC TABLE 1607.1 |

SNOW DESIGN DATA (2022 CBC SECTION 1603.1.3)

| PARAMETER | VALUE | REFERENCE |
|------------------|------------------------|---------------|
| GROUND SNOW LOAD | P _g = 0 PSF | ASCE 7-16 7.2 |

WIND DESIGN DATA (2022 CBC SECTION 1603.1.4)

| PARAMETER | VALUE | REFERENCE |
|---|---------------------------|-------------------------|
| ULTIMATE DESIGN WIND SPEED (3-SEC GUST) | V _{ult} = 92 MPH | 2022 CBC FIG. 1609.3 |
| NOMINAL DESIGN WIND SPEED (3-SEC GUST) | V _{nd} = 72 MPH | 2022 CBC 1609.3.1 |
| EXPOSURE CATEGORY | C | 2022 CBC 1609.4.3 |
| INTERNAL PRESSURE COEFFICIENT: | GCPi = ± 0.18 | ASCE 7-16 TABLE 26.13-1 |

COMPONENTS & CLADDING WIND PRESSURES (PSF)

| LOCATION | ZONE | COMPONENT TRIBUTARY AREA (SQ FT) | | |
|----------|-----------|----------------------------------|-------|-------|
| | | 10 | 100 | 500 |
| ROOF | ZONE 1 | -31.0 | -16.0 | -16.0 |
| | ZONE 2a | -31.0 | -16.0 | -16.0 |
| | ZONE 2b | -34.1 | -21.6 | -18.4 |
| | ZONE 2c | -31.0 | -16.0 | -16.0 |
| | ZONE 3a | -41.9 | -26.3 | -18.4 |
| | ZONE 3b | -34.1 | -21.6 | -18.4 |
| OVERHANG | ALL ZONES | 16.9 | 16.0 | 16.0 |
| | ZONE 1 | -43.5 | -27.8 | -27.8 |
| | ZONE 2a | -43.5 | -27.8 | -27.8 |
| | ZONE 2b | -46.6 | -34.1 | -31.0 |
| | ZONE 2c | -43.5 | -27.8 | -27.8 |
| | ZONE 3a | -54.4 | -38.8 | -31.0 |
| WALL | ZONE 3b | -46.6 | -34.1 | -31.0 |
| | ZONE 4 | -20.0 | -17.4 | -16.0 |
| | ZONE 5 | -24.7 | -19.2 | -16.0 |
| | POSITIVE | 18.4 | 16.0 | 16.0 |

SITE AND OCCUPANCY PARAMETERS

| PARAMETER | VALUE | | REFERENCE |
|---|--------------------------|--------------------------|-----------------------|
| | OPT 1 | OPT 2 | |
| RISK CATEGORY | II | II | 2022 CBC TABLE 1604.5 |
| SEISMIC IMPORTANCE FACTOR | I = 1.0 | I = 1.0 | ASCE 7-16 TABLE 1.5-2 |
| MAPPED SPECTRAL RESPONSE ACCELERATIONS: | S ₁ = 0.434 g | S ₁ = 1.05 g | 2022 CBC 1613.2.1 |
| SITE CLASS | D (DF) | D (DF) | 2022 CBC 1613.2.2 |
| SPECTRAL RESPONSE COEFFICIENTS: | S _{DS} = 1.00 g | S _{DS} = 1.97 g | 2022 CBC 1613.2.4 |
| | S _{DI} = 0.54 g | S _{DI} = 1.19 g | |

BUILDING PARAMETERS

| PARAMETER | VALUE | | REFERENCE |
|--------------------------------------|--|------------------------|------------------------|
| | OPT 1 | OPT 2 | |
| SEISMIC DESIGN CATEGORY | SDC = D | SDC = D | 2022 CBC 1613.2.5 |
| BASIC SEISMIC FORCE RESISTING SYSTEM | LIGHT FRAME (WOOD) WALLS SHEATHED WITH WOOD STRUCTURAL PANELS RATED FOR SHEAR RESISTANCE | | ASCE 7-16 TABLE 12.2-1 |
| RESPONSE MODIFICATION FACTOR | R = 6½ | | |
| SYSTEM OVERSTRENGTH FACTOR | Ω ₀ = 3 | | |
| DEFLECTION AMPLIFICATION FACTOR | Cd = 4 | | |
| DESIGN BASE SHEAR | V = 5.8 k | V = 11.5 k | ASCE 7-16 12.8.1 |
| SEISMIC RESPONSE COEFFICIENTS | C _s = 0.154 | C _s = 0.304 | ASCE 7-16 12.8.1.1 |
| ANALYSIS PROCEDURE USED | EQUIVALENT LATERAL FORCE PROCEDURE | | ASCE 7-16 12.8 |

- GEOTECHNICAL INFORMATION (2022 CBC SECTION 1603.1.6): REFER TO FOUNDATION GENERAL NOTES

FOUNDATION

- GEOTECHNICAL INFORMATION AND FOUNDATION DESIGN IS BASED ON THE FOLLOWING:
 - DESIGN LATERAL SOIL LOADS ARE IN ACCORDANCE WITH 2022 CBC TABLE 16.01.1
 - ALLOWABLE FOUNDATION BEARING AND LATERAL PRESSURES ARE IN ACCORDANCE WITH 2022 CBC TABLE 1806.2

SPREAD OR CONTINUOUS FOOTINGS:

| ELEMENT | ALLOWABLE BEARING CAPACITY (PSF) * | ALLOWABLE LATERAL RESISTANCE # | |
|--------------------|------------------------------------|---|----------------|
| | | PASSIVE RESISTANCE (PSF/FT BELOW GRADE) † | COHESION (PSF) |
| SHALLOW FOUNDATION | 1,500 | 100 | 130 |

- NOTES:
- THE ALLOWABLE CAPACITY MAY BE INCREASED BY ONE-THIRD WHEN CONSIDERING LOADS OF SHORT DURATION SUCH AS WIND OR SEISMIC FORCES.
 - THE ALLOWABLE LATERAL RESISTANCE CAN BE TAKEN AS THE SUM OF THE FRICTIONAL RESISTANCE AND PASSIVE RESISTANCE.
 - THE UPRIF FOOT OF SOIL NOT PROTECTED BY PAVEMENT SHALL BE NEGLECTED WHEN CALCULATING PASSIVE RESISTANCE.
 - COMPACTED FILL SHOULD BE PREPARED AS FOLLOWS: A MIN OF 12" OF COMPACTED FILL SHALL BE PROVIDED, COMPACTED TO A MIN OF 90 PERCENT MODIFIED PROCTOR IN ACCORDANCE WITH ASTM D 1557 (2022 CBC 1804.6)

- WHERE NOT SHOWN ON THE DRAWINGS, CONTRACTOR TO PROVIDE FOR DESIGN AND INSTALLATION OF ALL CRIBBING, SHEATHING AND SHORING REQUIRED AND SHALL BE SOLELY RESPONSIBLE FOR ALL EXCAVATION PROCEDURES INCLUDING LAGGING, SHORING, AND PROTECTION OF ADJACENT PROPERTY, STRUCTURES, STREETS, AND UTILITIES IN ACCORDANCE WITH ALL NATIONAL, STATE AND LOCAL SAFETY ORDINANCES.
- CONTRACTOR TO PROVIDE FOR DE-WATERING OF EXCAVATIONS FROM SURFACE WATER, GROUND WATER AND/OR SEEPAGE.
- EXCAVATION FOR FOOTINGS SHALL BE APPROVED BY THE INSPECTOR OR GEOTECHNICAL ENGINEER PRIOR TO PLACING CONCRETE AND REINFORCING.
- ALL EXCAVATIONS SHALL BE PROPERLY BACKFILLED. DO NOT PLACE BACKFILL BEHIND RETAINING WALLS BEFORE CONCRETE OR GROUT HAS ATTAINED FULL DESIGN STRENGTH. CONTRACTOR SHALL PROVIDE FOR DESIGN, PERMITS AND INSTALLATION OF SUCH BRACING.
- EXCAVATIONS SHALL BE CUT SQUARE AND SMOOTH, WITH LEVEL BOTTOMS.
- FOOTING BACKFILL AND UTILITY TRENCH BACKFILL WITH BUILDING AREA SHALL BE MECHANICALLY COMPACTED IN LAYERS IN ACCORDANCE WITH THE GEOTECHNICAL INVESTIGATION REPORT AND APPROVED BY THE GEOTECHNICAL ENGINEER. FLOODING WILL NOT BE PERMITTED. ALL FILLS USED TO SUPPORT FOUNDATIONS SHALL BE INSPECTED BY THE GEOTECHNICAL ENGINEER REPRESENTATIVE PER SECTION 1705.6 OF THE CODE.
- ALL ABANDONED FOOTINGS, UTILITIES, ETC. SHALL BE REMOVED. NEW FOOTINGS MUST EXTEND INTO UNDISTURBED SOILS.
- THIS PLAN IS INTENDED FOR FLAT LOTS, WITHOUT HIGHLY EXPANSIVE OR LIQUEFIABLE SOILS. IF THE PROJECT SITE IS DETERMINED TO HAVE ANY OF THESE QUALITIES, AS DETERMINED BY THE BUILDING OFFICIAL, THESE PER APPROVED ADU FOUNDATION PLANS AND DETAILS ARE NOT APPLICABLE.

EXISTING CONDITIONS

- ALL INFORMATION SHOWN ON THE PLANS RELATIVE TO EXISTING CONDITIONS IS GIVEN AS THE BEST PRESENT KNOWLEDGE FROM PLANS SUPPLIED BY THE OWNER, BUT WITHOUT GUARANTEE OF ACCURACY.
- WHERE ACTUAL CONDITIONS ARE NOT IN ACCORDANCE WITH THE INFORMATION PRESENTED, THE ARCHITECT AND/OR STRUCTURAL ENGINEER SHALL BE NOTIFIED IMMEDIATELY. NO MODIFICATIONS TO THE PLANS FOR NEW CONSTRUCTION SHALL BE MADE WITHOUT THE WRITTEN APPROVAL OF THE ARCHITECT.

EXISTING UNDERGROUND UTILITIES

- THE ARCHITECT AND ENGINEERS ARE NOT RESPONSIBLE FOR THE LOCATIONS OF EXISTING UNDERGROUND UTILITIES WHETHER OR NOT SHOWN ON THE DRAWINGS. DRAWINGS, IF ANY, IS APPROXIMATE. THE CONTRACTOR SHALL EXERCISE EXTREME CAUTION IN EXCAVATING AND TRENCHING ON THE SITE. THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE ARCHITECT AND/OR STRUCTURAL ENGINEER SHOULD ANY SUCH UNIDENTIFIED CONDITIONS BE DISCOVERED.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGES WHICH MAY RESULT FROM HIS FAILURE TO EXACTLY LOCATE AND PRESERVE ALL EXISTING UNDERGROUND UTILITIES.
- AN UNDERGROUND SERVICE ALERT INQUIRY IDENTIFICATION NUMBER MUST BE OBTAINED AT LEAST TWO WORKING DAYS BEFORE STARTING WORK WITH THIS PERMIT.
 - FOR PROJECTS IN SOUTHERN CALIFORNIA TELEPHONE NO. 1-800-422-4133.
 - FOR PROJECTS IN NORTHERN CALIFORNIA TELEPHONE NO. 1-800-227-2600.

DEMOLITION

- ALL DEMOLITION SHALL BE CARRIED ON IN SUCH A WAY AS NOT TO DAMAGE EXISTING ELEMENTS, WHICH ARE TO REMAIN IN THE FINISHED STRUCTURE.
- ALL ELEMENTS OF THE STRUCTURE, WHICH ARE TO REMAIN, AND WHICH ARE DAMAGED DURING DEMOLITION WORK SHALL BE REPLACED AT NO ADDITIONAL COST. EXISTING ELEMENTS SHALL BE PROTECTED TO THE FULLEST EXTENT POSSIBLE, IN ORDER TO MITIGATE DAMAGE.
- CONTRACTOR IS RESPONSIBLE FOR REMOVAL AND REPLACEMENT OF ALL EXISTING ELEMENTS THAT ARE NECESSARY FOR THE INSTALLATION OF ALL NEW WORK.
- WHERE EXISTING PARTITION WALLS ARE TO BE DEMOLISHED, CONTRACTOR SHALL VERIFY WALLS ARE NON-BEARING PRIOR TO DEMOLITION. IF WALLS ARE FOUND TO BE BEARING, CONTRACTOR SHALL NOTIFY ARCHITECT IMMEDIATELY

CONCRETE

- ALL CONCRETE CONSTRUCTION SHALL CONFORM WITH CHAPTER 19 OF THE CODE AND WITH THE PROVISIONS OF ACI 318-19.
- CONCRETE MATERIALS SHALL BE IN ACCORDANCE WITH THE FOLLOWING STANDARDS:

| MATERIAL | ASTM STANDARD |
|------------------------------------|---------------|
| PORTLAND CEMENT (TYPE II) | C150 |
| CONCRETE AGGREGATES (HARDROCK) | C33 |
| WATER* | C1602 |
| COAL FLY ASH OR POZZOLAN (CLASS F) | C618 |
| NATURAL OR MANUFACTURED SAND | C33 |
| SLAG | C989 |

- FOR SOILS WITH HIGH CONCENTRATIONS OF SULFATES (EXPOSURES S2 OR S3 PER ACI 318-19 TABLE 19.3.2.1) PORTLAND CEMENT SHALL BE TYPE V. VERIFY WITH PROJECT GEOTECHNICAL REPORT.
- WATER SHOULD ONLY BE ADDED AT THE BATCH PLANT. IN NO CASE SHALL THE DESIGN WATER/ CEMENT RATIO BE EXCEEDED.

- CONCRETE MIXES SHALL BE PROPORTIONED BASED ON SECTION 26.4.3 OF ACI 318-19, WHICH REFERENCES ACI 301-10 ARTICLE 4.2.3. MIX DESIGNS SHALL INCLUDE DOCUMENTATION OF MIX AVERAGE COMPRESSIVE STRENGTH THROUGH FIELD TEST DATA OR TRAIL MIXTURES IN ACCORDANCE WITH ACI 301-10 ARTICLE 4.2.3.4. SCHEDULE OF STRUCTURAL CONCRETE STRENGTHS AND LOCATIONS (UNO):

| LOCATION IN STRUCTURE | MINIMUM STRENGTH [PSI] | DENSITY (PCF) | MAX SLUMP (IN) | MAX WATER/CEMENT RATIO | SLAG/ FLY ASH† [MAX] |
|--|------------------------|---------------|----------------|------------------------|----------------------|
| CONCRETE FOUNDATIONS, GRADE BEAMS, TIE BEAMS | 2,500 | 150 | 4 | 0.5 | 0.15 |
| CONCRETE SLAB ON GRADE | 2,500 | 150 | 4 | 0.45 | 0.15 |

- AS MEASURED BY CEMENTITIOUS WEIGHT
- DEPOSITING AND CONVEYING OF CONCRETE SHALL CONFORM TO SECTION 26.5 OF ACI 318-19 AND PROJECT SPECIFICATIONS.
 - ALL CONCRETE SURFACES AGAINST WHICH NEW CONCRETE IS TO BE PLACED SHALL BE CLEANED AND ROUGHENED TO 1/4" AMPLITUDE.
 - ALL REINFORCING BARS, ANCHOR BOLTS AND OTHER CONCRETE INSERTS SHALL BE WELL SECURED IN POSITION PRIOR TO PLACING CONCRETE.
 - PROVIDE SLEEVES FOR PLUMBING AND ELECTRICAL OPENINGS IN CONCRETE BEFORE PLACING. DO NOT CUT ANY REINFORCING WHICH MAY CONFLICT. CORING IN CONCRETE IS NOT PERMITTED WITHOUT SEOR APPROVAL. NOTIFY THE SEOR IN ADVANCE OF CONDITIONS NOT SHOWN ON THE DRAWINGS. SEE THE DRAWINGS FOR ADDITIONAL RESTRICTIONS ON THE PLACEMENT OF OPENINGS IN SLABS AND WALLS.
 - PIPES EMBEDDED IN CONCRETE:
 - CONCRETE
 - PIPES LARGER THAN 1-1/2" DIAMETER SHALL NOTE BE EMBEDDED IN STRUCTURAL CONCRETE EXCEPT WHERE SPECIFICALLY APPROVED BY SEOR.
 - NO CONDUITS SHALL BE PLACED IN CONCRETE FILL OVER METAL DECK.
 - PIPES SHALL NOT DISPLACE OR INTERRUPT REINFORCING BARS.
 - DO NOT STACK CONDUITS, SPACE EMBEDDED PIPES AND CONDUITS AT A MINIMUM OF 3 DIAMETERS CLEAR FROM OTHER EMBEDDED PIPES/CONDUITS AND REBAR.

REINFORCING STEEL

- REINFORCING BARS SHALL CONFORM TO THE REQUIREMENTS OF CHAPTER 19 OF THE CODE AND WITH THE PROVISIONS OF ACI 318-19, ASTM A706, GRADE 60 UNO, ASTM A615 GR 60 STEEL, MAY BE SUBSTITUTED FOR ASTM A706 GRADE 60 STEEL PER ACI 318-19 SECTION 20.2.2.5 PROVIDED THE FOLLOWING CONDITIONS ARE MET:
 - THE ACTUAL YIELD STRENGTH BASED ON MILL TESTS DOES NOT EXCEED THE SPECIFIED YIELD STRENGTH BY MORE THAN 18,000 PSI.
 - THE RATIO OF THE ACTUAL ULTIMATE TENSILE STRESS TO THE ACTUAL YIELD STRENGTH IS NOT LESS THAN 1.25.
 - WHERE REINFORCEMENT COMPLYING WITH ASTM A615 IS TO BE WELDED, CHEMICAL TESTS SHALL BE PERFORMED TO DETERMINE WELDABILITY IN ACCORDANCE WITH SECTION 26.4.4 OF ACI 318-19.
- BARs SHALL BE CLEAN OF RUST, GREASE, OR OTHER MATERIALS LIKELY TO IMPAIR BOND. ALL REINFORCING BAR BENDS SHALL BE MADE COLD.
- REINFORCING BAR LAP SPLICES SHALL BE MADE AS INDICATED ON THE DRAWINGS. LAP ALL HORIZONTAL BARS AT CORNERS AND INTERSECTIONS, STAGGER ALL SPLICES UNLESS NOTED OTHERWISE ON PLANS.
 - MINIMUM LAP SPLICE LENGTH FOR REINFORCING STEEL BARS IN CONCRETE SHALL BE PER ACI 318-19 SECTION 25.5.2 AND THE REINFORCING SCHEDULE ON THE DRAWINGS.
- REINFORCING STEEL SHALL BE ACCURATELY PLACED AND ADEQUATELY SUPPORTED BEFORE THE CONCRETE IS PLACED AND SHALL BE SECURED AGAINST DISPLACEMENT DURING CONSTRUCTION WITHIN PERMITTED TOLERANCES. ADEQUATE SUPPORTS ARE ALSO NECESSARY TO KEEP THE REINFORCING STEEL AT THE PROPER DISTANCE FROM THE FORMS. USE WIRE BAR SUPPORTS, PRECAST CONCRETE SUPPORTS, SPACERS, BOLSTERS, REINFORCEMENT OR OTHER MEANS OF SUPPORT PER THE "CRSI MANUAL OF STANDARD PRACTICE", LATEST EDITION.
- ED ITEMS MAY BE CORRECTED PRIOR TO PLACEMENT OF OVERLYING GRIDS OR REINFORCING STEEL.
- CONCRETE PROTECTION FOR REINFORCEMENT

| THE FOLLOWING MINIMUM CONCRETE COVER SHALL BE PROVIDED FOR REINFORCEMENT IN CAST-IN-PLACE CONCRETE (NON-PRESTRESSED): | MINIMUM COVER, IN. |
|--|--------------------|
| A. CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH | 3 |
| B. CONCRETE EXPOSED TO EARTH OR WEATHER: NO.6 THROUGH NO. 18 BAR NO.5 BAR, W31 OR D31 WIRE & SMALLER | 2 1½ |
| C. CONCRETE NOT EXPOSED TO WEATHER OR IN CONTACT WITH GROUND: SLABS, WALLS, JOISTS: NO.14 AND NO.18 BARS NO.11 BAR & SMALLER BEAMS, COLUMNS: PRIMARY REINFORCEMENT TIES, STIRRUPS, SPIRALS | 1½ ¾ 1½ |

WOOD (GENERAL)

- PRESERVATIVE TREATMENT:
 - WOOD MEMBERS SHALL BE PRESERVATIVE TREATED IN ACCORDANCE WITH A1C 109-07, STANDARD FOR PRESERVATIVE TREATMENT, BASED ON THE SERVICE CONDITION PER THE USE CATEGORIES (UC) SPECIFIED IN AWPA U1-06.
 - UC1 - INTERIOR CONSTRUCTION, ABOVE GROUND, DRY - NO PRESERVATIVE TREATMENT REQUIRED
 - UC2 - INTERIOR CONSTRUCTION, ABOVE GROUND, WET - PRESERVATIVE TREATMENT REQUIRED IF THE HUMIDITY OR MOISTURE CONDENSATION IS 20% OR GREATER.
 - UC3 - EXTERIOR CONSTRUCTION ABOVE GROUND - PRESERVATIVE TREATMENT REQUIRED.
 - FOR ALL TREATED WOOD MEMBERS, ALL CUTS, HOLES AND INJURIES SUCH AS ABRASIONS OR HOLES FROM REMOVAL OF NAILS AND SPIKES WHICH MAY PENETRATE THE TREATED ZONE SHALL BE FIELD TREATED IN ACCORDANCE WITH AWPA M4-06. THE FOLLOWING FIELD TREATMENTS SHALL BE USED:
 - BORED HOLES: HOLES FOR CONNECTORS OR BOLTS MAY BE TREATED BY PUMPING COAL TAR ROOFING CEMENT MEETING ASTM D5643 INTO HOLES USING A GREASE GUN OR SIMILAR DEVICE
 - EXTERIOR: COPPER NAPHTHENATE
 - INTERIOR: INORGANIC BORON PRESERVATIVES LIMITED TO USE IN APPLICATIONS NOT IN CONTACT WITH GROUND AND CONTINUOUSLY PROTECTED FROM LIQUID WATER

SAWN LUMBER

- FRAMING LUMBER SHALL MEET THE FOLLOWING MINIMUM STANDARDS EXCEPT WHERE OTHERWISE NOTED:

SAWN LUMBER PROPERTIES

| USE | SIZE | SPECIES | GRADE | REFERENCE |
|--------------------------------|----------------------|---------|-------------------------------------|-------------------|
| MUDSILLS | 2 X 4 | D.F. | STANDARD OR BETTER PRESSURE TREATED | 2022 CBC 2303.1.9 |
| | 2 X 6 AND LARGER | D.F. | NO. 2 OR BETTER PRESSURE TREATED | |
| | 2 X | REDWOOD | FOUNDATION GRADE | |
| HORIZONTAL FRAMING LUMBER | | | | |
| ROOF JOISTS AND RAFTERS | 2 x | D.F. | NO. 2 | |
| FLOOR JOISTS | 2 X | D.F. | NO. 2 | |
| HEADERS AND BEAMS | 4 X | D.F. | NO. 2 | WCIB & WWPA |
| ANY OTHER HORIZONTAL | 4 X 4 AND SMALLER | D.F. | NO. 2 | |
| | 6 X 6 AND LARGER | D.F. | NO. 1 | |
| VERTICAL FRAMING LUMBER | | | | |
| TOP PLATES | 2 X | D.F. | NO. 2 | |
| STUDS | 2 X 4 & 3 X 4 | D.F. | STUD | WCIB & WWPA |
| | 2 X 6 & 2 X 8 | D.F. | NO. 2 | |
| POSTS | 4 X 4 & 4 X 6 POSTS | D.F. | NO. 2 | |
| | 6 X 6 & LARGER POSTS | D.F. | NO. 1 | |
| ALL OTHER FRAMING LUMBER | | | | |
| ALL OTHER FRAMING LUMBER (UNO) | ALL SIZES | D.F. | STANDARD & BETTER | WCIB & WWPA |

- FLOOR JOISTS SHALL BE GRADE STAMPED "S-DRY" WHICH INDICATES A MOISTURE CONTENT NOT EXCEEDING 19 PERCENT.
- ALL SOLE PLATES AND TOP PLATES SHALL BE GRADE STAMPED "KD" WHICH INDICATES KILN DRIED WITH A MOISTURE CONTENT NOT EXCEEDING 15 PERCENT.
- STUD WALLS SHOWN ON PLANS ARE NON-BEARING PARTITIONS WALLS, BEARING WALLS OR SHEAR WALLS BELOW THE FRAMING LEVEL, UNLESS NOTED OTHERWISE. STUDS SHALL BE SIZE AND SPACING AS NOTED IN THE DRAWINGS, SEE PLANS AND ARCHITECTURAL DRAWINGS, UNLESS OTHERWISE NOTED.
- MINIMUM FRAMING NAILING SHALL CONFORM TO CBC TABLE 2304.10.2. ALL NAILS SHALL BE COMMON WIRE NAILS. REDDRILL NAIL HOLES TO 70% OF NAIL SHANK DIAMETER WHERE NAILING TENDS TO SPLIT WOOD.
- UNLESS OTHERWISE NOTED, ALL WOOD SILL PLATES UNDER BEARING, EXTERIOR, OR SHEAR WALLS IN CONTACT WITH CONCRETE OR MASONRY SHALL BE BOLTED TO THE CONCRETE OR MASONRY WITH 5/8" Ø X 12" BOLTS W/ 0.229" X 3" X 3" PLATE WASHER (GALV) AT 4'-0" O.C. BEGINNING AT 9" O.C. MAXIMUM FROM EACH END OF THE PLATES. THE BOLTS SHALL EXTEND A MINIMUM OF 7" INTO THE CONCRETE OR MASONRY. POWDER DRIVEN NUTS AT 1/3 OF THE BOLT SPACING OR 24" O.C. MAXIMUM MAY BE SUBSTITUTED FOR THE ANCHOR BOLTS AT INTERIOR NON-SHEAR WALLS ONLY.
- ALL LUMBER IN CONTACT WITH CONCRETE SHALL BE PRESSURE TREATED LUMBER WITH AWPA TREATMENT C2 USING EITHER ALKALINE QUAT (AQ) TYPE B AND D), COPPER AZOLE (CBA-A, CA-B), OR SODIUM BORATES (SBK), ANCHOR BOLTS, FASTENERS, AND METAL FRAMING CONNECTORS IN CONTACT WITH PRESSURE TREATED LUMBER SHALL BE HOT-DIPPED GALVANIZED TO A RATING OF G-185 PER ASTM A653.
- PROVIDE 2 STUDS UNDER ALL 4 X 10 AND LARGER BEAMS OR HEADERS AT SPANS 6 FEET OR LONGER, UNLESS OTHERWISE NOTED. WHERE POSTS OR MULTIPLE STUDS UNDER BEAMS OR HEADERS ARE CALLED FOR ON DRAWINGS THOSE POSTS OR MULTIPLE

REQUIRED VERIFICATION AND INSPECTIONS

| WOOD CODE CHAPTER 17 AND REFERENCED 2018 NDS AND AWC SDPWS-2015 | | | |
|--|------------|----------|--------------------|
| SPECIAL INSPECTION OR TEST | CONTINUOUS | PERIODIC | CBC REFERENCE |
| 1. HIGH LOAD DIAPHRAGM WOOD STRUCTURAL PANELS - VERIFY THE FOLLOWING: - GRADE - THICKNESS - NOMINAL SIZE OF FRAMING MEMBERS AT ADJOINING PANEL EDGES - NAIL OR STAPLE DIAMETER AND LENGTH - NUMBER OF FASTENER LINES - SPACING BETWEEN FASTENERS IN EACH LINE - SPACING BETWEEN FASTENERS AT EDGE MARGINS | --- | X | 1705.5.1 2304.2 |
| 2. FIELD GLUING OPERATIONS OF ELEMENTS OF THE SEISMIC FORCE RESISTING SYSTEM. | X | --- | 1705.13.2 |
| 3. WOOD LATERAL FORCE-RESISTING SYSTEM WITH FASTENER SPACING OF THE SHEATHING LESS THAN 4" O.C. - WOOD SHEAR WALLS - WOOD DIAPHRAGMS - DRAG STRUTS - SHEAR PANELS - HOLD-DOWNS | --- | X | 1705.13.2 |
| 4. WOOD LATERAL FORCE-RESISTING SYSTEM WITH FASTENER SPACING OF THE SHEATHING GREATER THAN 4" O.C. (NOT REQUIRED) - WOOD SHEAR WALLS - WOOD DIAPHRAGMS - DRAG STRUTS - SHEAR PANELS - HOLD-DOWNS | --- | --- | 1705.13.2 |
| 5. METAL PLATE CONNECTED WOOD TRUSSES SPANNING 40 FEET OR GREATER - TEMPORARY INSTALLATION RESTRAINT/BRACING - PERMANENT INDIVIDUAL TRUSS MEMBER RESTRAINT/BRACING IN ACCORDANCE WITH APPROVED TRUSS SUBMITTAL PACKAGE | --- | X | 1705.5.2 |

**SOILS
CODE TABLE 1705.6**

| SPECIAL INSPECTION OR TEST | CONTINUOUS | PERIODIC |
|---|------------|----------|
| 1. VERIFY MATERIALS BELOW SHALLOW FOUNDATIONS ARE ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY | --- | X |
| 2. VERIFY EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL. | --- | X |
| 3. PERFORM CLASSIFICATION AND TESTING OF COMPACTED FILL MATERIALS | --- | X |
| 4. VERIFY USE OF PROPER MATERIALS, DENSITIES, AND LIFT THICKNESSES DURING PLACEMENT AND COMPACTION OF COMPACTED FILL. | X | --- |
| 5. PRIOR TO PLACEMENT OF COMPACTED FILL, INSPECT SUBGRADE AND VERIFY THAT SITE HAS BEEN PREPARED PROPERLY. | --- | X |

**CONCRETE CONSTRUCTION
CODE TABLE 1705.3**

| SPECIAL INSPECTION OR TEST | CONTINUOUS | PERIODIC | REFERENCED STANDARD | CBC REFERENCE |
|---|------------|----------|------------------------------------|---------------|
| 3. INSPECT ANCHORS CAST IN CONCRETE | --- | X | ACI 318: 26.7 | --- |
| 4. INSPECT ANCHORS POST-INSTALLED IN HARDENED CONCRETE MEMBERS (a) ADHESIVE ANCHORS INSTALLED IN HORIZONTALLY OR UPWARDLY INCLINED ORIENTATIONS TO RESIST SUSTAINED TENSION LOADS (b) MECHANICAL ANCHORS AND ADHESIVE ANCHORS NOT DEFINED IN 4.a. | X | X | ACI 318: 26.7.1 ACI 318: 26.7.1 | --- |

STATEMENT OF SPECIAL INSPECTIONS

- THIS STATEMENT OF SPECIAL INSPECTIONS HAS BEEN PREPARED PURSUANT TO SECTION 1704.3 OF THE CODE. THIS SECTION DETAILS BOTH REQUIRED SPECIAL INSPECTIONS AND TESTS INCLUDING TESTING PER SECTION 1705 OF THE CODE. THE FOLLOWING SHALL BE OBSERVED DURING THEIR IMPLEMENTATION:
 - GENERAL:
 - STRUCTURAL VERIFICATIONS, INSPECTIONS AND TESTS SHALL BE PERFORMED IN ACCORDANCE WITH CHAPTER 17 OF THE CODE AND/OR THE APPLICABLE REFERENCE STANDARD.
 - OWNER REQUIREMENTS:
 - THE OWNER OR OWNER'S AGENT SHALL EMPLOY ONE OR MORE APPROVED AGENCIES TO PERFORM INSPECTIONS DURING CONSTRUCTION ON THE TYPES OF WORK LISTED IN SECTION 1705 OF THE CODE AND IN THIS STATEMENT OF INSPECTIONS.
 - SPECIAL INSPECTOR QUALIFICATIONS:
 - THE SPECIAL INSPECTORS SHALL PROVIDE WRITTEN DOCUMENTATION TO THE BUILDING OFFICIAL DEMONSTRATING HIS OR HER COMPETENCE AND RELEVANT EXPERIENCE OR TRAINING. THE EXPERIENCE OR TRAINING SHALL BE CONSIDERED RELEVANT WHEN THE DOCUMENTED EXPERIENCE OR TRAINING IS RELATED IN COMPLEXITY TO THE SAME TYPE OF SPECIAL INSPECTION ACTIVITIES FOR PROJECTS OF SIMILAR COMPLEXITY AND MATERIAL QUANTITIES.
 - CONTRACTOR REQUIREMENTS:
 - SPECIAL INSPECTOR S IN ADDITION TO THE CONTRACTOR'S QUALITY CONTROL INSPECTIONS AND TESTING, THE CONTRACTOR'S QUALITY CONTROL INSPECTIONS AND TESTING SHALL OCCUR PRIOR TO SPECIAL INSPECTION AND REPORTS SHALL BE AVAILABLE TO THE SPECIAL INSPECTOR.
 - THE CONTRACTOR SHALL ENSURE THAT THE WORK FOR WHICH SPECIAL INSPECTION IS REQUIRED REMAINS ACCESSIBLE AND EXPOSED FOR SPECIAL INSPECTION PURPOSES UNTIL COMPLETION OF THE REQUIRED SPECIAL INSPECTION.
 - ANY CONTRACTOR RESPONSIBLE FOR THE CONSTRUCTION OF THE MAIN WIND OR SEISMIC FORCE RESISTING SYSTEM SHALL SUBMIT A WRITTEN STATEMENT OF RESPONSIBILITY TO THE BUILDING OFFICIAL AND OWNER PRIOR TO COMMENCEMENT OF WORK ON THE SYSTEM OR COMPONENT. THE STATEMENT OF RESPONSIBILITY SHALL CONTAIN ACKNOWLEDGEMENT OF AWARENESS OF THE SPECIAL INSPECTION REQUIREMENTS CONTAINED IN THE STATEMENT OF SPECIAL INSPECTIONS.
 - SPECIAL INSPECTOR REPORT REQUIREMENTS:
 - THE SPECIAL INSPECTOR SHALL KEEP RECORD OF INSPECTIONS
 - THE SPECIAL INSPECTOR SHALL FURNISH INSPECTION REPORTS TO THE BUILDING OFFICIAL AND TO THE ARCHITECT AND STRUCTURAL ENGINEER OF RECORD.
 - REPORTS SHALL INDICATE THAT WORK INSPECTED WAS OR WAS NOT COMPLETED IN CONFORMANCE TO APPROVED CONSTRUCTION DOCUMENTS.
 - DISCREPANCIES SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE CONTRACTOR FOR CORRECTION.
 - IF NOT CORRECTED DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE BUILDING OFFICIAL AND THE ARCHITECT AND STRUCTURAL ENGINEER OF RECORD PRIOR TO THE COMPLETION OF THAT PHASE OF WORK.
 - A FINAL REPORT DOCUMENTING SPECIAL INSPECTIONS AND CORRECTION OF ANY DISCREPANCIES NOTED SHALL BE SUBMITTED TO THE BUILDING OFFICIAL.

SHOP FABRICATION

- SHOP FABRICATION REQUIRES SPECIAL INSPECTION IN ACCORDANCE WITH CODE SECTION 1704.2.5. EXCEPTION: SHOP SPECIAL INSPECTIONS ARE NOT REQUIRED WHEN WORK IS DONE ON THE PREMISES OF FABRICATOR REGISTERED AND APPROVED TO PERFORM SUCH WORK IN ACCORDANCE WITH CODE SECTION 1704.2.5.1. THE FOLLOWING ACCREDITATIONS MEET THE REQUIREMENTS OF THIS EXCEPTION:
 - STEEL BUILDINGS (OR STEEL ELEMENTS IN OTHER BUILDINGS)
 - FOR GENERAL STEEL BUILDINGS OR ELEMENTS THE FABRICATOR SHALL BE AN AISC CERTIFIED FABRICATOR IN ACCORDANCE WITH THE AISC CERTIFICATION PROGRAM FOR STRUCTURAL STEEL FABRICATORS (AISC 201-04).
 - OTHER ACCREDITATION DEEMED ACCEPTABLE BY THE AUTHORITY HAVING JURISDICTION.
 - IF FABRICATION IS PERFORMED BY AN APPROVED FABRICATOR A CERTIFICATE OF COMPLIANCE MUST BE PROVIDED TO THE BUILDING INSPECTOR THAT THE MATERIALS SUPPLIED AND WORK PERFORMED BY THE FABRICATOR ARE IN CONFORMANCE WITH THE CONSTRUCTION DOCUMENTS.
 - IF FABRICATION IS NOT PERFORMED BY AN APPROVED FABRICATOR WELDING INSPECTION REPORTS MUST BE SUBMITTED TO THE BUILDING OFFICIAL BY AN APPROVED TESTING AGENCY.
 - NON-DESTRUCTIVE TESTING (NDT) MAY BE PERFORMED BY THE FABRICATOR, HOWEVER THE QA AGENCY SHALL REVIEW THE FABRICATOR'S NDT REPORTS.
- WOOD BUILDINGS
 - WOOD STRUCTURAL PANELS (SHEATHING) SHALL BE IDENTIFIED BY THE APA TRADEMARK.

PRE-FABRICATED WOOD TRUSS NOTES

- THE DESIGN OF METAL PLATE CONNECTED WOOD TRUSSES SHALL BE IN ACCORDANCE WITH THE FOLLOWING:
 - CODES AND STANDARDS:
 - THE GOVERNING CODE LISTED IN THE PROJECT GENERAL NOTES
 - MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES (ASCE 7-16)
 - NATIONAL DESIGN STANDARD FOR WOOD CONSTRUCTION AND SUPPLEMENT (ANSI/AWC NDS-2018)
 - SPECIAL DESIGN PROVISIONS FOR WIND & SEISMIC (AWC SDPWS-2015)
 - THE NATIONAL DESIGN STANDARD FOR METAL PLATE CONNECTED WOOD TRUSS CONSTRUCTION (ANSI/TPI 1-2014)
 - DESIGN CRITERIA:
 - TRUSSES SHALL BE DESIGNED FOR THE FOLLOWING MINIMUM VERTICAL LOADS AND OTHER LOADS INDICATED ON THE CONSTRUCTION DOCUMENTS (ATTIC MECHANICAL UNITS, ETC.)
 ROOF TRUSS LOADING:
 ASPHALT SHINGLE W/ GYP CEILING:
 TOP-CHORD DEAD LOAD: 13.0 PSF * (11.9 PSF SUPERIMPOSED)
 BOT CHORD DEAD LOAD: 8.3 PSF (6.7 PSF SUPERIMPOSED)
 ROOF - LIVE LOAD: 20 PSF
 ASPHALT SHINGLE W/ STUCCO CEILING:
 TOP-CHORD DEAD LOAD: 13.0 PSF * (11.9 PSF SUPERIMPOSED)
 BOT CHORD DEAD LOAD: 12.7 PSF (11.1 PSF SUPERIMPOSED)
 ROOF - LIVE LOAD: 20 PSF
 DEFLECTION CRITERIA:
 DEAD + LIVE LOAD: L/240
 LIVE LOAD ONLY: L/360
 *INCLUDES 4 PSF ALLOWANCE FOR PV PANELS
- INDICATES HORIZONTAL SEISMIC/WIND LOAD ON COLLECTOR TRUSSES. THE TRUSS DESIGNER SHALL DESIGN FOR THE TRUSSES FOR THE INDICATED HORIZONTAL LOAD ACTING IN BOTH THE TOP AND BOTTOM TRUSS CHORDS AND FOR THE TRANSFER OF THE FORCE TO THE CHORDS THROUGH THE WEB.
- CONTRACTOR REQUIREMENTS:
 - THE CONTRACTOR SHALL MEET ALL THE REQUIREMENTS LISTED IN SECTION 2.3.4 OF ANSI/TPI 1-2014 INCLUDING THE FOLLOWING:
 - MEANS AND METHODS: THE CONTRACTOR IS RESPONSIBLE FOR ALL MEANS AND METHODS, TECHNIQUES, SEQUENCES, PROCEDURES, PROGRAMS AND SAFETY IN CONNECTION WITH THE RECEIPT, STORAGE, HANDLING, INSTALLATION, RESTRAINING, AND BRACING OF THE TRUSSES. REFER TO THE GUIDE TO GOOD PRACTICE FOR HANDLING, INSTALLING, RESTRAINING & BRACING OF METAL PLATE CONNECTED WOOD TRUSSES (BCS1-B1)
 - TRUSS INSTALLATION SHALL COMPLY WITH INSTALLATION TOLERANCES SHOWN IN BCS1-B1
 - TEMPORARY INSTALLATION RESTRAINT/BRACING FOR THE TRUSS SYSTEM AND THE PERMANENT TRUSS SYSTEM SHALL BE INSTALLED IN ACCORDANCE WITH BCS1-B2.
 - CONSTRUCTION LOADING ON TRUSSES SHALL BE DONE IN ACCORDANCE WITH BCS1-B4.
 - TRUSS DAMAGE, JOBSITE MODIFICATIONS & INSTALLATION ERRORS SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE FOR AND THE TRUSS DESIGNER. REFERENCE BCS1-B5.
 - SUBMIT THE DRAWINGS FROM THE TRUSS DESIGNER/MANUFACTURER TO THE BUILDING DEPARTMENT PRIOR TO FABRICATION FOR APPROVAL. A COPY OF THIS SUBMITTAL SHALL BE PROVIDED TO THE ENGINEER OF RECORD FOR REVIEW OF GENERAL CONFORMANCE TO THE DESIGN INTENT. THE CONTRACTOR SHALL INCORPORATE THE TIME REQUIRED FOR THE SUBMITTAL TO BE REVIEWED, STAMPED AND APPROVED BY ALL PARTIES AND SHALL HAVE THE APPROVED TRUSS PLANS ON THE JOB SITE PRIOR TO FOUNDATION INSPECTION.
 - TRUSS DESIGNER REQUIREMENTS:
 - THE TRUSS DESIGNER SHALL MEET ALL THE REQUIREMENTS LISTED IN SECTION 2.3.5.5 OF ANSI/TPI 1-2014 INCLUDING THE FOLLOWING:
 - TRUSS DESIGNER SHALL SUPERVISE THE PREPARATION OF THE TRUSS DESIGN DRAWINGS WHICH SHALL CONTAIN THE INFORMATION LISTED IN SECTION 2.3.5.5 OF ANSI/TPI 1-2014. THIS INCLUDES ALL TRUSS TO TRUSS CONNECTIONS, AND DETAILS FOR THE "CALIFORNIA FILL" AREAS.
 - TRUSS DESIGNER SHALL COMPLY WITH THE REFERENCED CODE AND DESIGN CRITERIA ABOVE.
 - TRUSS DESIGNER SHALL SHOW ALL HANGERS, BRACING AND RESTRAINTS AS WELL AS METHOD OF RESTRAINT/BRACING ON THE TRUSS PLANS TO MEET ANY SEISMIC AND WIND REQUIREMENTS OF THE CODE.
 - SUBMIT TRUSS DESIGN DRAWINGS INCLUDING ALL RELEVANT DETAILS FOR THE FABRICATION OF THE TRUSSES AND PREPARE CALCULATIONS. ALL PLANS, DETAILS AND CALCULATIONS FOR THE TRUSSES SHALL BE STAMPED AND SIGNED BY A LICENSED PROFESSIONAL ENGINEER (CIVIL OR STRUCTURAL), LICENSED TO PRACTICE IN THE STATE OF CALIFORNIA.

WOOD STRUCTURAL PANELS (SHEATHING)

| WOOD STRUCTURAL PANEL PROPERTIES | | | | | | |
|----------------------------------|-----|----------------------------------|--------------------------------------|--------------------|-------------|---|
| USE | PLY | BOND CLASSIFICATION ^c | SHEATHING GRADE | PERFORMANCE RATING | SPAN RATING | REFERENCE ^d |
| ROOF | 5 | EXPOSURE 1 | REFER TO TYPICAL DIAPHRAGM SCHEDULE | | APA | 2022 CBC 2303.1.5 (DOC PS 1-09 OR PS 2-10) |
| FLOOR | 5 | EXPOSURE 1 | REFER TO TYPICAL DIAPHRAGM SCHEDULE | | APA | |
| WALL ^g | 5 | EXPOSURE 1 | REFER TO TYPICAL SHEAR WALL SCHEDULE | | APA | |

- TABLE NOTES:
- WOOD STRUCTURAL PANELS SHALL CONFORM TO THE REQUIREMENTS FOR THEIR TYPE IN ACCORDANCE WITH THE FOLLOWING VOLUNTARY STANDARDS BY THE ENGINEERED WOOD ASSOCIATION (AWC):
 - VOLUNTARY PRODUCT STANDARD, STRUCTURAL PLYWOOD, PS 1-09
 - VOLUNTARY PRODUCT STANDARD, PERFORMANCE STANDARD FOR WOOD-BASED STRUCTURAL-USE PANELS, PS 2-10
 - WOOD STRUCTURAL PANELS SHALL BE IDENTIFIED BY THE APA TRADEMARK INDICATING CONFORMANCE TO THE APPLICABLE VOLUNTARY STANDARD
 - WHERE PANELS ARE EXPOSED TO REPEATED WETTING AND REDRYING, LONG-TERM EXPOSURE TO WEATHER, OR CONDITIONS OF SIMILAR SEVERITY, "EXTERIOR" APA RATED PLYWOOD SHEATHING SHALL BE USED. C-D "EXPOSURE 1" APA RATED PLYWOOD SHEATHING (CDX) SHALL NOT BE USED FOR CONDITIONS INVOLVING LONG-TERM EXPOSURE TO WEATHER.
 - EXCEPTION: WOOD STRUCTURAL PANEL ROOF SHEATHING EXPOSED TO THE OUTDOORS ON THE UNDERSIDE IS PERMITTED TO BE "EXPOSURE 1" TYPING.
 - WOOD STRUCTURAL PANELS TO BE USED AS SIDING SHALL COMPLY WITH ANSI/APA PRP-210.
 - ORIENTED STRAND BOARD (OSB) WITH EQUIVALENT CLASSIFICATION AND RATINGS MAY BE USED IN LIEU OF PLYWOOD FOR WOOD STRUCTURAL PANEL WALL SHEATHING.

- TRANSPORTATION, STORAGE, AND HANDLING:
 - TRANSPORTATION
 - IN TRANSPORTING PANELS ON OPEN TRUCK BEDS, COVER THE BUNDLES WITH A TARP.
 - STORAGE
 - ALWAYS STORE THE PANELS UNDER COVER WHENEVER POSSIBLE
 - WHEN STORING PANELS OUTSIDE STACK THEM ON A LEVEL SURFACE ON TOP OF STRINGERS OR OTHER BLOCKING, THREE STRINGERS MINIMUM.
 - NEVER LEAVE PANELS IN CONTACT WITH THE GROUND
 - COVER THE STACK WITH A PLASTIC TARP, ENSURING THAT THE BUNDLE IS WELL VENTILATED TO PREVENT MILDEW.
 - IF MOISTURE ABSORPTION IS EXPECTED, CUT THE STEEL BAND TO PREVENT DAMAGE
 - KEEP SANDED OR OTHER APPEARANCE GRADE PANELS AWAY FROM HIGH TRAFFIC AREAS
 - HANDLING
 - ALWAYS PROTECT ENDS AND EDGES, ESPECIALLY TONGUE AND GROOVE PRODUCTS, FROM PHYSICAL DAMAGE.
 - ACCLIMATE THE PANELS FOR 24 HOURS MINIMUM BEFORE INSTALLATION BY STANDING THE PANELS ON EDGE WITH A GAP BETWEEN EACH TO ALLOW FOR AIR CIRCULATION OR PER MANUFACTURER'S RECOMMENDATIONS.
- PLYWOOD ORIENTATION
 - ROOF AND FLOOR SHEATHING SHALL BE LAID WITH THE GRAIN OF THE OUTER PILES PERPENDICULAR TO THE FRAMING MEMBERS. SHALL BE CONTINUOUS OVER 2 JOIST BAYS MINIMUM AND END JOINTS SHALL BE JOINED OVER FRAMING AND STAGGERED. LEAVE A 1/8" GAP BETWEEN PANELS TO ALLOW FOR PANEL EXPANSION UNLESS RECOMMENDED OTHERWISE BY THE PANEL MANUF. REFER TO SPECIFIC DETAILS IN THE DRAWINGS FOR FURTHER PARAMETERS.
 - PLYWOOD OR OSB WALL SHEATHING MAY BE APPLIED VERTICALLY OR HORIZONTALLY. ALL END JOINTS BE JOINED OVER FRAMING AND STAGGERED.
- BLOCKING:
 - ROOF: ALL ROOF SHEATHING SHALL BE BLOCKED UNLESS SPECIFICALLY ALLOWED ON PLANS, WHERE PERMITTED TO BE UNBLOCKED, ALL UNBLOCKED EDGES SHALL BE TONGUE AND GROOVE.
 - FLOOR: ALL FLOOR SHEATHING SHALL BE BLOCKED UNLESS SPECIFICALLY ALLOWED ON PLANS, WHERE PERMITTED TO BE UNBLOCKED, ALL UNBLOCKED EDGES SHALL BE TONGUE AND GROOVE.
 - WALLS: ALL SHEAR WALLS SHALL BE FULLY BLOCKED AT PLYWOOD EDGES.
- FASTENERS
 - USE SHEATHING NAILS SAME GAUGE AS COMMON WIRE NAILS WITH LENGTHS AT LEAST EQUAL TO SHEATHING THICKNESS PLUS REQUIRED PENETRATION PER AWS SDPWS TABLE 4.2A OR 4.3A (AS REQUIRED).
 - EQUIVALENT PNEUMATIC DRIVE NAILS OR STAPLES MAY BE USED IF FASTENER MANUFACTURER HAS RECEIVED ICC OR IAPMO APPROVAL FOR THE INTENDED USE. FASTENERS TO BE SUBSTITUTED SHALL BE EQUIVALENT IN LATERAL AND WITHDRAWAL STRENGTH TO THE SIZE OF COMMON NAIL SPECIFIED.
 - USE OF MACHINE NAILING IS SUBJECT TO A SATISFACTORY JOB SITE DEMONSTRATION FOR EACH PROJECT AND THE APPROVAL BY THE PROJECT ARCHITECT OR STRUCTURAL ENGINEER. THE APPROVAL IS SUBJECT TO CONTINUED SATISFACTORY PERFORMANCE. MACHINE NAILING WILL NOT BE APPROVED IN 5/16" PLYWOOD OR OSB SHEATHING. IF NAIL HEADS PENETRATE THE OUTER PLY MORE THAN WOULD BE NORMAL FOR A HAND HAMMER OR IF MINIMUM ALLOWABLE EDGE DISTANCES ARE NOT MAINTAINED, THE PERFORMANCE WILL BE DEEMED UNSATISFACTORY.
 - TYPICAL NAILING SHALL BE 10D AT 4' O.C. AT ALL SUPPORTED EDGES AND OVER SHEAR WALLS, AND 10D AT 12' O.C. AT ALL INTERMEDIATE SUPPORTS, UNLESS OTHERWISE NOTED. SEE PLANS AND REFER TO SHEAR WALL SCHEDULE.



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRIBUTE THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

**COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT**
SAN LUIS OBISPO, CA
**GENERAL NOTES, SPECIAL
INSPECTION & TESTS**



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONSTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

FOUNDATION PLAN NOTES

- REFER TO THE FOLLOWING SHEETS FOR TYPICAL DETAILS:

| DESCRIPTION | SHEET (S) |
|---------------------------|---------------|
| SYMBOLS AND ABBREVIATIONS | S-101 |
| STRUCTURAL GENERAL NOTES | S-102 - S-103 |
| TESTING AND INSPECTION | S-103 |
| TYPICAL CONCRETE DETAILS | S-301 |
| TYPICAL WOOD DETAILS | S-401 - S-405 |
- SEE ARCHITECTURAL DRAWINGS FOR FINISHED FLOOR ELEVATIONS. REFERENCE FINISHED FLOOR ELEVATION = 0'-0" CORRESPONDS TO FINISHED FLOOR ELEVATION.
- ALL DIMENSIONS SHOWN ARE FROM FACE OF CONCRETE/MASONRY. FACE OF SHEATHING, OR CENTERLINE OF COLUMN. ALL COLUMNS ARE CENTERED IN STUD WALLS. UNO.
- FOR ANY DIMENSIONAL INFORMATION NOT SHOWN, SEE ARCHITECTURAL DRAWINGS.
- SEE ARCHITECTURAL DRAWINGS FOR ANY EMBEDDED ITEMS AND ALL EXTERIOR CONCRETE PAVING.
- SEE PLANS AND ARCHITECTURAL DRAWINGS FOR DEPRESSIONS AND/OR SLOPES IN CONCRETE SLABS.
- SEE ARCHITECTURAL DRAWINGS FOR SIZE AND LOCATION OF ALL DOOR AND WINDOW OPENINGS IN BEARING AND NON-BEARING WALLS.
- SEE ARCHITECTURAL DRAWINGS FOR LOCATION OF INTERIOR NON-BEARING PARTITIONS.
- SEE ARCHITECTURAL, PLUMBING, MECHANICAL AND ELECTRICAL DRAWINGS FOR ADDITIONAL EMBEDDED ITEMS AND SLAB PENETRATIONS.
- FOR TYPICAL SLAB-ON-GRADE REQUIREMENTS, INCLUDING SLAB JOINTS, SEE DETAIL 31/S-301.
- ALL POSTS IN 4" WALLS SHALL BE 4x4. UNLESS NOTED OTHERWISE
ALL POSTS IN 6" WALLS SHALL BE 6x6. UNLESS NOTED OTHERWISE
- PLATE WASHERS ARE REQUIRED FOR ALL SILL PLATE ANCHOR BOLTS. REFER TO 34/S-402 FOR PLATE WASHER REQUIREMENTS AT SHEAR WALLS.
- ALL HOLD-DOWN ANCHOR NUTS SHALL BE TIGHTENED JUST PRIOR TO COVERING.
- ALL BOLT HOLES IN WOOD MEMBERS, SHALL BE DRILLED A MAXIMUM OF 1/8" OVERSIZE. INSPECTOR TO VERIFY.
- THE BUILDING PAD SHALL BE PREPARED AS OUTLINED IN DETAIL S3/S-301. THE BUILDING OFFICIAL SHALL REQUIRE PAD CERTIFICATION BY A GEOTECHNICAL ENGINEER AT THEIR DISCRETION.
- BOTTOM OF FOOTING SHALL BE, UNLESS DEEPER FOUNDATIONS ARE REQUIRED BY THE BUILDING OFFICIAL:
 - 21" BELOW PAD OR ADJACENT GRADE AT PERIMETER, WHICHEVER IS DEEPER. UNO.
 - 21" BELOW PAD OR ADJACENT GRADE AT INTERIOR GRADE BEAMS, WHICHEVER IS DEEPER. UNO.
 NOTE: FOOTING MUST BE DEEPEMED LOCALLY PER DETAIL 32/S-301 TO ACCOMMODATE ANCHOR BOLT HOLD-DOWN EMBED DEPTHS.
- ALL THIS PLAN IS INTENDED FOR FLAT LOTS, WITHOUT HIGHLY EXPANSIVE OR LIQUEFIABLE SOILS. IF THE PROJECT SITE IS DETERMINED TO HAVE ANY OF THESE QUALITIES, AS DETERMINED BY THE BUILDING OFFICIAL, THESE PRE-APPROVED ADU FOUNDATION PLANS AND DETAILS ARE NOT APPLICABLE.

SYMBOL LEGEND



SCHEDULES


| HOLD-DOWN SCHEDULE | | |
|----------------------------------|---|----------|
| SPECIFIES HOLD-DOWN/STRAP DETAIL | INDICATES HOLD-DOWN/STRAP TYPE | DETAIL |
| | INDICATES SIMPSON S318 HOLD-DOWN TO: CONC FOUNDATION: | 12/S-311 |

| CONTINUOUS FOOTING SCHEDULE | | | | | |
|-----------------------------|-------|----------------------------------|------------|------------------|----------|
| MARK | WIDTH | MIN EMBED BELOW LOWEST PAD GRADE | LONG REINF | TRANS REINF | DETAIL |
| C1.25 | 1'-3" | SEE NOTE 16 | (2) #5 T&B | #3 @ 12" OC, BOT | 31/S-311 |


| GRADE BEAM SCHEDULE | | | | | | |
|---------------------|-------|-----------|----------------------------------|------------------------------|-------------|----------|
| TYPE | WIDTH | THICKNESS | MIN EMBED BELOW LOWEST PAD GRADE | LONG REINF | TRANS REINF | DETAIL |
| G81 | 1'-0" | 1'-0" | SEE NOTE 16 | (2) #4 @ TOP (2) #4 @ BOT | #3 @ 24" OC | 13/S-312 |

| PAD FOOTING SCHEDULE | | | | | | | |
|----------------------|-------|--------|-----------|----------------------------------|------------|-------------|----------|
| TYPE | WIDTH | LENGTH | THICKNESS | MIN EMBED BELOW LOWEST PAD GRADE | TOP REINF | BOT REINF | DETAIL |
| F2 | 2'-0" | 2'-0" | 1'-6" | SEE NOTE 16 | (3) #5, EW | (3) #5 @ EW | 11/S-312 |

NOTE: FOOTING MUST BE DEEPEMED LOCALLY PER DETAIL 32/S-301 TO ACCOMMODATE AB HOLD-DOWN EMBED DEPTHS.

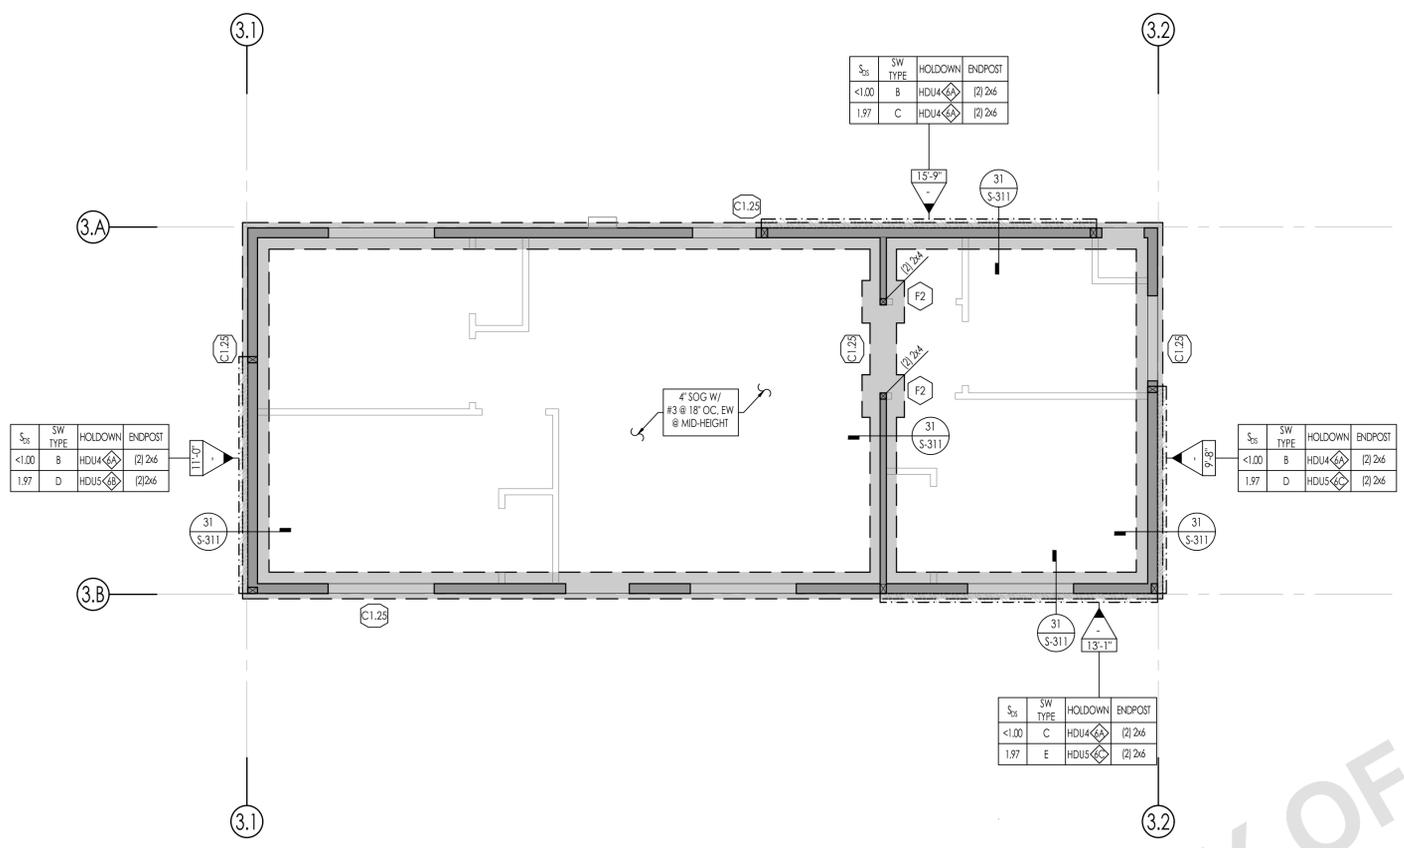

1 FOUNDATION PLAN - MID CENTURY MODERN - NO PORCH OPT.
SCALE: 1/4" = 1'-0"

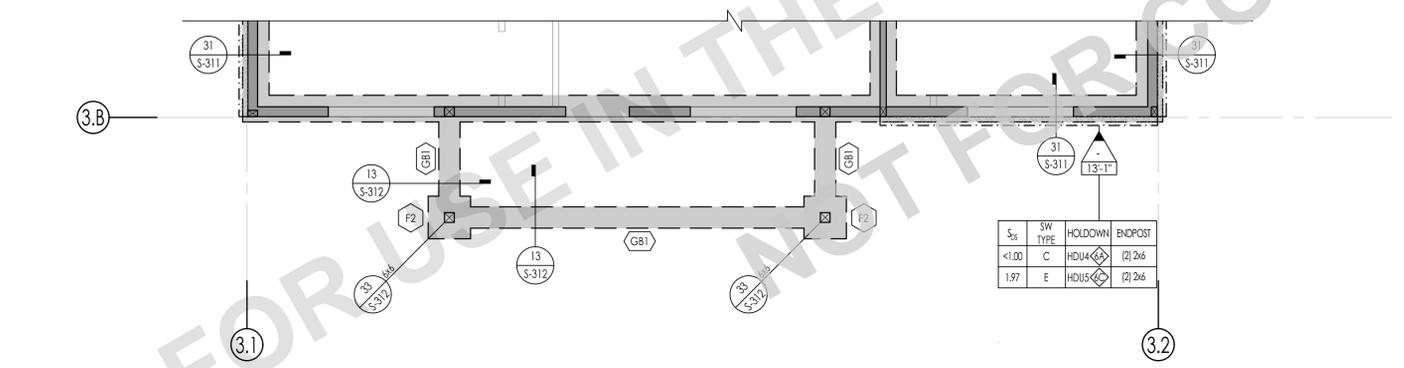

2 FOUNDATION PLAN - MID CENTURY MODERN - PORCH
SCALE: 1/4" = 1'-0"



N:\2020\2727-01\2020-00-county\ad\Structural\ConDoc\Sheet\Plan_3\mid century\2727-01_C022_Plan_3.dwg, 13/201, Sep 28, 2023, 4:38pm, obosaz

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA

FOUNDATION PLAN - MID CENTURY MODERN

DATE
09/28/2023

SHEET

S-201



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONSTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

ROOF FRAMING NOTES

- SEE ARCHITECTURAL DRAWINGS FOR ALL DIMENSIONS AND ELEVATIONS INCLUDING, BUT NOT LIMITED TO THE FOLLOWING. ALL DIMENSIONS TO BE VERIFIED PRIOR TO CONSTRUCTION:
 - GRID DIMENSIONS AND HORIZONTAL CONTROL
 - ALL DIMENSIONS, ELEVATIONS, FINISH SURFACE, SLOPES, DRAINS, SLAB DEPRESSIONS, ETC
 - LOCATION AND EXTENT OF EXTERIOR WALL ASSEMBLIES AND OPENINGS
 - ALL NON STRUCTURAL WALLS
- REFER TO THE FOLLOWING SHEETS FOR TYPICAL DETAILS:

| DESCRIPTION | SHEET (S) |
|---------------------------|---------------|
| SYMBOLS AND ABBREVIATIONS | S-101 |
| STRUCTURAL GENERAL NOTES | S-102 - S-103 |
| TESTING AND INSPECTION | S-103 |
| TYPICAL CONCRETE DETAILS | S-301 |
| TYPICAL WOOD DETAILS | S-401 - S-405 |
- SEE ARCHITECTURAL DRAWINGS FOR ALL TOP OF SHEATHING AND TOP OF WALL ELEVATIONS.
- SEE ARCHITECTURAL, PLUMBING, MECHANICAL AND ELECTRICAL DRAWINGS FOR SIZE AND LOCATION OF PIPES, DUCTS AND OTHER ROOF PENETRATIONS. FOR ROOF PENETRATIONS NOT SHOWN ON ROOF FRAMING PLAN, SEE DETAIL 23/S-403 FOR TYPICAL OPENINGS, UNO.
- ALL POSTS IN 6" WALLS SHALL BE 6x6, UNLESS NOTED OTHERWISE.
 TYPICAL WALL FRAMING SHALL BE:
 2x6 @ 16" OC @ ALL EXTERIOR WALLS, UNO
 2x4 @ 16" OC @ ALL INTERIOR BEARING WALLS, UNO
 2x4 @ 16" @ ALL INTERIOR NON-BEARING WALLS, UNO
- ALL INTERIOR WALLS NOT SHOWN ON THE STRUCTURAL FRAMING PLANS BUT SHOWN ON THE ARCHITECTURAL DRAWINGS SHALL BE CONSTRUCTED PER NON-BEARING PORTION WALL DETAIL 43/S-401, UNO.
- DIAPHRAGM TYPES:
 ALL ROOF DIAPHRAGMS SHALL BE TYPE A, UNO REFER TO 12/S-403
- ALL LINES AND/OR MEMBERS INDICATED AS "STRUT" SHALL RECEIVE (2) ROWS OF BOUNDARY NAILING (BN), STGR.
- TRUSS MEMBERS AND COMPONENTS SHALL NOT BE CUT, NOTCHED, DRILLED OR OTHERWISE ALTERED IN ANY WAY WITHOUT WRITTEN CONCURRENCE AND APPROVAL OF A REGISTERED DESIGN PROFESSIONAL.
- ALTERATIONS RESULTING IN THE ADDITION OF LOADS TO ANY MEMBER (E.G. HVAC EQUIPMENT, WATER HEATER) SHALL NOT BE PERMITTED WITHOUT VERIFICATION THAT THE TRUSS IS CAPABLE OF SUPPORTING SUCH ADDITIONAL LOADING.

SYMBOL LEGEND

- INDICATES SHEAR WALL TYPE AND LENGTH. SEE SCHEDULE ON 13/S-402
- INDICATES BLOCKING & STRAPPING ABOVE & BELOW WINDOW OPENINGS PER DETAIL 44/S-402
- INDICATES HEADER @ OPENING. REFER TO 32/S-401 FOR HEADER SIZE, UNO ON PLANS
- INDICATES TOP PLATE SPLICE NAILING PER 33/S-403. NOTE THAT NAILING APPLIES TO ENTIRE LENGTH OF TOP PLATE. PROVIDE TYPE (C) SPLICE, UNO
- INDICATES STRAP PER 34/S-405, UNO

SCHEDULES

| HOLDOWN SCHEDULE | | |
|--------------------------------|---|----------|
| SPECIFIES HOLDOWN/STRAP DETAIL | INDICATES HOLDOWN/STRAP TYPE | DETAIL |
| | INDICATES SIMPSON SSB HOLDOWN TO: CONVC FOUNDATION: | 22/S-311 |

| ROOF BEAM SCHEDULE | | |
|--------------------|-----------------------|---------|
| MARK | SIZE | REMARKS |
| B1 | 4x6 SELECT STRUCTURAL | |
| B2 | 4x10 | |
| B3 | 6x10 | |

| ROOF RAFTER SCHEDULE | | |
|----------------------|--------------|---------|
| MARK | SIZE | REMARKS |
| R1 | 2x8 @ 16" OC | |


| HEADER SCHEDULE | | |
|-----------------|------|---------|
| MARK | SIZE | REMARKS |
| H1 | 6x8 | |
| H2 | 4x10 | |

PREFABRICATED ROOF TRUSS


1. FOR PREFABRICATED ROOF TRUSS NOTES SEE NOTES ON SHEET S-103

| ROOF TRUSS SCHEDULE | | |
|---------------------|--------------------------|------------------------------------|
| MARK | DESCRIPTION | REMARKS |
| RT | ROOF TRUSS (COMMON) | 24" OC MAX |
| SGT | STRUCTURAL GABLE TRUSS | |
| MT | MONO PITCH TRUSS | 24" OC MAX |
| JT | JACK TRUSS | 24" OC MAX |
| VJT | VALLEY JACK TRUSS | 24" OC MAX |
| CJT | CORNER JACK TRUSS | |
| GT | GIRDER TRUSS | |
| MGT | MONO PITCH GIRDER TRUSS | |
| DT (#) | DRAG TRUSS | |
| CGT | CALIFORNIA GIRDER TRUSS | |
| HR | HIP RAFTER / JACK RAFTER | |
| CHT | CALIFORNIA HIP TRUSS | 24" OC MAX |
| SCT | SCISSOR TRUSS | 24" OC MAX. CEILING SLOPE PER ARCH |

(#) - EQUALS DRAG FORCE IN LBS. DRAG FORCE IS AT A FACTORED LEVEL (0.7E) DRAG FORCES CALCULATED IN ACCORDANCE WITH ASCE 7-16 12.10.1.1. IN STRUCTURES ENTIRELY BRACED BY LIGHT FRAME SHEAR WALLS OR PORTIONS THEREOF. DRAG MEMBERS SHALL BE DESIGNED TO RESIST FORCES USING THE LOAD COMBINATIONS OF ASCE 7-16 SECTION 12.4.2.3 IN ALL OTHER STRUCTURES DRAGS SHALL INCLUDE THE EFFECT OF OVER-STRENGTH PER ASCE 7-16 12.4.3.2

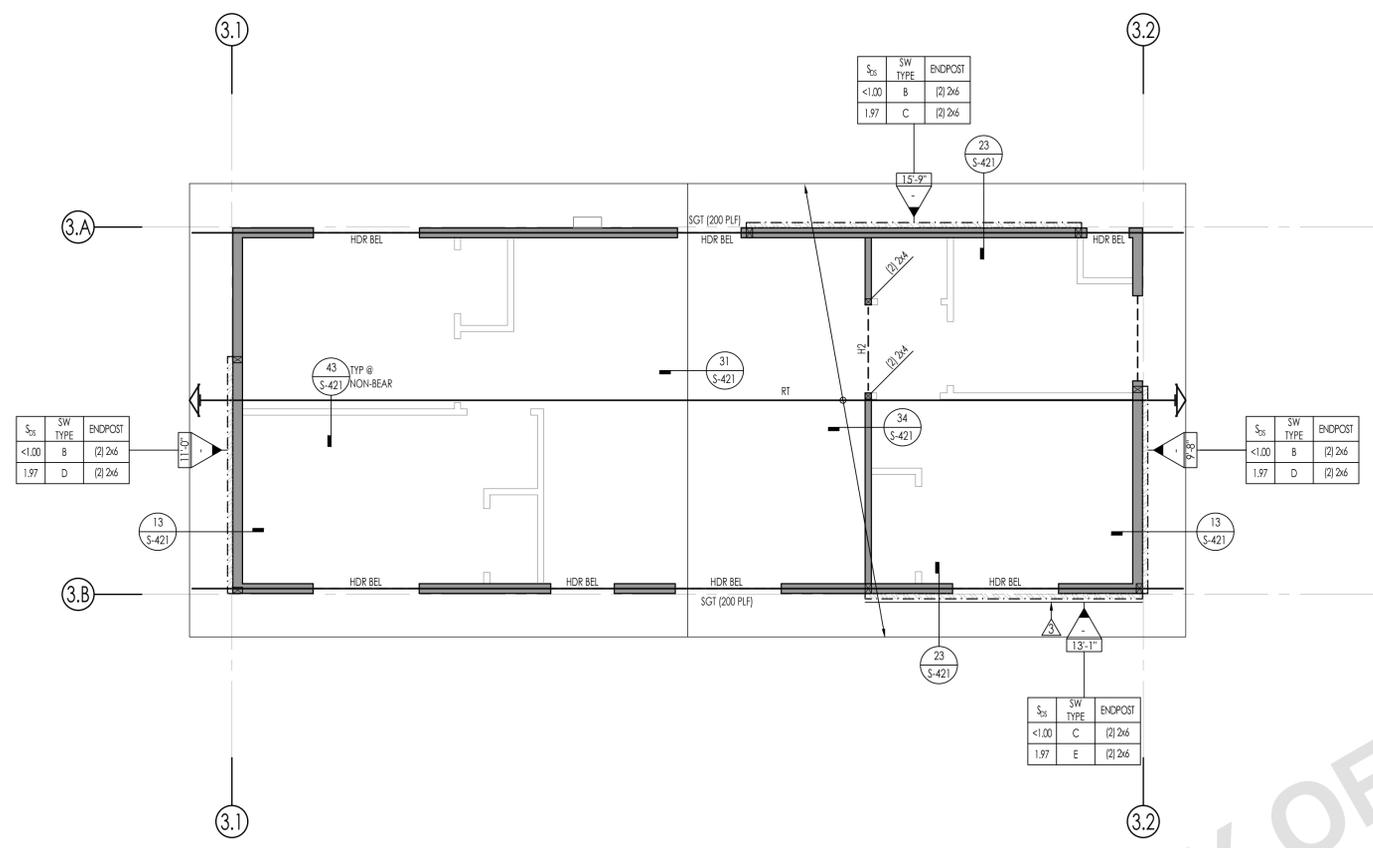

1 ROOF FRAMING PLAN - MID CENTURY MODERN - NO PORCH OPT.
SCALE: 1/4" = 1'-0"

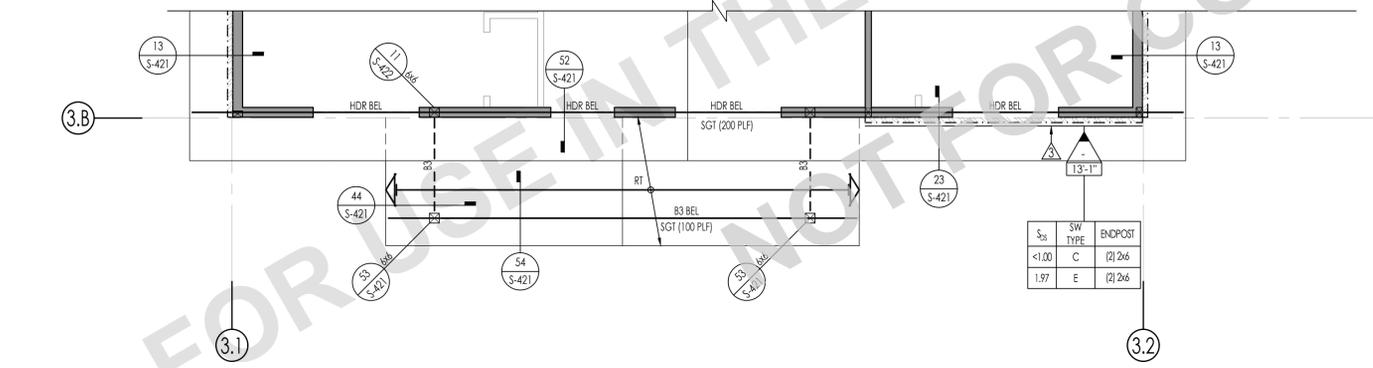

2 ROOF FRAMING PLAN - MID CENTURY MODERN - PORCH
SCALE: 1/4" = 1'-0"



COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA

ROOF FRAMING PLAN - MID CENTURY MODERN

DATE
09/28/2023



SHEET
S-202

N:\2020\2727-01-cu29-alc-county\ad\Structural\ConDoc\Sheet\Plan_3\mid-century\2727-01_CU27-01_Plan_3.dwg, 13/2023, Sep 28, 2023, 4:38pm, obcorz




THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONSTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA
TYPICAL CONCRETE DETAILS

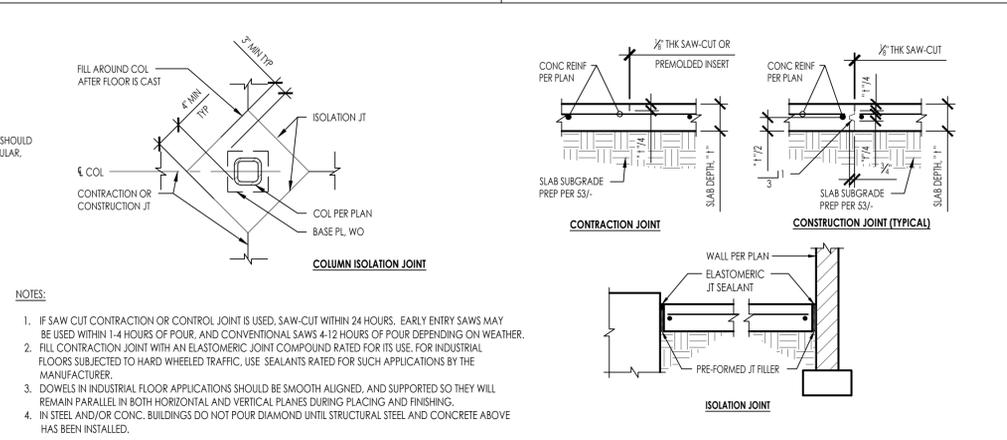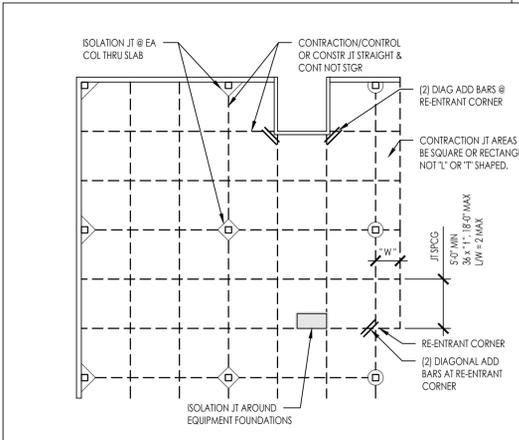


SLAB ON GRADE JOINTS
2727-01-C102 - S301



NTS 31

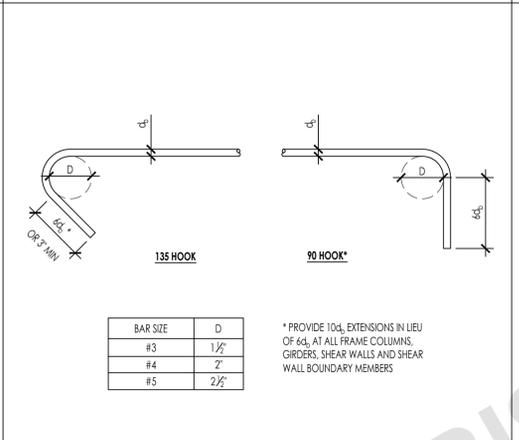

REIN TIES AND STIRRUPS
2727-01-C102 - S301

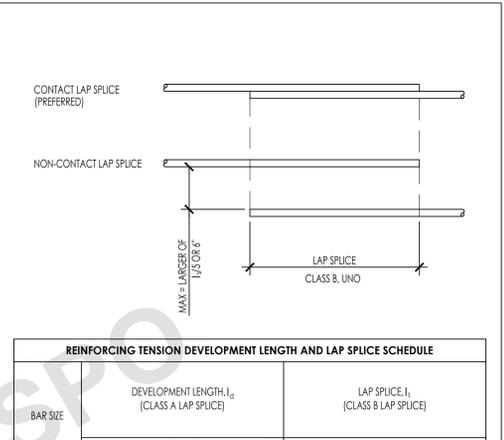


REINFORCING TENSION DEVELOPMENT LENGTH AND LAP SPLICE SCHEDULE
2727-01-C102 - S301

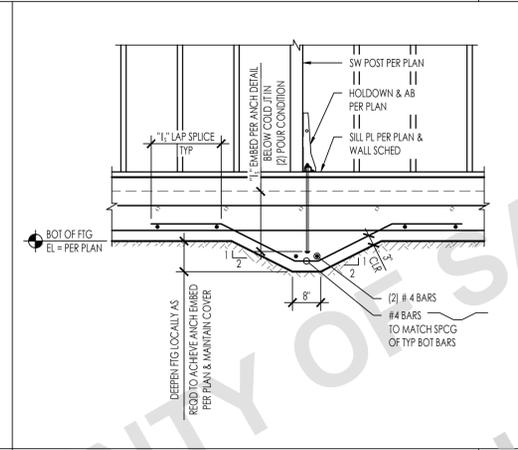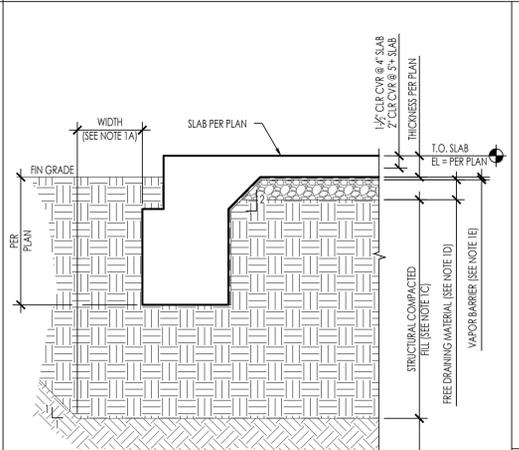

SLAB ON GRADE EDGE AND SUBGRADE PREP
2727-01-C102 - S301

DEEPEMED FTG @ ANCHOR BOLT
2727-01-C102 - S301

STEP FOOTING
2727-01-C102 - S301



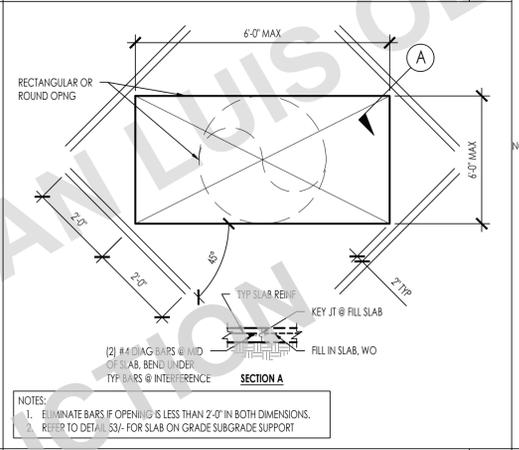


SOG OPENING
2727-01-C102 - S301

REINFORCING TENSION DEVELOPMENT LENGTH AND LAP SPLICE SCHEDULE

| BAR SIZE | DEVELOPMENT LENGTH l_d (CLASS A LAP SPLICE) | | LAP SPLICE l_s (CLASS B LAP SPLICE) | |
|----------|--|-------------|--|-------------|
| | f_c (psi) | f_c (psi) | f_c (psi) | f_c (psi) |
| | 2,500 | 3,000 | 4,000 | 2,500 |
| #3 | 1'-6" | 1'-5" | 1'-3" | 2'-0" |
| #4 | 2'-0" | 1'-10" | 1'-7" | 2'-8" |
| #5 | 2'-6" | 2'-4" | 2'-0" | 3'-3" |
| #6 | 3'-0" | 2'-9" | 2'-5" | 3-11" |
| #7 | 4'-5" | 4'-0" | 3'-6" | 5-9" |
| #8 | 5'-0" | 4-7" | 4-0" | 6-6" |
| #9 | 5-8" | 5-2" | 4-6" | 7-4" |
| #10 | 6-5" | 5-10" | 5-1" | 8-3" |
| #11 | 7-1" | 6-6" | 5-7" | 9-2" |


REIN DEVELOPMENT LENGTH AND SPLICES
2727-01-C102 - S301

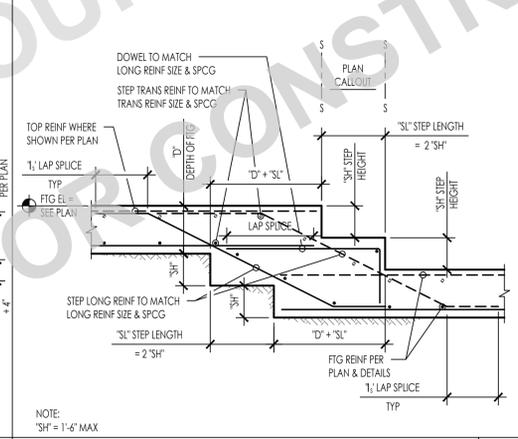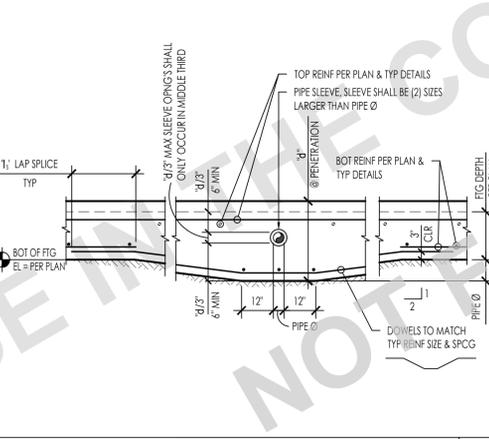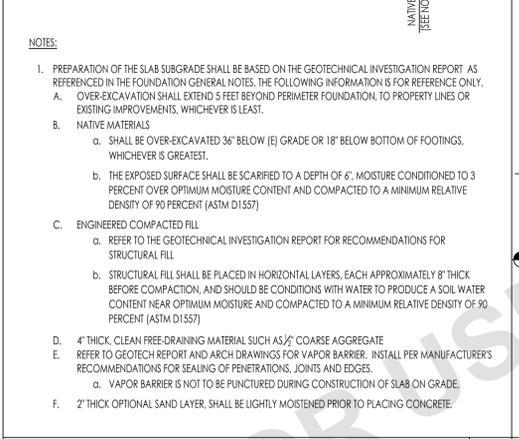


SLAB ON GRADE EDGE AND SUBGRADE PREP
2727-01-C102 - S301

SLEEVE THROUGH FOUNDATION (SLAB TURN-DOWN)
2727-01-C102 - S301




STEP FOOTING
2727-01-C102 - S301

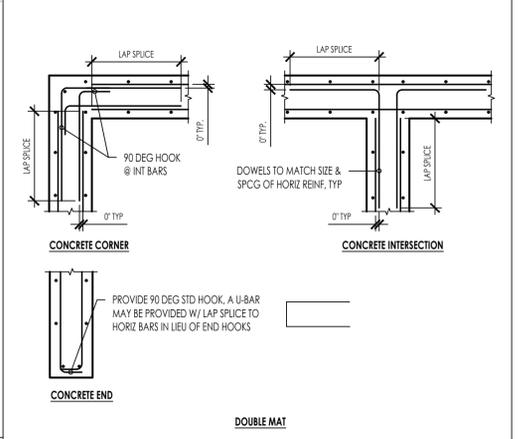

CONC REIN @ INTERSECTION
2727-01-C102 - S301

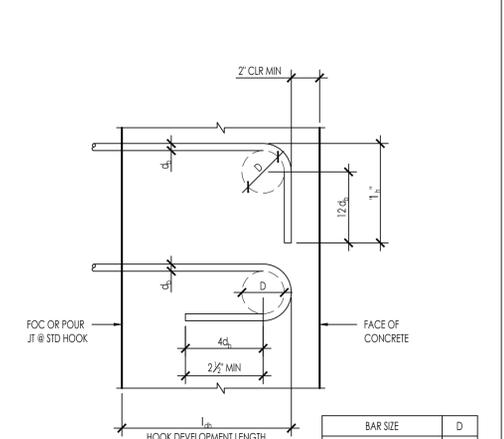


REIN HOOK DEVELOPMENT LENGTH AND BENDS
2727-01-C102 - S301

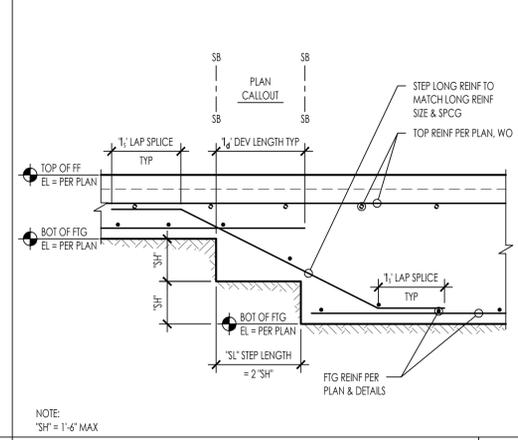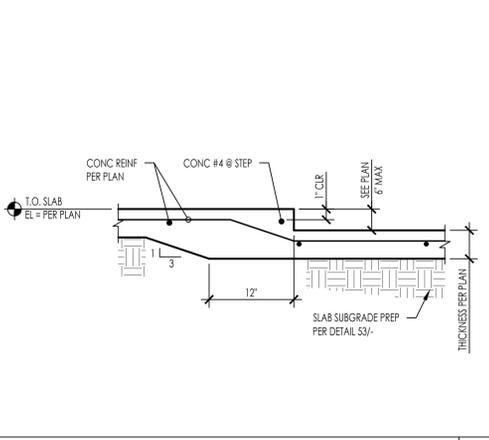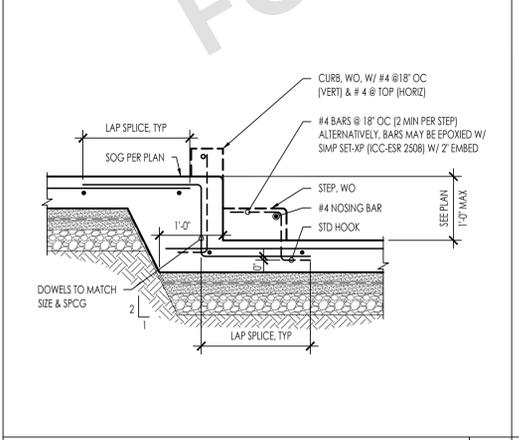

STEP IN CONCRETE SLAB ON GRADE
2727-01-C102 - S301

SLAB ON GRADE DEPRESSION
2727-01-C102 - S301

STEPPED FOOTING (BOTTOM ONLY)
2727-01-C102 - S301

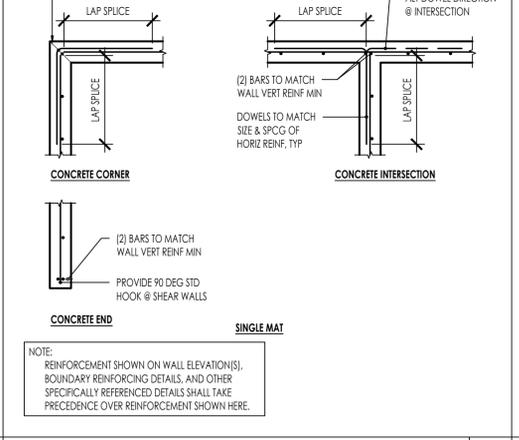

CONC REIN @ INTERSECTION
2727-01-C102 - S301

STANDARD HOOK DEVELOPMENT LENGTH l_{dh}

| BAR SIZE | D | l_{dh} | NORMAL WEIGHT | | |
|----------|---------|----------|---------------|-------|-------|
| | | | 2,500 | 3,000 | 4,000 |
| #3 | 2 1/4" | 6" | 0-9" | 0-9" | 0-8" |
| #4 | 3" | 8" | 1-0" | 0-11" | 0-10" |
| #5 | 3 3/4" | 10" | 1-3" | 1-2" | 1-0" |
| #6 | 4 1/2" | 12" | 1-6" | 1-5" | 1-3" |
| #7 | 5 1/4" | 1-2" | 1-9" | 1-8" | 1-5" |
| #8 | 6" | 1-4" | 2-0" | 1-10" | 1-7" |
| #9 | 9 1/2" | 1-7 1/2" | 2-3" | 2-1" | 1-10" |
| #10 | 10 3/4" | 1-10" | 2-7" | 2-4" | 2-1" |
| #11 | 12" | 2-0 1/2" | 2-10" | 2-7" | 2-3" |


REIN HOOK DEVELOPMENT LENGTH AND BENDS
2727-01-C102 - S301

DATE
09/28/2023
SHEET

S-301



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONSTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

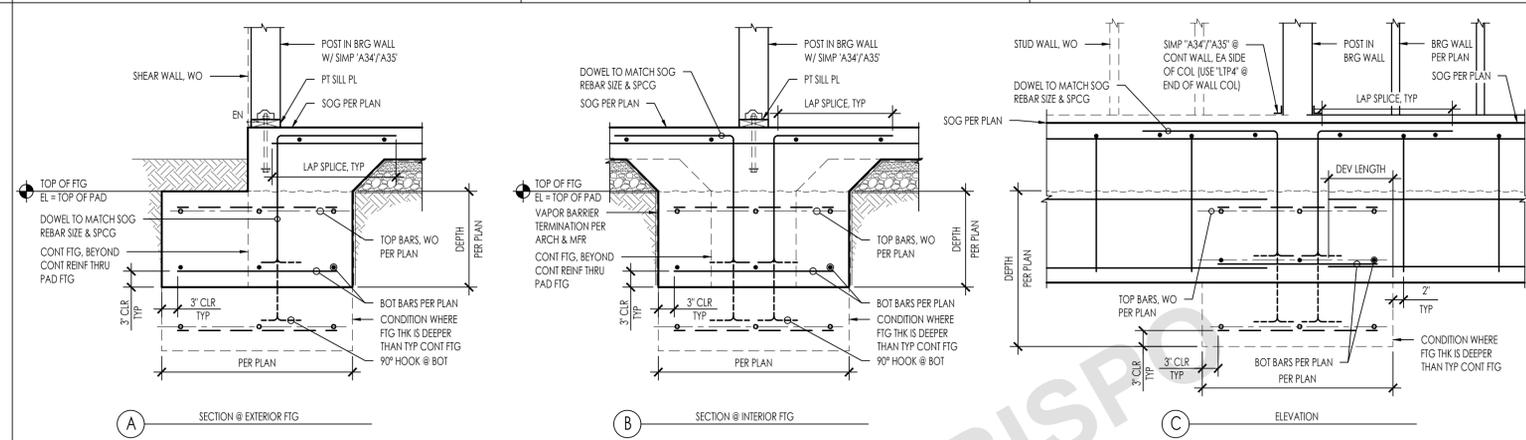

51

41


SPREAD FOOTING @ BEARING WALL POST

2727-01-C102-1312

3/4" = 1'-0" 11

52

42

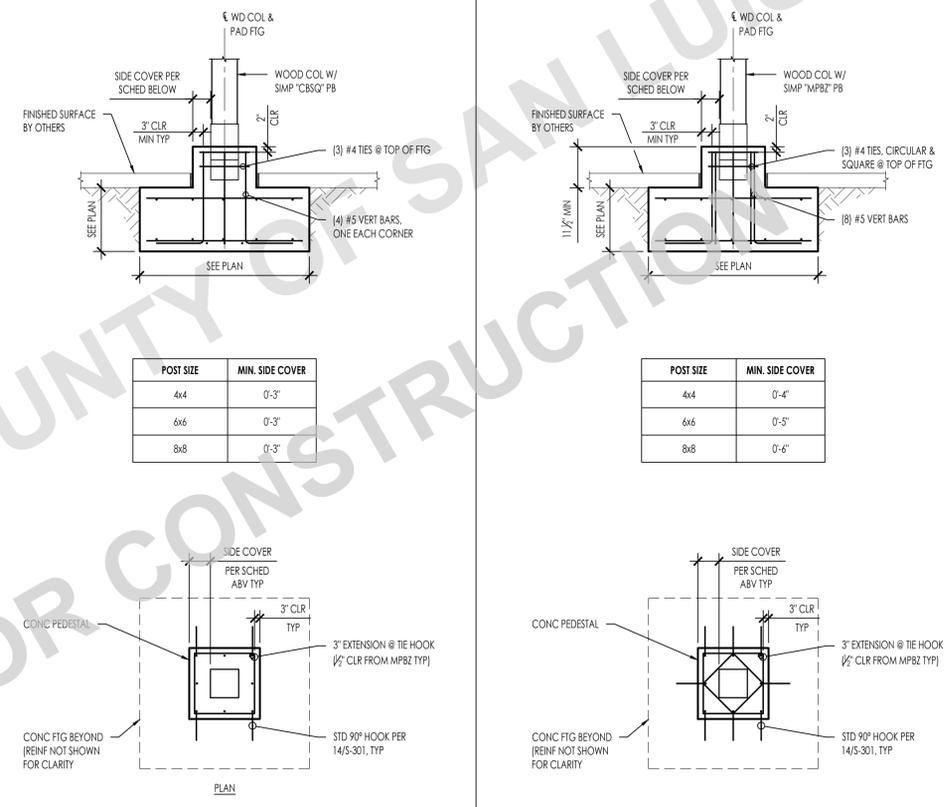

53

43

PORCH PAD FOOTING

2727-01-C102-1312-23

33

MOMENT BASE POST @ POLE FOOTING


2727-01-C102-1312

23

GRADE BEAM

2727-01-C102-1312

NTS 13

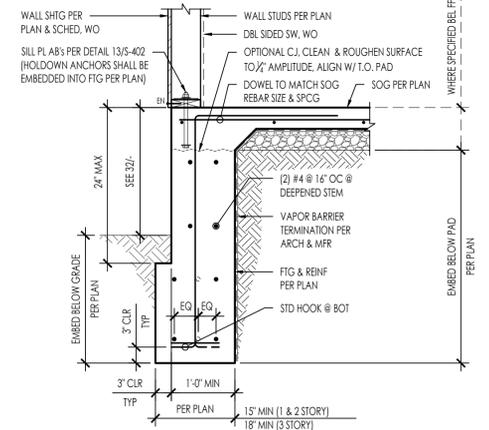

54

44

24

DEEPEND EXTERIOR FOOTING

2727-01-C102-1312

3/4" = 1'-0" 14

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
 SAN LUIS OBISPO, CA

CONCRETE DETAILS

DATE
09/28/2023

SHEET

S-312

N:\2000\2727-01-c102-acc-county\adul\structural\ConDoc\Sheet\Rein\2727-01-C102-1312.dwg, PLAN 3, \$312, Sep 28, 2023, 4:33pm, oadpse




THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONSTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

| BEARING/SHEAR WALL HEADER SCHEDULE | | | | | | | | | | | | |
|------------------------------------|-----------|----------------|----------------|------------|---------|---------|---------|---------------|-----------|----------------|----------------|------------|
| 4 INCH WALLS | | | | | 3-STORY | | | 2-STORY | | | 1-STORY | |
| OPENING WIDTH | 4x HEADER | SILL AT WINDOW | POST / TRIMMER | KING STUDS | 3-STORY | 2-STORY | 1-STORY | OPENING WIDTH | 6x HEADER | SILL AT WINDOW | POST / TRIMMER | KING STUDS |
| UP TO 3'-0" | 4x4 | 2x | 2x4 | 2x4 | | | | UP TO 3'-0" | 6x4 | 2x | 2x6 | 2x6 |
| 3'-0" - 5'-0" | 4x6 | 2x | 2x4 | 2x4 | | | | 3'-0" - 5'-0" | 6x6 | 2x | 2x6 | 2x6 |
| 5'-0" - 7'-0" | 4x8 | (2) 2x | (2) 2x4 | (2) 2x4 | | | | 5'-0" - 7'-0" | 6x8 | (2) 2x | 2x6 | (2) 2x6 |

| BEARING/SHEAR WALL HEADER SCHEDULE | | | | | | | | | | | | |
|------------------------------------|-----------|----------------|----------------|------------|---------|---------|---------|---------------|-----------|----------------|----------------|------------|
| 8 INCH WALLS | | | | | 3-STORY | | | 2-STORY | | | 1-STORY | |
| OPENING WIDTH | 8x HEADER | SILL AT WINDOW | POST / TRIMMER | KING STUDS | 3-STORY | 2-STORY | 1-STORY | OPENING WIDTH | 6x HEADER | SILL AT WINDOW | POST / TRIMMER | KING STUDS |
| UP TO 3'-0" | 6x8 FLAT | 2x | 2x6 | 2x6 | | | | UP TO 3'-0" | 6x6 | 2x | 2x6 | 2x6 |
| 3'-0" - 5'-0" | 6x8 FLAT | 2x | 2x6 | 2x6 | | | | 3'-0" - 5'-0" | 6x8 | 2x | 2x6 | 2x6 |
| 5'-0" - 7'-0" | 6x8 FLAT | (2) 2x | 2x6 | (2) 2x6 | | | | 5'-0" - 7'-0" | 6x12 | (2) 2x | 2x6 | (2) 2x6 |


NOTES:
 1. THIS DETAIL APPLIES AT ALL EXT WALLS AND INT LOAD BEARING WALLS AND ALSO APPLIES TO SHEAR WALL FRAMING
 A. FOR SHEAR WALLS SEE 3415-402 FOR ADD'L REQUIREMENTS.
 B. FOR INTERIOR NON-BEARING PARTITIONS SEE DETAIL 431.
 2. HEADERS, KING STUDS AND OTHER REFERENCES ON PLAN GOVERN OVER THIS TYPICAL SCHED/DETAILS
 3. PROVIDE A34 @ 4" WALLS & A35 @ 6" OR GREATER WALLS (ICC-ESR 2523)

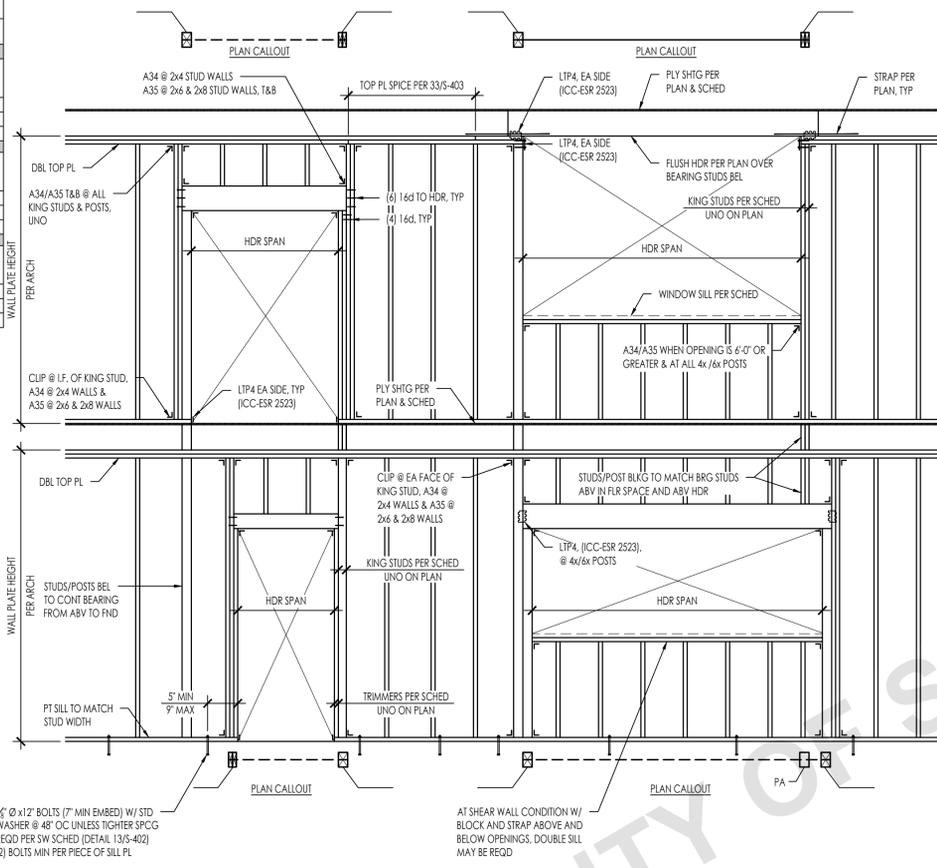

| FASTENING SCHEDULE PER 2022 CBC 2304.10.1 | | |
|--|-------------------------|--|
| CONNECTION | FASTENING | LOCATION |
| 1. BLOCKING BETWEEN CEILING JOISTS, RAFTERS OR TRUSSES TO TOP PLATE OR OTHER FRAMING BELOW | 3-8d COMMON | EACH END, TOENAIL |
| 2. BLOCKING BETWEEN RAFTERS OR TRUSSES NOT AT THE WALL TO TOP PLATE, TO RAFTER OR TRUSS | 2-8d COMMON | EACH END, TOENAIL |
| 3. FLAT BLOCKING TO TRUSS AND WEB FILLER | 1-6d COMMON @ 6" OC | FACE NAIL |
| 4. CEILING JOIST TO TOP PLATE | 3-8d COMMON | EACH JOIST, TOENAIL |
| 5. CEILING JOIST NOT ATTACHED TO PARALLEL RAFTER, LAPS OVER PARTITIONS | 3-16d COMMON | FACE NAIL |
| 6. CEILING JOIST ATTACHED TO PARALLEL RAFTER (HEEL JOINT) | 3-16d COMMON | FACE NAIL |
| 7. COLLAR TIE TO RAFTER | 3-10d COMMON | FACE NAIL |
| 8. RAFTER OR ROOF TRUSS TO PLATE | 3-10d COMMON | TOENAIL ² |
| 9. ROOF RAFTER TO RIDGE VALLEY OR HIP RAFTER; OR ROOF RAFTER TO 2-INCH RIDGE BEAM | 2-16d COMMON | END NAIL |
| 10. STUD TO STUD AND ABUTTING STUDS AT INTERSECTING WALL CORNERS | 3-10d COMMON | TOENAIL |
| 11. BUILT-UP HEADER (2" TO 2" HEADER) | 1-6d COMMON | 1/4" OC EACH EDGE, FACE NAIL |
| 12. CONTINUOUS HEADER TO STUD | 4-10d COMMON | TOENAIL |
| 13. TOP PLATE TO TOP PLATE | 1-6d COMMON | 1/4" OC FACE NAIL |
| 14. TOP PLATE TO TOP PLATE, AT END JOINTS | 8-16d COMMON | EACH SIDE OF END JOINT, FACE NAIL (MINIMUM 24" LAP SPURCE LENGTH EACH SIDE OF END JOINT) |
| 15. BOTTOM PLATE TO JOIST, RIM JOIST, BAND JOIST OR BLOCKING | 2-16d COMMON | 1/4" OC FACE NAIL |
| 16. STUD TO TOP OR BOTTOM PLATE | 4-8d COMMON | TOENAIL |
| 17. TOP PLATES, LAPS AT CORNERS AND INTERSECTIONS | 2-16d COMMON | FACE NAIL |
| 18. JOIST TO SILL, TOP PLATE, OR GIRDER | 3-8d COMMON | TOENAIL |
| 20. RIM JOIST, BAND JOIST, OR BLOCKING TO TOP PLATE, SILL OR OTHER FRAMING BELOW | 8d COMMON | 6" OC, TOENAIL |
| 21. 1"x6" SUBFLOOR OR LESS TO EACH JOIST | 2-8d COMMON | FACE NAIL |
| 22. 2" SUBFLOOR TO JOIST OR GIRDER | 2-16d COMMON | FACE NAIL |
| 23. BUILT-UP GIRDER AND BEAMS, 2" LUMBER LAYERS | 20d COMMON (4" x 0.192) | 32" OC FACE NAIL AT TOP AND BOTTOM STAGGERED ON OPPOSITE SIDE |
| 24. LEDGER STRIP SUPPORTING JOIST OR RAFTERS | 3-16d COMMON | EACH JOIST OR RAFTER, FACE NAIL |
| 26. JOIST TO BAND JOIST OR RIM JOIST | 3-16d COMMON | END NAIL |
| 27. BRIDGING OR BLOCKING TO JOIST, RAFTER OR TRUSS | 2-8d COMMON | EACH END, TOENAIL |


NOTES:
 a. THIS NAILING SCHEDULE SHALL ONLY BE USED IF CONDITION IS NOT OTHERWISE DETAILED OR SPECIFIED ON THE CONSTRUCTION DOCUMENTS. COMMON NAILS SHALL BE USED EXCEPT WHERE OTHERWISE NOTED.
 b. WHERE A RAFTER IS FASTENED TO AN ADJACENT PARALLEL CEILING JOIST IN ACCORDANCE WITH THIS SCHEDULE AND THE CEILING JOIST IS FASTENED TO THE TOP PLATE IN ACCORDANCE WITH THIS SCHEDULE, THE NUMBER OF TOENAILS IN THE RAFTER SHALL BE PERMITTED TO BE REDUCED BY ONE NAIL.

EXTERIOR WALL / INTERIOR WALL BEARING WALL FRAMING

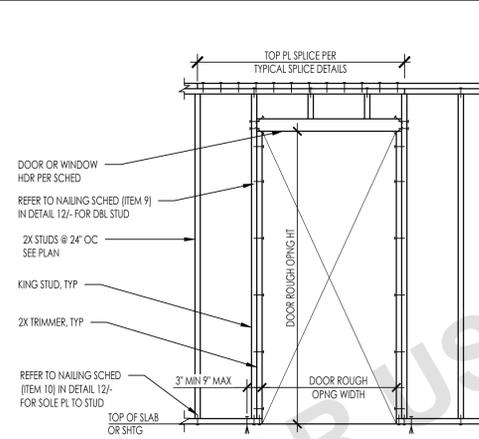

| HEADER SCHEDULE | | |
|-----------------|-----------------|-----------------|
| OPENING WIDTH | 2x4 WALL HEADER | 2x6 WALL HEADER |
| < 4'-0" | 4x4 | 4x6 FLAT |
| 4'-0" - 6'-0" | 4x4 | 4x6 FLAT |
| 6'-0" - 8'-0" | 4x6 | 4x6 FLAT |
| 8'-0" - 10'-0" | 4x6 | 6x6 |


NOTE:
 1. HEADERS, KING STUDS AND OTHER REFERENCES ON PLAN GOVERN OVER THESE TYPICAL SCHEDULES/DETAILS
 2. NAIL SILL PLATE TO WOOD FRAMED FLOORS WITH 1-6d @ 12" OC.

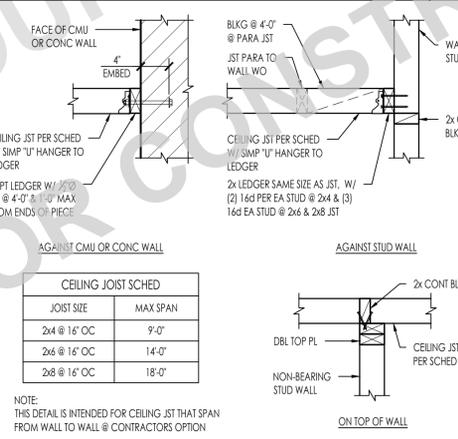

| CEILING JOIST SCHED | |
|---------------------|----------|
| JOIST SIZE | MAX SPAN |
| 2x4 @ 16" OC | 9'-0" |
| 2x6 @ 16" OC | 14'-0" |
| 2x8 @ 16" OC | 18'-0" |


NOTE:
 THIS DETAIL IS INTENDED FOR CEILING JST THAT SPAN FROM WALL TO WALL @ CONTRACTORS OPTION

INTERIOR NON-BEARING PARTITION WALL FRAMING




54

CEILING JOIST SCHED & DETAILS




44

CEILING JOIST SCHED & DETAILS

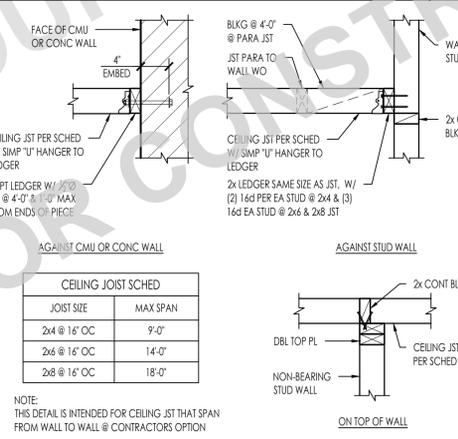


CEILING JOIST SCHED & DETAILS




34

TYPICAL WOOD STUD INTERSECTIONS



TYPICAL WOOD STUD INTERSECTIONS

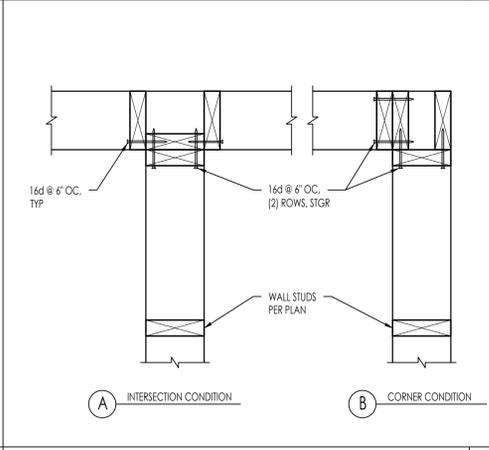


34

MULTI-PLY MEMBER CONNECTION



MULTI-PLY MEMBER CONNECTION

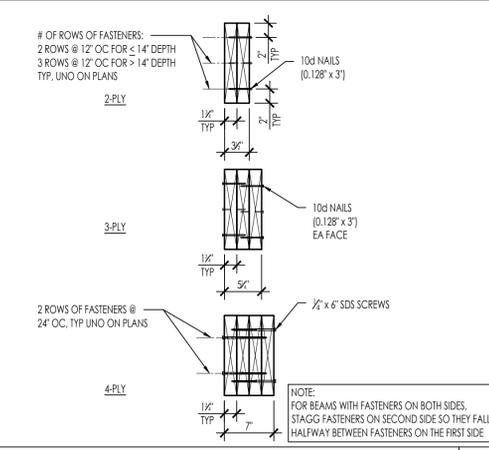

14

COUNTY OF SAN LUIS OBISPO
 ACCESSORY DWELLING UNIT
 SAN LUIS OBISPO, CA

TYPICAL WOOD DETAILS

DATE
 09/28/2023
 SHEET

S-401


N:\2020\2727\01\c202-acc-county\add\structural\ConDoc\Sheet\2727-01-C1022-540.dwg, PLAN 3 - 540, Sep 28, 2023 4:33pm, onpbr




THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONSTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA
TYPICAL WOOD DETAILS

DATE
09/28/2023
SHEET
S-402

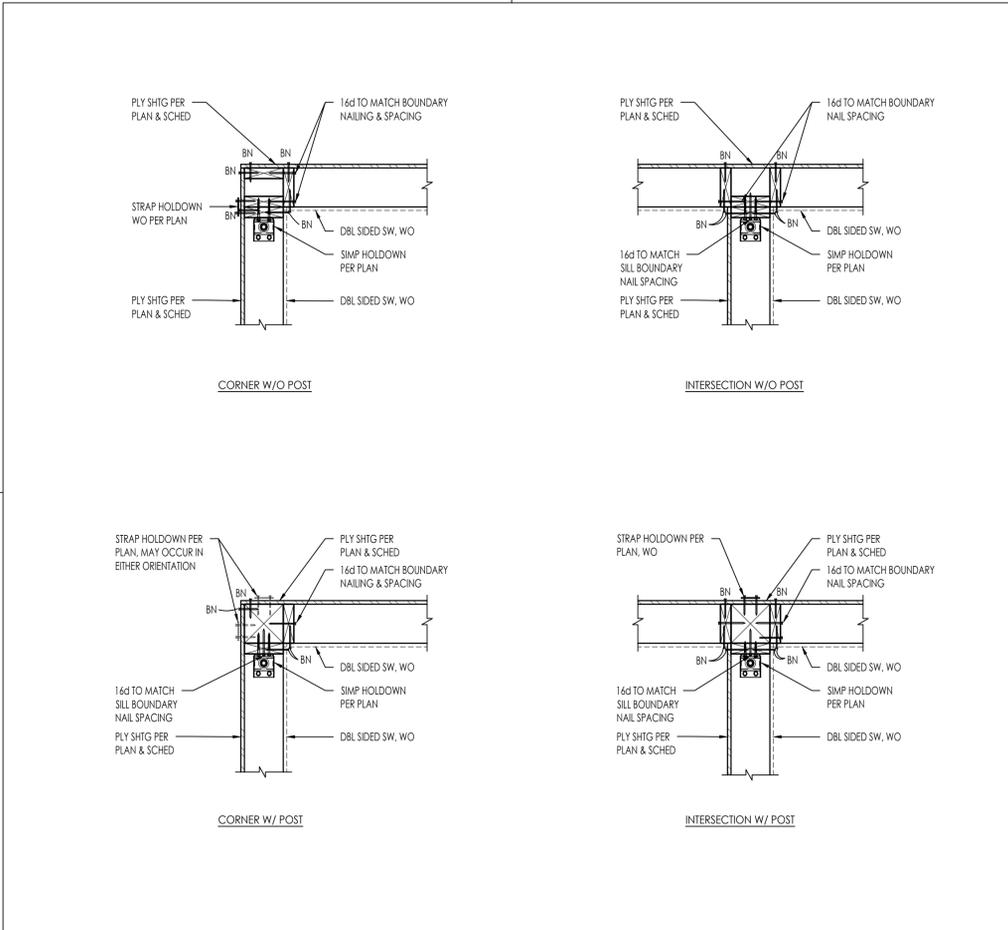

SHEAR WALL INTERSECTION NTS 42

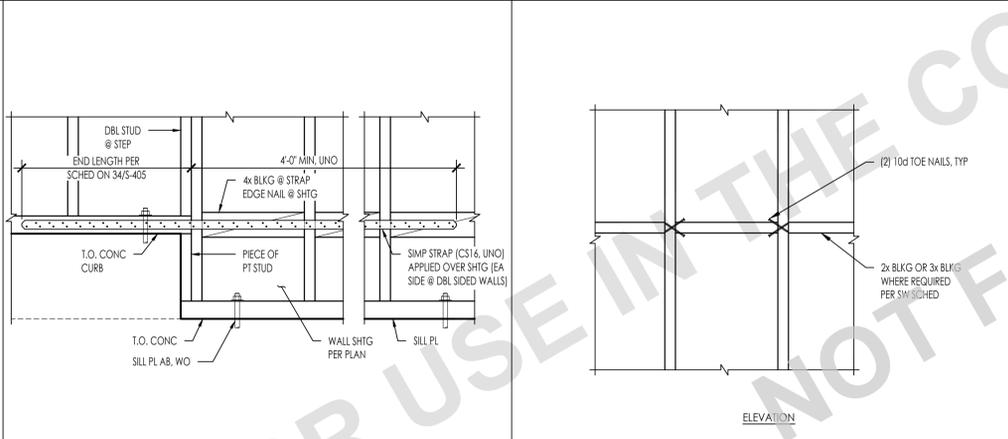


STRAP AT STEP IN SHEAR WALL SILL PLATE NTS 53 TYPICAL BLOCKING DETAIL NTS 43

| MARK | # OF BLKG | SIMPSON STRAP | NAILS EA SIDE OF OPENING | STRAP LENGTH (IN) | ALLOWABLE TENSION LOADS (LBS) |
|------|-----------|---------------|--------------------------|-------------------|-------------------------------|
| ▽1 | 1 | CS20 | (12) 10d x 2 1/2" | 32 | 1,030 |
| ▽2 | 1 | CS16 | (20) 10d x 2 1/2" | | 1,705 |
| ▽3 | 1 | CS14 | (26) 10d x 2 1/2" | 39 | 2,490 |
| ▽4 | 2 | CMST16 | (50) 10d x 3 1/2" | | 4,690 |
| ▽5 | 2 | CMST14 | (66) 10d x 2 1/2" | 39 | 6,475 |
| ▽6 | 2 | CMST12 | (86) 10d x 2 1/2" | | 9,215 |

NOTES:
1. 2 BAYS OR 32" MIN STRAP LENGTH
2. BOUNDARY AND EDGE NAILING FROM PLYWOOD TO STUDS / FRAMING SHALL OCCUR ABOVE AND BELOW OPENINGS AT THIS CONDITION
3. SEE TYPICAL SHEAR WALL ELEVATION FOR BALANCE OF INFO NOT SHOWN

FORCE TRANSFER AROUND OPENINGS NTS 44

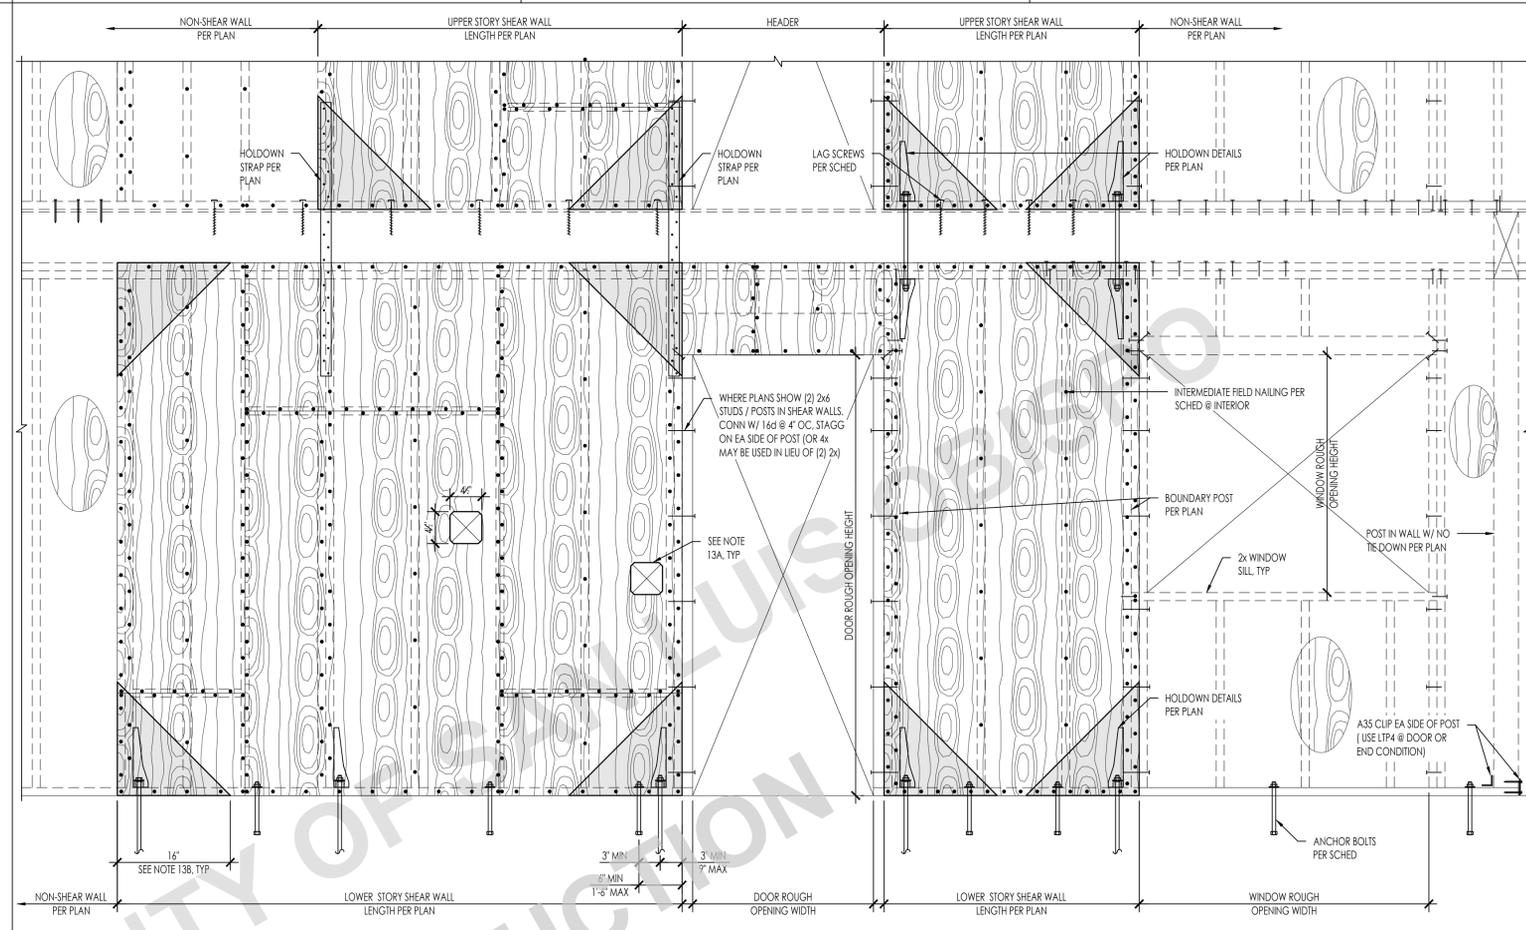

TYPICAL SHEAR WALL ELEVATION AND SCHEDULE NTS 13

| WALL SYMBOL | STRUCT SHEATHING | FRAMING SIZE | NAILING | | | | SILL NAILING | | ANCHOR BOLTING | CAPACITY PER 2015 AWC SDPWS |
|-------------|---|--------------------|-------------|--------------|--------------------------|--------------------|--------------|-------------------|----------------|-----------------------------|
| | | | (2) 2x STUD | EDGE | INTERMEDIATE SUPPORTS | NAILS / LAG SCREWS | 8 | 14 | | |
| △ | 15/32" STRUCT 1 PLYWOOD | 2x 10d @ 8" OC | 8d @ 6" OC | 8d @ 12" OC | 16d @ 6" OC | 12" OC | 24" OC | 5/8" DIA @ 48" OC | 280 PLF | |
| △ | 15/32" STRUCT 1 PLYWOOD | 2x 10d @ 8" OC | 10d @ 6" OC | 10d @ 12" OC | 5/8" LAG SCREWS @ 16" OC | 12" OC | 16" OC | 5/8" DIA @ 48" OC | 340 PLF | |
| △ | 15/32" STRUCT 1 PLYWOOD | 2x 10d @ 8" OC | 10d @ 4" OC | 10d @ 12" OC | 5/8" LAG SCREWS @ 16" OC | 8" OC | 12" OC | 5/8" DIA @ 32" OC | 510 PLF | |
| △ | 15/32" STRUCT 1 PLYWOOD | 2x 10d @ 4" OC | 10d @ 3" OC | 10d @ 12" OC | 5/8" LAG SCREWS @ 16" OC | 6" OC | 8" OC | 5/8" DIA @ 32" OC | 665 PLF | |
| △ | 15/32" STRUCT 1 PLYWOOD | 2x 10d @ 3" OC | 10d @ 2" OC | 10d @ 12" OC | 5/8" LAG SCREWS @ 8" OC | 4" OC | 8" OC | 5/8" DIA @ 24" OC | 860 PLF | |
| △ | 15/32" STRUCT 1 PLYWOOD (EACH FACE OF WALL) | 3x (2) 10d @ 5" OC | 10d @ 4" OC | 10d @ 12" OC | 5/8" LAG SCREWS @ 8" OC | (2) @ 8" OC * | 6" OC | 5/8" DIA @ 16" OC | 1020 PLF | |
| △ | 15/32" STRUCT 1 PLYWOOD (EACH FACE OF WALL) | 3x (2) 10d @ 4" OC | 10d @ 3" OC | 10d @ 8" OC | 5/8" LAG SCREWS @ 8" OC | (2) @ 6" OC * | A34 @ 4" OC | 5/8" DIA @ 16" OC | 1330 PLF | |
| △ | 15/32" STRUCT 1 PLYWOOD (EACH FACE OF WALL) | 3x (2) 10d @ 3" OC | 10d @ 2" OC | 10d @ 6" OC | 5/8" LAG SCREWS @ 6" OC | (2) @ 4" OC * | LTP4 @ 4" OC | 5/8" DIA @ 8" OC | 1740 PLF | |

NOTES:
1. ALL PLYWOOD SHALL BE 5 PLY MINIMUM WITH A SPAN RATING OF 32/16 AND ALL PANEL EDGES SHALL BE BLOCKED. PROVIDE 1/8" GAP AT ALL PANEL JOINTS.
2. ALL NAILS SHALL BE COMMON NAILS.
3. PROVIDE E.N. AT ALL END STUDS, STUDS/POSTS WITH HOLDOWNS OR THE DOWN STRAPS, SILL PLATES AND TOP PLATES.
4. WHERE 10d NAILS ARE 3 INCHES ON CENTER OR LESS, NAILS SHALL BE STAGGERED.
5. NAILS SHALL BE 1/2 INCH MINIMUM FROM PLYWOOD PANEL EDGE AND 3/8 INCH MINIMUM FROM CONNECTING MEMBER EDGE WHERE SHEAR EXCEEDS 300 PLF.
6. USE 3x FRAMING AT BOTTOM SILL PLATES. BLOCKING AND ALL STUDS AT ADJACENT PANEL EDGES WHERE SHEAR EXCEEDS 300 PLF. STRUCTURALLY ACCEPTABLE TO USE (2) 2x INSTEAD OF 3x FRAMING AT BOTTOM SILL PLATES.
7. WHERE SILL SHEAR TRANSFER IS THROUGH LAG SCREWS, SILL PLATE SHALL BE A MINIMUM OF 2 1/2" THICK.
8. LAG SCREWS SHALL BE 6 INCHES LONG AND HOLES ARE TO BE PRE-DRILLED AS TO NOT SPLIT BLOCKING/RIM.
9. SEE ELEVATION ABOVE FOR TYPICAL CONSTRUCTION.
10. REFER TO PLATE WASHER DETAIL FOR REQUIREMENTS.
11. LENGTHEN ANCHOR BOLTS AS REQUIRED FOR EMBEDMENT AND SILL PLATE THICKNESS.
12. ORIENTED STRAND BOARD (OSB) MAY BE SUBSTITUTED FOR PLYWOOD NOTED ABOVE PROVIDED IT IS RATED BY APA'S PERFORMANCE STANDARD RATING AND IS OF THE SAME NUMBER OF LAYERS AS PLYWOOD PLY INDICATED.
13. LIMITATIONS OF MECHANICAL PENETRATIONS IN SHEAR WALLS:
A. 4 1/2" MAX PENETRATION.
B. NO CUTS OR HOLES IN SHEATHING WITHIN 16" OF CORNERS, SQUARE PENETRATIONS SHALL RADIUS EDGES. DO NOT OVER CUT HOLE WITH SAW.
14. ASSUMES A 1 1/4" MIN LSI RIM BOARD. FASTENER EDGE DIST IS 5/8" MIN & 6" END DISTANCE MIN. 2" MIN PENETRATION INTO RIM BOARD.
* WALL W/ DOUBLE SIDED PLYWOOD REQUIRE (2) RIM BOARDS.
15. SIMPSON LTP4 CLIP SHALL BE INSTALLED IN A HORIZONTAL ORIENTATION. IF CLIP IS INSTALLED OVER THE SHEATHING, 0.131" x 2 1/2" NAILS SHALL BE USED.

TYPICAL SHEAR WALL ELEVATION AND SCHEDULE NTS 13


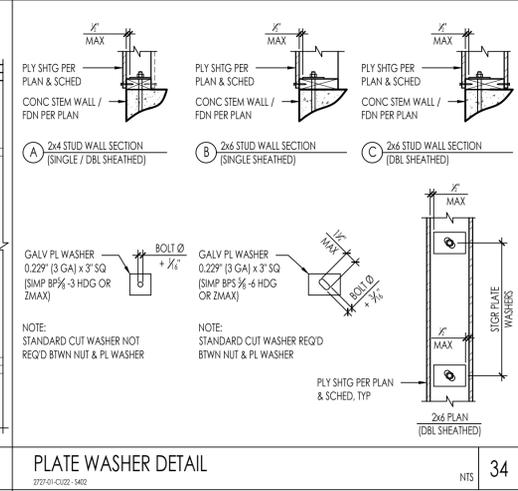


PLATE WASHER DETAIL NTS 34




DOUBLE SIDED SHEAR WALL NTS 24 2x STUD NAILING @ ADJOINING PANEL EDGES NTS 14


N:\2020\2727-01-c022-ak-county\adu\Structural\Drawings\2727-01-C022-5402.dwg, PLAN 3 - 5402_swp_28.dwg, 4/3/2023, 4:33pm, odepce

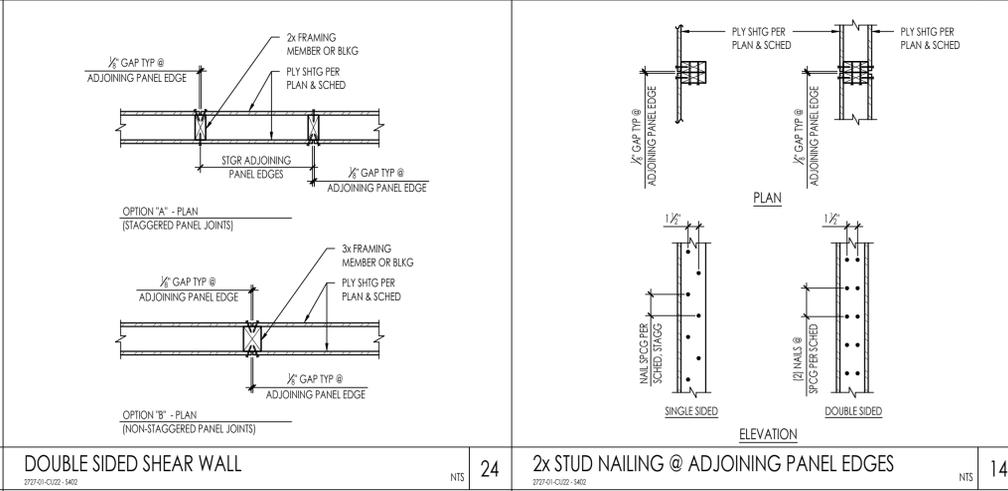

THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

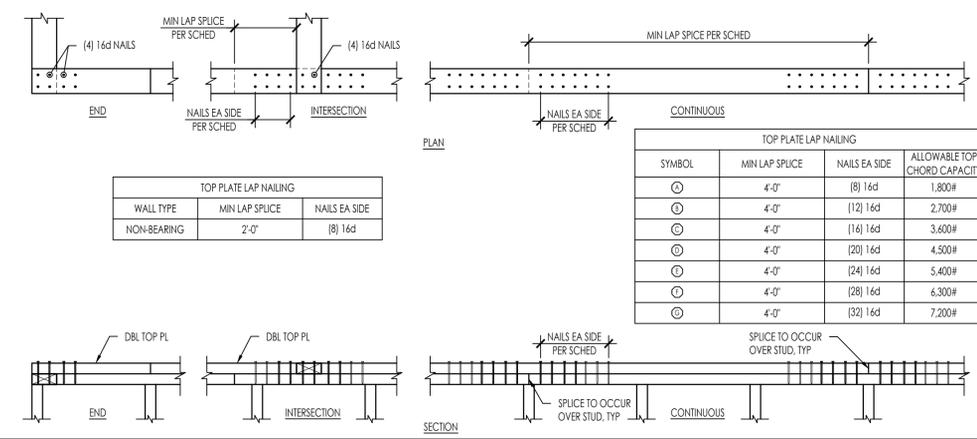


51 DBL TOP PLATE SPLICE NAILING 227-01-C102-1463 NTS 32

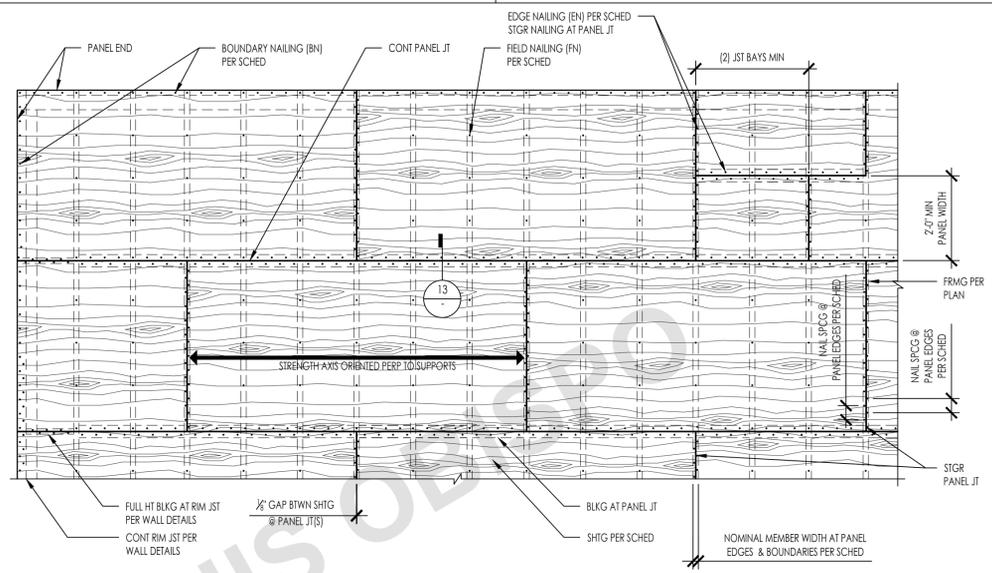


| TYPE | LOCATION | SHEATHING THICKNESS | SHEATHING GRADE* | SPAN RATING | BLOCKING | NAILS | BOUNDARY NAILING (BN) | EDGE NAILING AT CONT. PANEL EDGES (EN) | EDGE NAILING AT OTHER PANEL EDGES (EN) | FIELD NAILING (FN) | PANEL EDGE SUPPORT OR NOMINAL MEMBER WIDTH AT PANEL EDGES | LINES OF FASTENERS |
|------|----------|---------------------|------------------|-------------|----------|-------|-----------------------|--|--|--------------------|---|--------------------|
| A | ROOF | SEE NOTE 5 | SHEATHING | 32 / 16 | NO | 10d | 6 | - | 6 | 12 | H-CLIPS | 1 |
| B | FLOOR | 3/4" | STURD-FLOOR | 48 / 24 | NO | 10d | 6 | - | 6 | 12 | T&G | 1 |
| C | FLOOR | 3/4" | STURD-FLOOR | 48 / 24 | YES | 10d | 2 1/2 | 2 1/2 | 4 | 12 | 2x4 FLAT | 1 |

- NOTES:
- DIAPHRAGM SHALL BE GLUED TO FLOOR FRAMING PRIOR TO NAILING. REFER TO PROJECT GENERAL NOTES.
 - MINIMUM EDGE DISTANCE FOR NAILS SHALL BE 1/2" FROM SHEATHING EDGE AND 3/8" FROM LUMBER EDGE.
 - NAILS SHALL BE DRIVEN TIGHT TO TOP OF PLYWOOD SURFACE AND SHALL NOT PENETRATE THE TOP OF PLYWOOD MORE THAN COMMONLY EXPECTED WITH HAMMER DRIVEN NAILS.
 - WHERE H-CLIPS ARE SPECIFIED, THEY SHOULD BE INSTALLED AS FOLLOWS:
 - ONE H-CLIP SHALL BE PLACED BETWEEN ABUTTING PANELS AT A LOCATION MIDWAY BETWEEN EACH PAIR OF TRUSSES, RAFTERS OR JOISTS. HOWEVER, (2) H-CLIPS ARE REQUIRED BETWEEN SUPPORTS WHEN SPACED 48 INCHES ON CENTER.
 - USE THE SAME SIZE PANEL EDGE CLIP AS THE PANEL THICKNESS. H-CLIPS MUST FIT SNUGLY.
 - ABUTTING WOOD STRUCTURAL PANELS BE FITTED AS CLOSELY AS CLIPS PERMIT. OCCASIONAL MISFIT OF ABUTTING SHEETS MAY BE TOLERATED PROVIDING THAT GAPS DO NOT EXCEED MAXIMUM OPENING OF 1/8".
 - ROOF SHEATHING THICKNESS SHALL BE INSTALLED AS FOLLOWS:
 - 1/2" @ SINGLE PLY OR ASPHALT SHINGLES
 - 3/4" @ TILE
 - 3/4" @ TILE WITH MORTAR
 - STRUCTURALLY ACCEPTABLE TO USE "SHEATHING" SHEATHING GRADE @ FLOOR LOCATIONS WITHOUT GYPCRETE TOPPING


52 PLYWOOD DIAPHRAGM SHEATHING 227-01-C102-1463 NTS 12

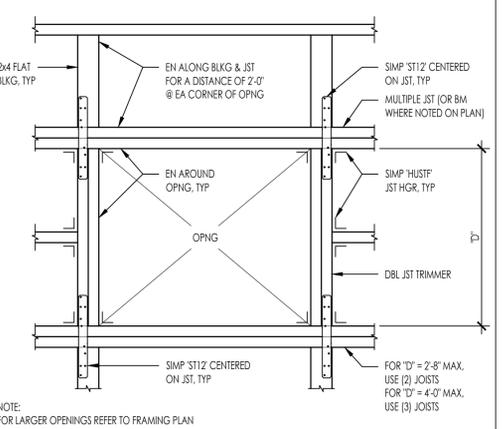

53 OPENING AT FRAMING 227-01-C102-1463 NTS 23

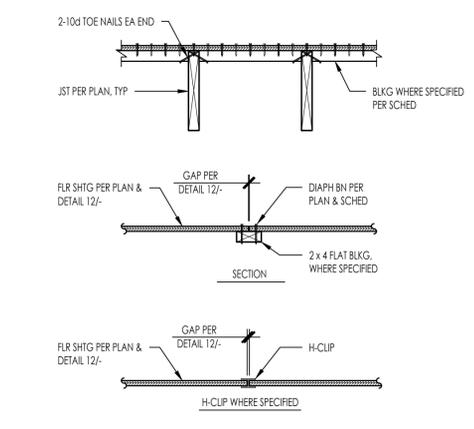

54 DIAPHRAGM PANEL JOINTS 227-01-C102-1463 NTS 13

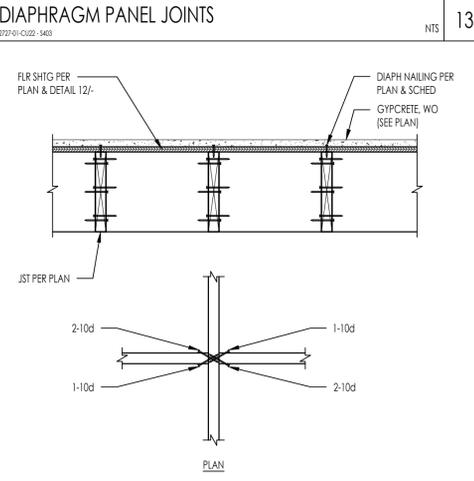

54 TYP JOIST BLOCKING 227-01-C102-1463 NTS 14

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA
TYPICAL WOOD DETAILS

DATE
09/28/2023
SHEET


S-403

N:\2000\2277-01-c102-acc-county\adu\structural\CondDoc\Sheet\227-01-C102-1463.dwg, PLAN 3 - 5403.dwg, 2023-09-28 4:33pm, oispet




THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.


| | | | |
|----|----|----|--|
| | | | |
| 51 | 41 | 31 | |

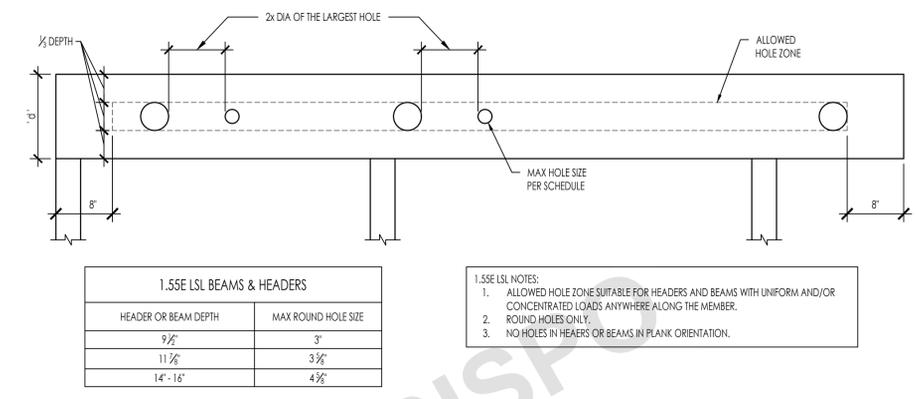


| | | | |
|----|----|----|--|
| | | | |
| 52 | 42 | 32 | |

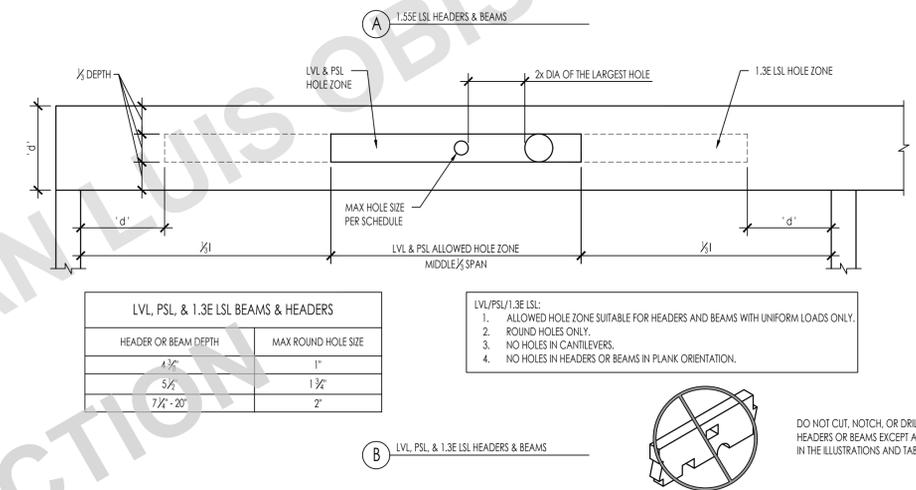

| | | | |
|----|----|----|--|
| | | | |
| 53 | 43 | 33 | |

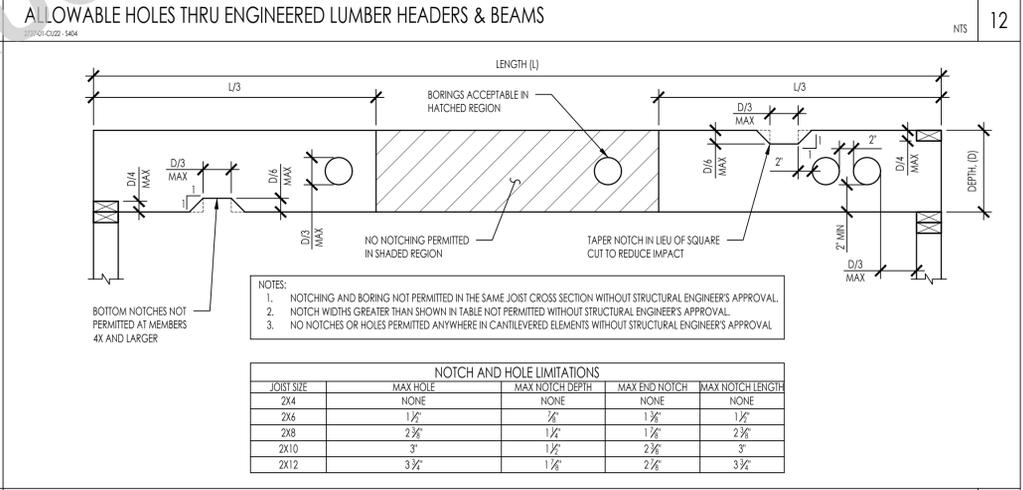

| | | | |
|----|----|----|--|
| | | | |
| 54 | 44 | 34 | |

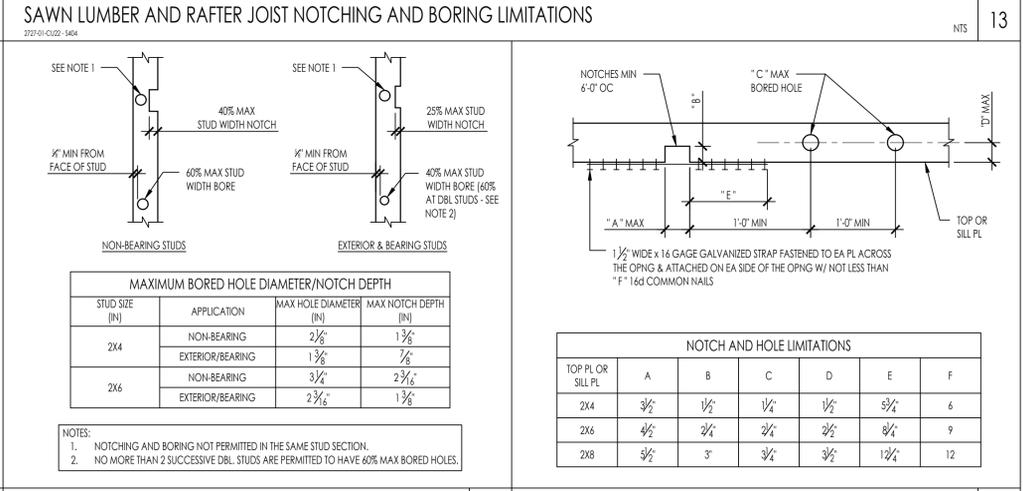

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA
TYPICAL WOOD DETAILS

N:\2000\2727-01-cu29-loc-county\adu\Structural\Sheet\Sheet\2727-01-CU22-5404.dwg, P:\AN 3 - 5404.dwg, Sep 28, 2023 4:33pm, oadpet




THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONSTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA


ROOF FRAMING DETAILS

DATE
09/28/2023
SHEET


S-421

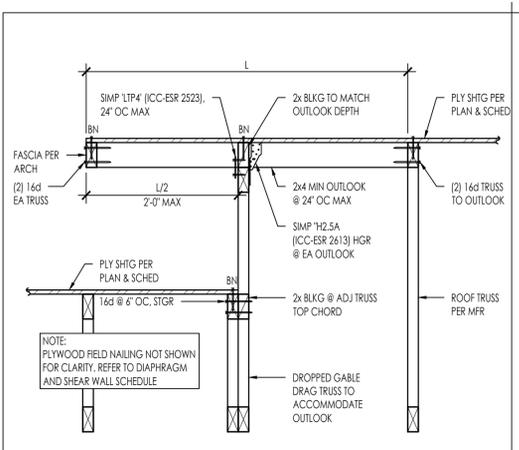


DIAPH TRANSITION W/ OVERHANG
2372-01-C1022-1461 1" = 1'-0" 51

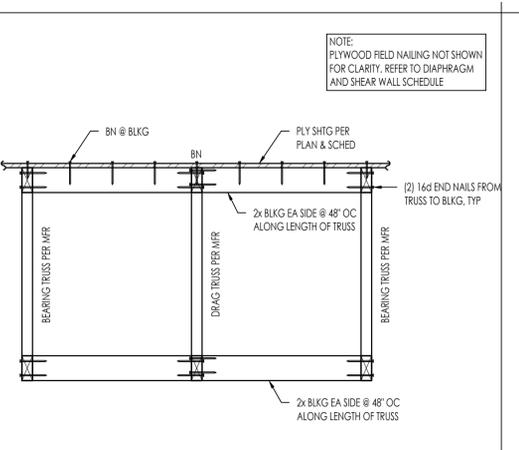


INTERIOR DRAG TRUSS
2372-01-C1022-1461 1" = 1'-0" 41

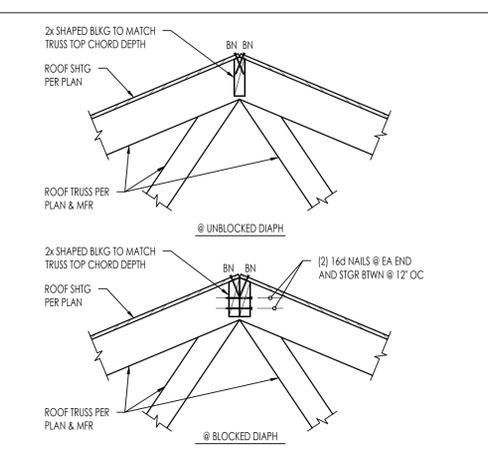


SHEATHING OVER ROOF RIDGE
2372-01-C1022-1461 1" = 1'-0" 31

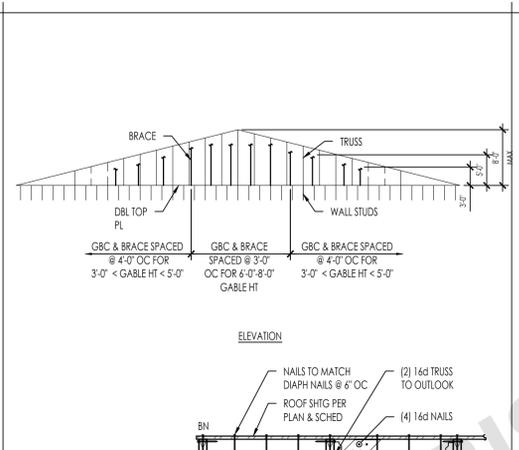


GABLE END TRUSS W/O LOOKOUT
2372-01-C1022-1461 1" = 1'-0" 35

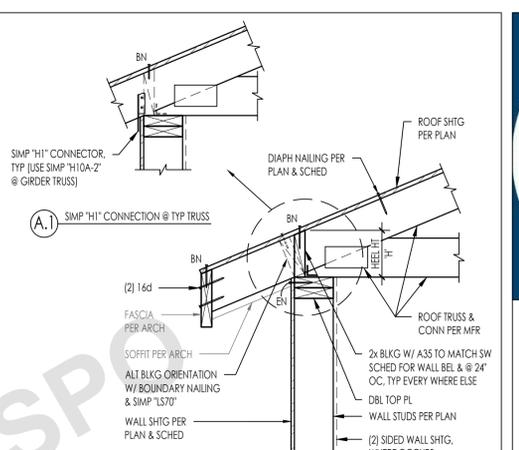


ROOF TRUSS PERP TO EXTERIOR WALL
2372-01-C1022-1461 NTS 37

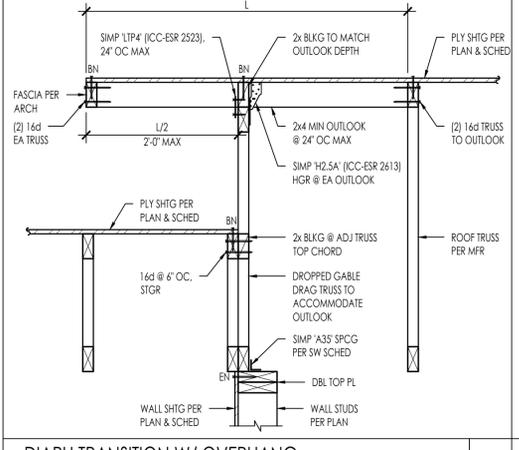


DIAPH TRANSITION W/ OVERHANG
2372-01-C1022-1461 1" = 1'-0" 52

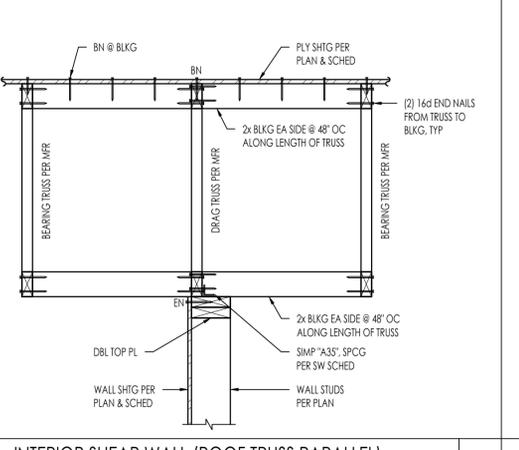


INTERIOR SHEAR WALL (ROOF TRUSS PARALLEL)
2372-01-C1022-1461 1" = 1'-0" 42

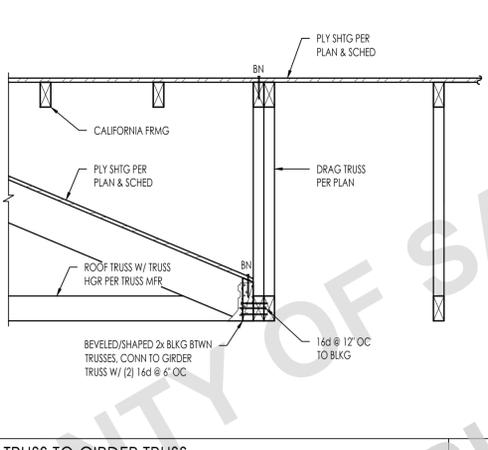


TRUSS TO GIRDER TRUSS
2372-01-C1022-1461 1" = 1'-0" 33

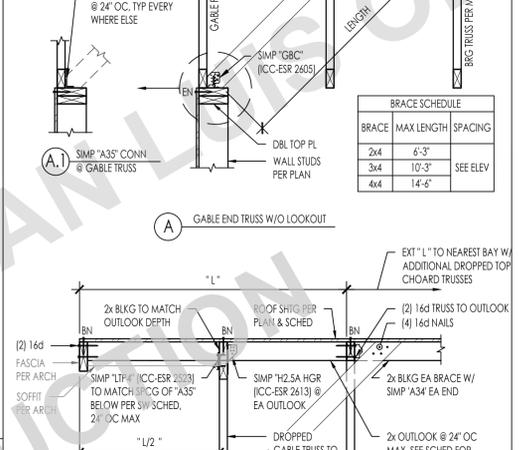


GABLE END TRUSS W/ LOOKOUT
2372-01-C1022-1461 1" = 1'-0" 36

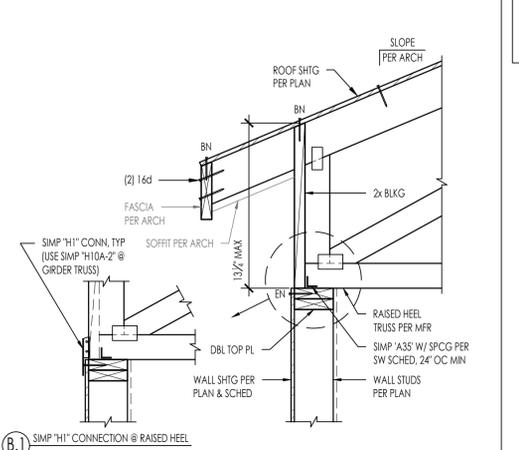


ROOF TRUSS PERP TO EXTERIOR WALL
2372-01-C1022-1461 NTS 38

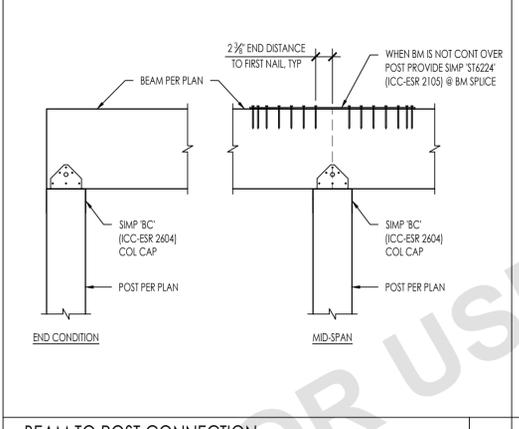


BEAM TO POST CONNECTION
2372-01-C1022-1461 1" = 1'-0" 53

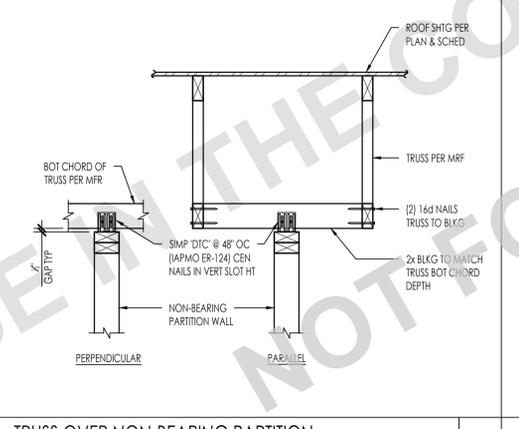


TRUSS OVER NON-BEARING PARTITION
2372-01-C1022-1461 1" = 1'-0" 43

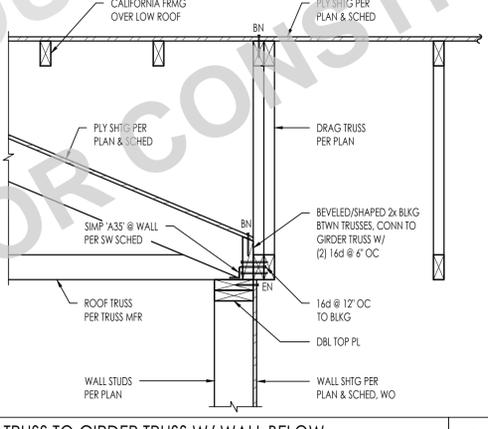


TRUSS TO GIRDER TRUSS W/ WALL BELOW
2372-01-C1022-1461 1" = 1'-0" 34

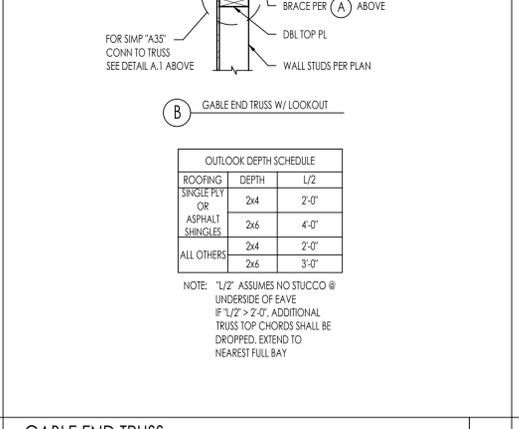


GABLE END TRUSS
2372-01-C1022-1461 NTS 39

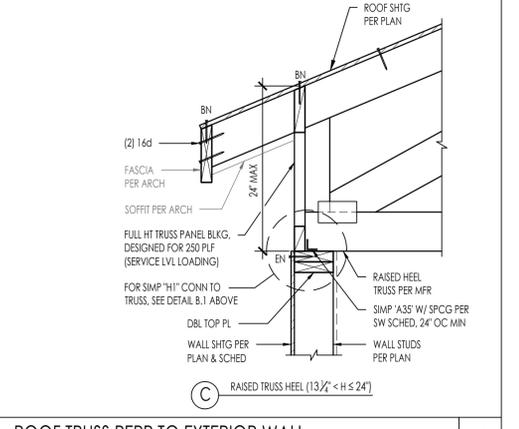


ROOF TRUSS PERP TO EXTERIOR WALL
2372-01-C1022-1461 NTS 40

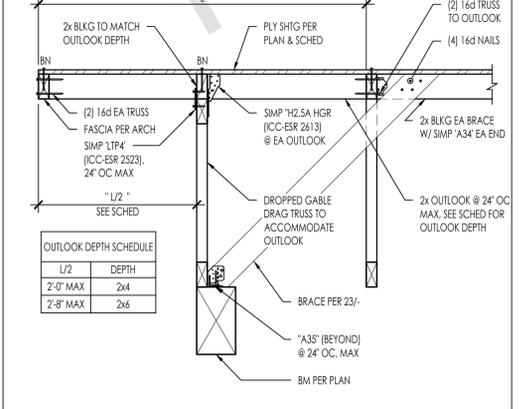


GABLE END TRUSS W/ LOOKOUT @ BEAM
2372-01-C1022-1461 1" = 1'-0" 54

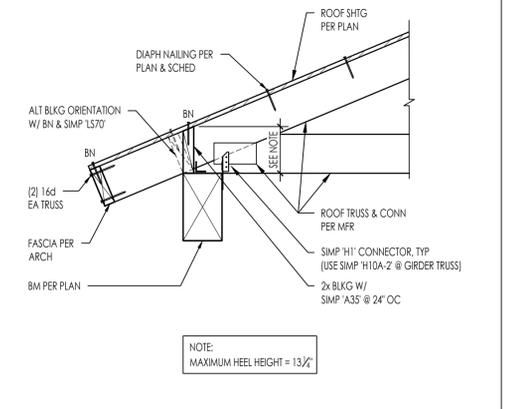


ROOF TRUSS PERP TO BEAM
2372-01-C1022-1461 1" = 1'-0" 44

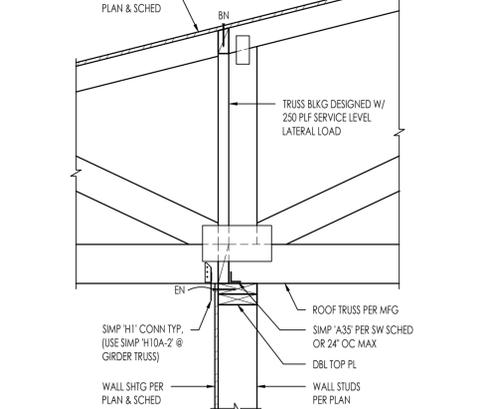

TRUSS INTERIOR BEARING WALL
2372-01-C1022-1461 1" = 1'-0" 34

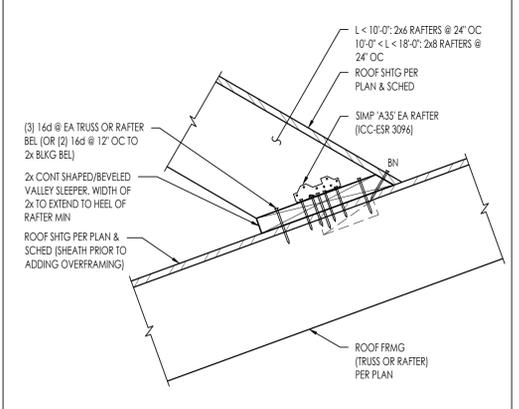

CALIFORNIA FRAMING SLEEPER
2372-01-C1022-1461 NTS 24

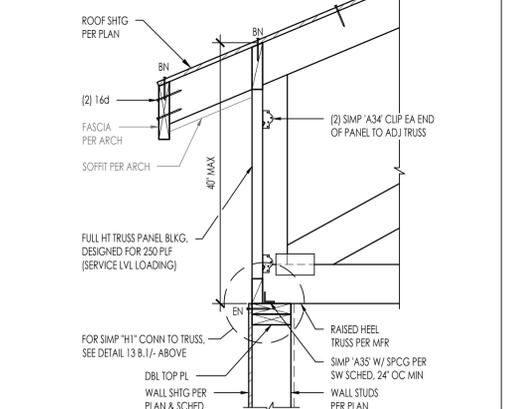

ROOF TRUSS PERP TO EXTERIOR WALL
2372-01-C1022-1461 NTS 14

N:\2020\2727-01-C1022-00-00\Structural\ConDoc\Sheet\2727-01-C1022-1461.dwg, PLAN 3, 54.dwg, Sep 28, 2023, 4:30pm, oadpe

| Energy Use | Standard Design Source Energy (EDR1) (kBtu/ft ² -yr) | Standard Design TDV Energy (EDR2) (KTOV/ft ² -yr) | Proposed Design Source Energy (EDR1) (kBtu/ft ² -yr) | Proposed Design TDV Energy (EDR2) (KTOV/ft ² -yr) | Compliance Margin (EDR1) | Compliance Margin (EDR2) |
|---|---|--|---|--|--------------------------|--------------------------|
| Space Heating | 1.89 | 8.54 | 1.85 | 14.74 | 0.04 | -6.2 |
| Space Cooling | 0.79 | 29.16 | 0.38 | 19.9 | 0.41 | 9.26 |
| IAQ Ventilation | 0.54 | 5.79 | 0.54 | 5.79 | 0 | 0 |
| Water Heating | 3.39 | 35.55 | 2.37 | 27.66 | 1.02 | 7.89 |
| Self Utilization/Flexibility Credit | | | | 0 | | 0 |
| North Facing Efficiency Compliance Total | 6.61 | 79.04 | 5.14 | 68.09 | 1.47 | 10.95 |
| Space Heating | 1.89 | 8.54 | 1.92 | 14.88 | -0.03 | -6.34 |
| Space Cooling | 0.79 | 29.16 | 0.56 | 23.94 | 0.23 | 5.22 |
| IAQ Ventilation | 0.54 | 5.79 | 0.54 | 5.79 | 0 | 0 |
| Water Heating | 3.39 | 35.55 | 2.37 | 27.58 | 1.02 | 7.97 |
| Self Utilization/Flexibility Credit | | | | 0 | | 0 |
| East Facing Efficiency Compliance Total | 6.61 | 79.04 | 5.39 | 72.19 | 1.22 | 6.85 |

CF1R-PRF-01E (Page 2 of 12)
 Calculation Date/Time: 2023-09-26T20:33:42-07:00
 Input File Name: 3 Bedrm Plan -Plan 3abc CZ 4.rbd22x
 Report Generated: 2023-09-26 20:34:06

| Energy Use Intensity | Standard Design (kBtu/ft ² -yr) | Proposed Design (kBtu/ft ² -yr) | Compliance Margin (kBtu/ft ² -yr) | Margin Percentage |
|----------------------|--|--|--|-------------------|
| North Facing | 27.78 | 25.72 | 2.06 | 7.42 |
| East Facing | 27.78 | 26.08 | 1.7 | 6.12 |
| South Facing | 27.78 | 25.46 | 2.32 | 8.35 |
| West Facing | 27.78 | 26.15 | 1.63 | 5.87 |

| Energy Use Intensity | Standard Design (kBtu/ft ² -yr) | Proposed Design (kBtu/ft ² -yr) | Compliance Margin (kBtu/ft ² -yr) | Margin Percentage |
|----------------------|--|--|--|-------------------|
| North Facing | 27.78 | 25.72 | 2.06 | 7.42 |
| East Facing | 27.78 | 26.08 | 1.7 | 6.12 |
| South Facing | 27.78 | 25.46 | 2.32 | 8.35 |
| West Facing | 27.78 | 26.15 | 1.63 | 5.87 |

CF1R-PRF-01E (Page 1 of 12)
 Calculation Date/Time: 2023-09-26T20:33:42-07:00
 Input File Name: 3 Bedrm Plan -Plan 3abc CZ 4.rbd22x
 Report Generated: 2023-09-26 20:34:06

| GENERAL INFORMATION | Run Title | Project Name | Project Location | City | State | Zip | Standard Version | Report Date |
|---------------------|----------------------|----------------------|------------------|--------------|--------------|--------------|------------------|--------------|
| 01 | Residential Building | Residential Building | San Luis Obispo | CA | 93401 | 2022 | 2023-09-26 | |
| 02 | North Facing | North Facing | North Facing | North Facing | North Facing | North Facing | North Facing | North Facing |
| 03 | East Facing | East Facing | East Facing | East Facing | East Facing | East Facing | East Facing | East Facing |
| 04 | South Facing | South Facing | South Facing | South Facing | South Facing | South Facing | South Facing | South Facing |
| 05 | West Facing | West Facing | West Facing | West Facing | West Facing | West Facing | West Facing | West Facing |


| Energy Use | Standard Design Source Energy (EDR1) (kBtu/ft ² -yr) | Standard Design TDV Energy (EDR2) (KTOV/ft ² -yr) | Proposed Design Source Energy (EDR1) (kBtu/ft ² -yr) | Proposed Design TDV Energy (EDR2) (KTOV/ft ² -yr) | Compliance Margin (EDR1) | Compliance Margin (EDR2) |
|---|---|--|---|--|--------------------------|--------------------------|
| Space Heating | 1.89 | 8.54 | 1.56 | 12.13 | 0.33 | -3.59 |
| Space Cooling | 0.79 | 29.16 | 0.4 | 19.18 | 0.39 | 9.98 |
| IAQ Ventilation | 0.54 | 5.79 | 0.54 | 5.79 | 0 | 0 |
| Water Heating | 3.39 | 35.55 | 2.36 | 27.57 | 1.03 | 7.98 |
| Self Utilization/Flexibility Credit | | | | 0 | | 0 |
| South Facing Efficiency Compliance Total | 6.61 | 79.04 | 4.86 | 64.67 | 1.75 | 14.37 |
| Space Heating | 1.89 | 8.54 | 1.76 | 13.86 | 0.13 | -5.32 |
| Space Cooling | 0.79 | 29.16 | 0.72 | 29.43 | 0.07 | -0.27 |
| IAQ Ventilation | 0.54 | 5.79 | 0.54 | 5.79 | 0 | 0 |
| Water Heating | 3.39 | 35.55 | 2.36 | 27.5 | 1.03 | 8.05 |
| Self Utilization/Flexibility Credit | | | | 0 | | 0 |
| West Facing Efficiency Compliance Total | 6.61 | 79.04 | 5.38 | 76.58 | 1.23 | 2.46 |

| REQUIRED PV SYSTEMS | 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 | 10 | 11 | 12 |
|-----------------------|-----------|-------------------|------------|-------------------|------|---------------|------------|-------------------|-----------------|-------------------|-------------------------|----|
| DC System Size (kWdc) | Exception | Module Type | Array Type | Power Electronics | CFI | Azimuth (deg) | Tilt Input | Array Angle (deg) | Tilt: (x in 12) | Inverter Eff. (%) | Annual Solar Access (%) | |
| 2.25 | NA | Standard (14-17%) | Fixed | none | true | 150-270 | n/a | n/a | <=7:12 | 96 | 98 | |

| FENESTRATION / GLAZING | 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 | 10 | 11 | 12 | 13 | 14 |
|------------------------|--------|------------|-------------|---------|------------|-------------|-------|-------------------------|----------|-----------------|------|-------------|------------------|----|
| Name | Type | Surface | Orientation | Azimuth | Width (ft) | Height (ft) | Mult. | Area (ft ²) | U-factor | U-factor Source | SHGC | SHGC Source | Exterior Shading | |
| Window 3 | Window | Right Wall | Right | 270 | | | 1 | 16 | 0.3 | NFRC | 0.23 | NFRC | Bug Screen | |

| ZONE INFORMATION | 01 | 02 | 03 | 04 | 05 | 06 | 07 |
|------------------|-------------|------------------|------------------------------------|---------------------|------------------------|--------|----|
| Zone Name | Zone Type | HVAC System Name | Zone Floor Area (ft ²) | Avg. Ceiling Height | Water Heating System 1 | Status | |
| Zone 1 | Conditioned | HVAC System1 | 741.75 | 8 | DHW Sys 1 | New | |

| BUILDING ENVELOPE - HERS VERIFICATION | 01 | 02 | 03 | 04 | 05 |
|---------------------------------------|------------------------------------|-------------------------------|-------|-------|----|
| Quality Insulation Installation (QII) | High R-value Spray Foam Insulation | Building Envelope Air Leakage | CFM50 | CFM50 | |
| Required | Not Required | N/A | n/a | n/a | |



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRACT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

COUNTY OF SAN LUIS OBISPO
 ACCESSORY DWELLING UNIT
 SAN LUIS OBISPO, CA
 ENERGY COMPLIANCE - PLAN 3A

APPROVED SET
 DATE
 09/28/2023
 SHEET
 T24 - 301

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT
 I, I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: Jennifer Rennick
 Signature Date: 9/26/2023
 Company: In Balance Green Consulting
 Address: [Redacted]
 City/State/Zip: [Redacted]
 Phone: [Redacted]

RESPONSIBLE PERSON'S DECLARATION STATEMENT
 I certify the following under penalty of perjury, under the laws of the State of California:
 1. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design identified on this Certificate of Compliance.
 2. I certify that the energy features and performance specifications identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
 3. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.

Responsible Designer Name: [Redacted]
 Responsible Designer Signature: [Redacted]
 Company: [Redacted]
 Address: [Redacted]
 City/State/Zip: [Redacted]
 Phone: [Redacted]

INDOOR AIR QUALITY (IAQ) FANS

| 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 |
|-----------------|---------------|----------------------|--------------|--------------------------------|----------------------------------|-----------------------------------|-------------------|--------|
| Dwelling Unit | Airflow (CFM) | Fan Efficacy (W/CFM) | IAQ Fan Type | Includes Heat/Energy Recovery? | IAQ Recovery Effectiveness - SRE | Includes Fault Indicator Display? | HERS Verification | Status |
| Sfam IAQVentRpt | 52 | 0.35 | Exhaust | No | N/A / n/a | No | Yes | |

SPACE CONDITIONING SYSTEMS

| 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 |
|---------------|---------------------------|--------------------|-------------------------|--------------------|-------------------------|----------|-------------------|--------------------------|
| Name | System Type | Heating Unit Name | Heating Equipment Count | Cooling Unit Name | Cooling Equipment Count | Fan Name | Distribution Name | Required Thermostat Type |
| HVAC System 1 | Heat pump heating cooling | Heat Pump System 1 | 4 | Heat Pump System 1 | 4 | n/a | n/a | Setback |

HVAC - HEAT PUMPS


| 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 | 10 | 11 | 12 | 13 | | |
|--------------------|---------------|-----------------|-----------------|--------------------|--------|---------|-----------------|--------------|-----------------|--------------|------------------|--------------------------------|-----------------|-------------------|
| Name | System Type | Number of Units | Heating | | | Cooling | | | Efficiency Type | SEER / SEER2 | EER / EER / CEER | Zonally Controlled | Compressor Type | HERS Verification |
| | | | Efficiency Type | HSPF / HSPF2 / COP | Cap 47 | Cap 17 | Efficiency Type | SEER / SEER2 | | | | | | |
| Heat Pump System 1 | VCHP-ductless | 4 | HSPF2 | 8 | 10900 | 10200 | EER2SEER2 | 16 | 12.4 | Not Zonal | Multi-speed | Heat Pump System 1-hers-htpump | | |

HVAC HEAT PUMPS - HERS VERIFICATION

| 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 |
|--------------------------------|------------------|----------------|-------------------|---------------------|-----------------------------|---------------------|-------------------------|-------------------------|
| Name | Verified Airflow | Airflow Target | Verified EER/EER2 | Verified SEER/SEER2 | Verified Refrigerant Charge | Verified HSPF/HSPF2 | Verified Heating Cap-47 | Verified Heating Cap-17 |
| Heat Pump System 1-hers-htpump | Not Required | 0 | Required | Required | Yes | Yes | Yes | Yes |

VARIABLE CAPACITY HEAT PUMP COMPLIANCE OPTION - HERS VERIFICATION

| 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 | 10 |
|--------------------|----------------------------------|----------------------------|-------------------------------------|-----------------------|--|--|--|------------------------------|-------------------------------------|
| Name | Certified Low-Static VCHP System | Airflow to Habitable Rooms | Ductless Units in Conditioned Space | Wall Mount Thermostat | Air Filter Sizing & Pressure Drop Rating | Low Leakage Ducts in Conditioned Space | Minimum Airflow per R4.3 and SC3.3.3.4.1 | Certified non-continuous Fan | Indoor Fan not Running Continuously |
| Heat Pump System 1 | Not required | Required | Required | Required | Not required | Not required | Not required | Not required | Not required |



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

FOR USE IN THE COUNTY OF SAN LUIS OBISPO
NOT FOR CONSTRUCTION

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
 SAN LUIS OBISPO, CA

ENERGY COMPLIANCE - PLAN 3A

APPROVED SET

DATE
09/28/2023

SHEET
T24 - 302

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Residential Building
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-09-26T20:07:24-07:00
Input File Name: 3 Bedrm Plan -Plan 3abc CZ 5.rbd22x

CF1R-PRF-01E
(Page 3 of 12)

ENERGY USE SUMMARY table with columns: Energy Use, Standard Design Source Energy (EDR1), Standard Design TDV Energy (EDR2), Proposed Design Source Energy (EDR1), Proposed Design TDV Energy (EDR2), Compliance Margin (EDR1), Compliance Margin (EDR2). Rows include Space Heating, Space Cooling, IAQ Ventilation, Water Heating, Self Utilization/Flexibility Credit, North Facing Efficiency Compliance Total, and East Facing Efficiency Compliance Total.

Registration Number: CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: Report Version: 2022.0.000
HERS Provider: CZ-5-03
Report Generated: 2023-09-26 20:07:46

CF1R-PRF-01E (Page 2 of 12)
Calculation Date/Time: 2023-09-26T20:07:24-07:00
Input File Name: 3 Bedrm Plan -Plan 3abc CZ 5.rbd22x

ENERGY DESIGN RATINGS table with columns: Standard Design, Proposed Design, and Compliance Margin. Rows include North Facing, East Facing, South Facing, and West Facing. Includes a note about Energy EDR including improvements like a better building envelope and more efficient equipment.

HERS Provider: Report Generated: 2023-09-26 20:07:46
Registration Number: CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: Report Version: 2022.0.000
HERS Provider: CZ-5-03
Report Generated: 2023-09-26 20:07:46


CZ-5-02

CF1R-PRF-01E (Page 1 of 12)
Calculation Date/Time: 2023-09-26T20:07:24-07:00
Input File Name: 3 Bedrm Plan -Plan 3abc CZ 5.rbd22x

GENERAL INFORMATION table with columns: Item, Description, Value. Rows include Project Name, Project Location, Project City, Project County, Building Type, etc.

HERS Provider: Report Generated: 2023-09-26 20:07:46
Registration Number: CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: Report Version: 2022.0.000
HERS Provider: CZ-5-03
Report Generated: 2023-09-26 20:07:46

CZ-5-01



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRACT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Residential Building
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-09-26T20:07:24-07:00
Input File Name: 3 Bedrm Plan -Plan 3abc CZ 5.rbd22x

CF1R-PRF-01E
(Page 6 of 12)

REQUIRED PV SYSTEMS table with columns: 01-12. Rows include DC System Size (kWdc), Exception, Module Type, Array Type, Power Electronics, CFI, Azimuth (deg), Tilt Input, Array Angle (deg), Tilt: (x in 12), Inverter Eff. (%), Annual Solar Access (%).

REQUIRED SPECIAL FEATURES
The following are features that must be installed as condition for meeting the modeled energy performance for this computer analysis.
• Ceiling has high level of insulation
• Variable capacity heat pump compliance option (verification details from VCHP Staff report, Appendix B, and RA3)
• Compact distribution system basic credit
• Northwest Energy Efficiency Alliance (NEEA) rated heat pump water heater; specific brand/model, or equivalent, must be installed

HERS FEATURE SUMMARY
The following is a summary of the features that must be field-verified by a certified HERS Rater as a condition for meeting the modeled energy performance for this computer analysis. Additional detail is provided in the building tables below. Registered CF2Rs and CF3Rs are required to be completed in the HERS Registry
• Quality insulation installation (QII)
• Indoor air quality ventilation
• Kitchen range hood
• Verified EER/EER2
• Verified SEER/SEER2
• Verified Refrigerant Charge
• Airflow in habitable rooms (SC3.1.4.1.7)
• Verified HSPF2
• Verified heat pump rated heating capacity
• Wall-mounted thermostat in zones greater than 150 sq ft (SC3.4.5)
• Ductless indoor units located entirely in conditioned space (SC3.1.4.1.8)

BUILDING - FEATURES INFORMATION table with columns: 01-07. Rows include Project Name, Conditioned Floor Area (ft²), Number of Dwelling Units, Number of Bedrooms, Number of Zones, Number of Ventilation Cooling Systems, Number of Water Heating Systems.

Registration Number: CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: Report Version: 2022.0.000
HERS Provider: CZ-5-06
Report Generated: 2023-09-26 20:07:46

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Residential Building
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-09-26T20:07:24-07:00
Input File Name: 3 Bedrm Plan -Plan 3abc CZ 5.rbd22x

CF1R-PRF-01E
(Page 5 of 12)

ENERGY USE INTENSITY table with columns: North Facing, East Facing, South Facing, West Facing. Rows include Gross EUI, Net EUI, and Compliance Margin. Includes notes: 1. Gross EUI is Energy Use Total (not including PV) / Total Building Area. 2. Net EUI is Energy Use Total (including PV) / Total Building Area.

Registration Number: CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: Report Version: 2022.0.000
HERS Provider: CZ-5-05
Report Generated: 2023-09-26 20:07:46

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Residential Building
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-09-26T20:07:24-07:00
Input File Name: 3 Bedrm Plan -Plan 3abc CZ 5.rbd22x

CF1R-PRF-01E
(Page 4 of 12)

ENERGY USE SUMMARY table with columns: Energy Use, Standard Design Source Energy (EDR1), Standard Design TDV Energy (EDR2), Proposed Design Source Energy (EDR1), Proposed Design TDV Energy (EDR2), Compliance Margin (EDR1), Compliance Margin (EDR2). Rows include Space Heating, Space Cooling, IAQ Ventilation, Water Heating, Self Utilization/Flexibility Credit, South Facing Efficiency Compliance Total, and West Facing Efficiency Compliance Total.

Registration Number: CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: Report Version: 2022.0.000
HERS Provider: CZ-5-04
Report Generated: 2023-09-26 20:07:46

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Residential Building
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-09-26T20:07:24-07:00
Input File Name: 3 Bedrm Plan -Plan 3abc CZ 5.rbd22x

CF1R-PRF-01E
(Page 9 of 12)

BUILDING ENVELOPE - HERS VERIFICATION table with columns: 01-05. Rows include Quality Insulation Installation (QII), High R-value Spray Foam Insulation, Building Envelope Air Leakage, CFM50, CFM50.

WATER HEATING SYSTEMS table with columns: 01-09. Rows include Name, System Type, Distribution Type, Water Heater Name, Number of Units, Solar Heating System, Compact Distribution, HERS Verification, Water Heater Name (H).

WATER HEATERS - NEEA HEAT PUMP table with columns: 01-08. Rows include Name, # of Units, Tank Vol. (gal), NEEA Heat Pump Brand, NEEA Heat Pump Model, Tank Location, Duct Inlet Air Source, Duct Outlet Air Source.

WATER HEATING - COMPACT DISTRIBUTION table with columns: 01-07. Rows include Dwelling Unit type, Water Heating System Name, Master Bath distance of furthest fixture to Water Heater (ft), Kitchen distance of furthest fixture to Water Heater (ft), Furthest Third furthest fixture to Water Heater (ft), Compactness Factor, HERS Verification.

WATER HEATING - HERS VERIFICATION table with columns: 01-07. Rows include Name, Pipe Insulation, Parallel Piping, Compact Distribution, Compact Distribution Type, Recirculation Control, Shower Drain Water Heat Recovery.

Registration Number: CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: Report Version: 2022.0.000
HERS Provider: CZ-5-09
Report Generated: 2023-09-26 20:07:46

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Residential Building
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-09-26T20:07:24-07:00
Input File Name: 3 Bedrm Plan -Plan 3abc CZ 5.rbd22x

CF1R-PRF-01E
(Page 8 of 12)

FENESTRATION / GLAZING table with columns: 01-14. Rows include Name, Type, Surface, Orientation, Azimuth, Width (ft), Height (ft), Mult., Area (ft²), U-factor, U-factor Source, SHGC, SHGC Source, Exterior Shading.

SLAB FLOORS table with columns: 01-08. Rows include Name, Zone, Area (ft²), Perimeter (ft), Edge Insul. R-value and Depth, Edge Insul. R-value and Depth, Carpeted Fraction, Heated.

OPAQUE SURFACE CONSTRUCTIONS table with columns: 01-08. Rows include Construction Name, Surface Type, Construction Type, Framing, Total Cavity R-value, Interior / Exterior Continuous R-value, U-factor, Assembly Layers.

Table with columns: 01-08. Rows include R-19 Wall, Attic RoofZone 1, R-38 Roof Attic.

Table with columns: 01-08. Rows include R-38 Roof Attic.

Registration Number: CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: Report Version: 2022.0.000
HERS Provider: CZ-5-08
Report Generated: 2023-09-26 20:07:46

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Residential Building
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-09-26T20:07:24-07:00
Input File Name: 3 Bedrm Plan -Plan 3abc CZ 5.rbd22x

CF1R-PRF-01E
(Page 7 of 12)

ZONE INFORMATION table with columns: 01-07. Rows include Zone Name, Zone Type, HVAC System Name, Zone Floor Area (ft²), Avg. Ceiling Height, Water Heating System 1, Status.

OPAQUE SURFACES table with columns: 01-08. Rows include Name, Zone, Construction, Azimuth, Orientation, Gross Area (ft²), Window and Door Area (ft²), Tilt (deg).

Table with columns: 01-08. Rows include Front Wall, Left Wall, Rear Wall, Right Wall, Roof, Roof 2.

ATTIC table with columns: 01-08. Rows include Name, Construction, Type, Roof Rise (x in 12), Roof Reflectance, Roof Emittance, Radiant Barrier, Cool Roof.

FENESTRATION / GLAZING table with columns: 01-14. Rows include Name, Type, Surface, Orientation, Azimuth, Width (ft), Height (ft), Mult., Area (ft²), U-factor, U-factor Source, SHGC, SHGC Source, Exterior Shading.

Registration Number: CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: Report Version: 2022.0.000
HERS Provider: CZ-5-07
Report Generated: 2023-09-26 20:07:46

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA
ENERGY COMPLIANCE - PLAN 3A

APPROVED SET
DATE
09/28/2023
SHEET
T24 - 303

C:\Users\amrinc\Documents\2727-01 SLO County\ADU_CD_CENTRAL_2022_amrinc\NSFGU-01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: Residential Building
 Calculation Date/Time: 2023-09-26T20:07:24-07:00
 Calculation Description: Title 24 Analysis
 Input File Name: 3 Bedrm Plan - Plan 3abc CZ 5.r1bd22x

(Page 12 of 12)

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT

I, I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: Jennifer Rennick
 Signature Date: 9/26/2023
 Company: In Balance Green Consulting
 Address: [Redacted]
 City/State/Zip: [Redacted]
 Phone: [Redacted]

RESPONSIBLE PERSON'S DECLARATION STATEMENT

I certify the following under penalty of perjury, under the laws of the State of California:

- I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design identified on this Certificate of Compliance.
- I certify that the energy features and performance specifications identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
- The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.

Responsible Designer Name: [Redacted]
 Responsible Designer Signature: [Redacted]
 Company: [Redacted]
 Date Signed: [Redacted]
 Address: [Redacted]
 License: [Redacted]
 City/State/Zip: [Redacted]
 Phone: [Redacted]

Registration Number: [Redacted] Registration Date/Time: [Redacted] HERS Provider: CZ-5-12
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Schema Version: rev 20220901 Report Generated: 2023-09-26 20:07:46

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: Residential Building
 Calculation Date/Time: 2023-09-26T20:07:24-07:00
 Calculation Description: Title 24 Analysis
 Input File Name: 3 Bedrm Plan - Plan 3abc CZ 5.r1bd22x

(Page 11 of 12)

INDOOR AIR QUALITY (IAQ) FANS

| 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 |
|-----------------|---------------|----------------------|--------------|--------------------------------|----------------------------------|-----------------------------------|-------------------|--------|
| Dwelling Unit | Airflow (CFM) | Fan Efficacy (W/CFM) | IAQ Fan Type | Includes Heat/Energy Recovery? | IAQ Recovery Effectiveness - SRE | Includes Fault Indicator Display? | HERS Verification | Status |
| Sfam IAQVentRpt | 52 | 0.35 | Exhaust | No | n/a / n/a | No | Yes | |

Registration Number: [Redacted] Registration Date/Time: [Redacted] HERS Provider: CZ-5-11
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Schema Version: rev 20220901 Report Generated: 2023-09-26 20:07:46

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: Residential Building
 Calculation Date/Time: 2023-09-26T20:07:24-07:00
 Calculation Description: Title 24 Analysis
 Input File Name: 3 Bedrm Plan - Plan 3abc CZ 5.r1bd22x

(Page 10 of 12)

SPACE CONDITIONING SYSTEMS

| 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 |
|--------------|---------------------------|--------------------|-------------------------|--------------------|-------------------------|----------|-------------------|--------------------------|
| Name | System Type | Heating Unit Name | Heating Equipment Count | Cooling Unit Name | Cooling Equipment Count | Fan Name | Distribution Name | Required Thermostat Type |
| HVAC System1 | Heat pump heating cooling | Heat Pump System 1 | 4 | Heat Pump System 1 | 4 | n/a | n/a | Setback |

HVAC - HEAT PUMPS

| 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 | 10 | 11 | 12 | 13 | | |
|--------------------|---------------|-----------------|-----------------|--------------------|--------|---------|-----------------|--------------|-----------------|--------------|------------------|--------------------------------|-----------------|-------------------|
| Name | System Type | Number of Units | Heating | | | Cooling | | | Efficiency Type | SEER / SEER2 | EER / EER / CEER | Zonally Controlled | Compressor Type | HERS Verification |
| | | | Efficiency Type | HSPF / HSPF2 / COP | Cap 47 | Cap 17 | Efficiency Type | SEER / SEER2 | | | | | | |
| Heat Pump System 1 | VCHP-ductless | 4 | HSPF2 | 8 | 6000 | 5400 | EER2SEER2 | 16 | 12.4 | Not Zonal | Multi-speed | Heat Pump System 1-hers-htpump | | |

HVAC HEAT PUMPS - HERS VERIFICATION

| 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 |
|--------------------------------|------------------|----------------|-------------------|---------------------|-----------------------------|---------------------|-------------------------|-------------------------|
| Name | Verified Airflow | Airflow Target | Verified EER/EER2 | Verified SEER/SEER2 | Verified Refrigerant Charge | Verified HSPF/HSPF2 | Verified Heating Cap 47 | Verified Heating Cap 17 |
| Heat Pump System 1-hers-htpump | Not Required | 0 | Required | Required | Yes | Yes | Yes | Yes |

VARIABLE CAPACITY HEAT PUMP COMPLIANCE OPTION - HERS VERIFICATION

| 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 | 10 |
|--------------------|----------------------------------|----------------------------|-------------------------------------|-----------------------|--|--|---|------------------------------|-------------------------------------|
| Name | Certified Low-Static VCHP System | Airflow to Habitable Rooms | Ductless Units in Conditioned Space | Wall Mount Thermostat | Air Filter Sizing & Pressure Drop Rating | Low Leakage Ducts in Conditioned Space | Minimum Airflow per RA3.3 and SC3.3.3.4.1 | Certified non-continuous Fan | Indoor Fan not Running Continuously |
| Heat Pump System 1 | Not required | Required | Required | Required | Not required | Not required | Not required | Not required | Not required |

Registration Number: [Redacted] Registration Date/Time: [Redacted] HERS Provider: CZ-5-10
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Schema Version: rev 20220901 Report Generated: 2023-09-26 20:07:46



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONSTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

FOR USE IN THE COUNTY OF SAN LUIS OBISPO
 NOT FOR CONSTRUCTION

COUNTY OF SAN LUIS OBISPO
 ACCESSORY DWELLING UNIT
 SAN LUIS OBISPO, CA
 ENERGY COMPLIANCE - PLAN 3A

APPROVED SET
 DATE: 09/28/2023
 SHEET: T24 - 304

| Item | Requirement | Points | Weight | Score |
|---|---|--------|--------|-------|
| G2 | Install Water-Efficient Fixtures | 2 | 1 | 2 |
| G2.1 | WaterSense Showers/Faucets 1.8 gpm with Matching Compensation Valve | 2 | 1 | 2 |
| G2.2 | WaterSense Bathroom Faucets 1.0 gpm | 1 | 1 | 1 |
| G2.3 | WaterSense Toilets with a Maximum Performance (MP) Threshold of No Less Than 500 Gons/Flush 1.28 gal OR 1.1 gal | 1 | 1 | 1 |
| G3 | Pre-Flush for Graywater System | 0 | 1 | 0 |
| G4 | Operational Graywater System | 0 | 1 | 0 |
| G5 | Thermosetting Shower Valve or Auto-Diversion Tub Spout | 0 | 1 | 0 |
| HEATING, VENTILATION AND AIR CONDITIONING | | | | |
| H1 | Sealed Combustion Units | 0 | 1 | 0 |
| H1.1 | Sealed Combustion Furnace | 0 | 1 | 0 |
| H1.2 | Sealed Combustion or Heat Pump Water Heater | 0 | 2 | 0 |
| H2 | High Performing Zoned Hydronic Radiant Heating System | 0 | 1 | 0 |
| H3 | Effective Ductwork | 0 | 1 | 0 |
| H3.1 | Duct Insulation on Duct Joints and Seams | 0 | 1 | 0 |
| H3.2 | Pressure Balance the Ductwork System | 0 | 1 | 0 |
| H4 | ENERGY STAR® Bathroom Fans Per HV1 Standards with Air Flow Verified | 0 | 1 | 0 |
| H5. Advanced Practices for Cooling | | | | |
| H5.1 | ENERGY STAR® Ceiling Fans in Living Areas and Bedrooms | 0 | 1 | 0 |
| H6. Whole House Mechanical Ventilation Practices to Improve Indoor Air Quality | | | | |
| H6.1 | Meet ASHRAE 62.2-2015 Ventilation Residential Standards | Y | 1 | 1 |
| H6.2 | Advanced Ventilation Standards | 0 | 2 | 0 |
| H6.3 | Outdoor Air is Filtered and Tempered | 0 | 1 | 0 |
| H7. Effective Range Hood Design and Installation | | | | |
| H7.1 | Effective Range Hood Ducting and Design | 0 | 1 | 0 |
| H7.2 | Automatic Range Hood Control | 0 | 1 | 0 |
| H8. High Efficiency HVAC Filter (MERV 16+) | | | | |
| H8.1 | Advanced Refrigerators | 0 | 1 | 0 |
| H8.2 | No Fireplace or Sealed Gas Fireplace | 1 | 1 | 1 |
| H8.3 | Humidity Control Systems | 0 | 1 | 0 |
| H12 | Register Design Per ACCA Manual T | 0 | 1 | 0 |
| RENEWABLE ENERGY | | | | |
| E1 | Onsite Renewable Generation (Solar PV, Solar Thermal, and Wind) | 25 | 25 | 25 |
| I2. Low Carbon Homes | | | | |
| I2.1 | Near Zero Energy Home | 2 | 2 | 2 |
| I2.2 | Low Carbon Home | 0 | 4 | 0 |
| I3. Energy Storage | | | | |
| I4 | Solar Hot Water Systems to Preheat Domestic Hot Water | 0 | 4 | 0 |
| BUILDING PERFORMANCE AND TESTING | | | | |
| J1 | Third-Party Verification of Quality of Insulation Installation | 0 | 1 | 0 |
| J2 | Supply and Return Air Flow Testing | 0 | 1 | 0 |
| J3 | Mechanical Ventilation Testing | 0 | 1 | 0 |
| J4 | All Electric or Combustion Appliance Safety Testing | 0 | 1 | 0 |
| J5 | Building Performance Exceeds Title 24 Part 6 | 0 | 1 | 0 |
| J6 | Home Outperforms Title 24 Part 6 | 1 | 1 | 1 |
| J7 | Title 24 Prepared and Signed by a CABEC Certified Energy Analyst | 0 | 1 | 0 |
| J8 | Participation in Utility Program with Third-Party Plan Review | 0 | 1 | 0 |
| J9 | ENERGY STAR® for Homes | 0 | 1 | 0 |
| J9.1 | EPA Indoor airPlus Certification | 0 | 1 | 0 |
| J10 | Blower Door Testing | 0 | 1 | 0 |
| FINISHES | | | | |
| K1 | Entrways Designed to Reduce Tracked-In Contaminants | 0 | 1 | 0 |

| Item | Requirement | Points | Weight | Score |
|---|--|--------|--------|-------|
| C13 | Reduced Light Pollution | 1 | 1 | 1 |
| C14 | Large Stature Trees | 0 | 1 | 0 |
| C15 | Third Party Landscape Program Certification | 0 | 1 | 0 |
| C16 | Maintenance Contract with Certified Professional | 0 | 1 | 0 |
| STRUCTURAL FRAME AND BUILDING ENVELOPE | | | | |
| D1 | Optimal Water Engineering | 0 | 1 | 0 |
| D1.1 | Joists, Rafters, and Studs at 24 Inches on Center | 0 | 1 | 0 |
| D1.2 | Non-Load Bearing Door and Window Headers Sized for Load | 0 | 1 | 0 |
| D1.3 | Advanced Framing Measures | 0 | 2 | 0 |
| D3 | Construction Material Efficiencies | 0 | 1 | 0 |
| D3.1 | Engineered Lumber | 0 | 1 | 0 |
| D3.2 | Engineered Beams and Headers | 0 | 1 | 0 |
| D3.3 | Wood Joists or Web Trusses for Floors | 0 | 1 | 0 |
| D3.4 | OSB for Subfloor | 0.5 | 0.5 | 0.5 |
| D3.5 | OSB for Wall and Roof Sheathing | 0.5 | 0.5 | 0.5 |
| D4 | Insulated Headers | 0 | 1 | 0 |
| D5 | FSC-Certified Wood | 0 | 1 | 0 |
| D5.1 | Dimensional Lumber, Studs, and Timber | 0 | 1 | 0 |
| D5.2 | Panel Products | 0 | 1 | 0 |
| D6 | Solid Wall Systems | 0 | 1 | 0 |
| D6.1 | At Least 90% of Floors | 0 | 1 | 0 |
| D6.2 | At Least 90% of Exterior Walls | 0 | 1 | 0 |
| D6.3 | At Least 90% of Roofs | 0 | 1 | 0 |
| D7 | Energy Heats on Roof Trusses | 0 | 1 | 0 |
| D8 | Overhangs and Gutters | 1 | 1 | 1 |
| D8.1 | Detached Garage | 0 | 2 | 0 |
| D8.2 | Mitigation Strategies for Attached Garage | 0 | 1 | 0 |
| D10 | Structural Pest and Rot Controls | 1 | 1 | 1 |
| D10.1 | All Wood Located At Least 12 Inches Above the Soil | 1 | 1 | 1 |
| D10.2 | Wood Framing Trusses With Borates or Factory-Integrated, or Wall Materials Other Than Wood | 0 | 1 | 0 |
| D11 | Mold-Resistant Materials in Wet Areas (such as Kitchen, Bathrooms, Utility Rooms, and Basements) | 2 | 1 | 1 |
| EXTERIOR | | | | |
| E1 | Environmentally Preferable Decking | 0 | 1 | 0 |
| E2 | Flashing Installation Third-Party Verified | 0 | 2 | 0 |
| E3 | Rain Screen Wall System | 0 | 2 | 0 |
| E4 | Durable and Non-Combustible Cladding Materials | 1 | 1 | 1 |
| E5 | Durable Roofing Materials | 1 | 1 | 1 |
| E5.1 | Durable and Fire Resistant Roofing Materials or Assembly | 1 | 1 | 1 |
| E6 | Vegetated Roof | 0 | 2 | 0 |
| INSULATION | | | | |
| F1 | Insulation with 30% Post-Consumer or 60% Post-Industrial Recycled Content | 0 | 1 | 0 |
| F1.1 | Walls and Floors | 0 | 0.5 | 0 |
| F1.2 | Ceilings | 0 | 0.5 | 0 |
| F2 | Insulation that Meets the CDPH Standard Method—Residential for Low Emissions | 0 | 1 | 0 |
| F2.1 | Walls and Floors | 0 | 0.5 | 0 |
| F2.2 | Ceilings | 0 | 0.5 | 0 |
| F3 | Low GWP Insulation That Does Not Contain Fire Retardants | 0 | 1 | 0 |
| F3.1 | Cavity Walls and Floors | 0 | 1 | 0 |
| F3.2 | Ceilings | 0 | 1 | 0 |
| F3.3 | Interior and Exterior | 0 | 1 | 0 |
| PLUMBING | | | | |
| G1 | Efficient Distribution of Domestic Hot Water | 1 | 1 | 1 |
| G1.1 | Insulated Hot Water Pipes | 1 | 1 | 1 |
| G1.2 | WaterSense Volume Limit for Hot Water Distribution | 0 | 1 | 0 |
| G1.3 | Increased Efficiency in Hot Water Distribution | 0 | 1 | 0 |

| Item | Requirement | Points | Weight | Score |
|-------------------|---|--------|--------|-------|
| A1 | Construction Footprint | 0 | 1 | 0 |
| A2 | Job Site Construction Waste Diversion | 2 | 2 | 2 |
| A2.1 | 70% C&D Waste Diversion (Including Alternative Daily Cover) | 2 | 2 | 2 |
| A2.2 | Recycling Rates from Third-Party Verified Mixed-Use Waste Facility | 0 | 1 | 0 |
| A3 | Recycled Content Base Material | 1 | 1 | 1 |
| A4 | Heat Island Effect Reduction (Non-Roof) | 0 | 1 | 0 |
| A5 | Construction Environmental Quality Management Plan Including Flush-Out | 2 | 2 | 2 |
| A6 | Stormwater Control: Prescriptive Path (water capped at 3 points) | 0 | 3 | 0 |
| A6.1 | Permeable Paving Material | 0 | 1 | 0 |
| A6.2 | Filteration and/or Bio-Retention Features | 1 | 1 | 1 |
| A6.3 | Non-Leaching Roofing Materials | 1 | 1 | 1 |
| A6.4 | Smart Stormwater Street Design | 0 | 1 | 0 |
| A7 | Stormwater Control: Performance Path | 0 | 3 | 0 |
| FOUNDATION | | | | |
| B1 | Fly Ash and/or Slag in Concrete | 1 | 1 | 1 |
| B2 | Radon-Resistant Construction | 0 | 2 | 0 |
| B3 | Foundation Drainage System | 0 | 2 | 0 |
| B4 | Moisture Controlled Crawlspace | 0 | 1 | 0 |
| B5 | Structural Pest Controls | 0 | 1 | 0 |
| B5.1 | Termite Shields and Separated Exterior Wood-to-Concrete Connections | 0 | 1 | 0 |
| B5.2 | Plan Traps, Screens, or Beams at Least 36 Inches from the Foundation | 0 | 1 | 0 |
| LANDSCAPE | | | | |
| C1 | Plants Grouped by Water Needs (Hydrozoning) | 0 | 1 | 0 |
| C2 | Three Inches of Mulch in Planting Beds | 0 | 1 | 0 |
| C3 | Resource Efficient Landscapes | 0 | 1 | 0 |
| C3.1 | Use Invasive Species Listed by Cal-IPC | 0 | 1 | 0 |
| C3.2 | Plants Chosen and Located to Grow in Natural Site | 0 | 1 | 0 |
| C3.3 | Drought Tolerant, California Native, Mediterranean Species, or Other Appropriate Species | 0 | 1 | 0 |
| C4 | No Turf on Slopes Exceeding 10% and No Overhead Sprinklers Installed in Areas Less Than Eight Feet Wide | 2 | 2 | 2 |
| C4.1 | Turf on a Small Percentage of Landscaped Area | 0 | 2 | 0 |
| C4.2 | Turf on a Small Percentage of Landscaped Area | 0 | 2 | 0 |
| C5 | Trees to Moderate Building Temperature | 0 | 1 | 0 |
| C6 | High-Efficiency Irrigation System | 0 | 2 | 0 |
| C7 | One Inch of Compost in the Top Six to Twelve Inches of Soil | 0 | 2 | 0 |
| C8 | Rainwater Harvesting System | 0 | 3 | 0 |
| C9 | Recycled Wastewater Irrigation System | 0 | 1 | 0 |
| C10 | Submeter or Dedicated Meter for Landscape Irrigation | 0 | 2 | 0 |
| C11 | Landscape Meets Water Budget | 0 | 1 | 0 |
| C12 | Environmentally Preferable Materials for Site Elements and Fencing | 0 | 1 | 0 |
| C12.1 | Environmentally Preferable Materials for 70% of Non-Peat Landscape Elements and Fencing | 0 | 1 | 0 |

| Item | Requirement | Points | Weight | Score |
|--|--|--------|--------|-------|
| N5.1 | Responsible Entry with Views to Caltrans | 1 | 1 | 1 |
| N5.2 | Entrances Visible from Street and/or Other Front Doors | 0 | 1 | 0 |
| N5.3 | Parties Oriented to Street and Public Space | 0 | 1 | 0 |
| N6. Passive Solar Design | | | | |
| N6.1 | Heating Load | 1 | 1 | 1 |
| N6.2 | Cooling Load | 1 | 2 | 1 |
| N7. Adaptable Building | | | | |
| N7.1 | Universal Design Principles in Units | 0 | 1 | 0 |
| N7.2 | Full-Function Independent Ramps | 0 | 1 | 0 |
| N8. Resiliency | | | | |
| N8.1 | Assessment | 0 | 1 | 0 |
| N8.2 | Strategies to Address Assessment Findings | 0 | 1 | 0 |
| N9. Social Equity to Community | | | | |
| N9.1 | Equity Workforce | 0 | 1 | 0 |
| N9.2 | Community Location | 0 | 1 | 0 |
| OTHER | | | | |
| O1 | GreenPoint Rated Checklist in Blueprints | Y | 1 | 1 |
| O2 | Pre-Construction Kickoff Meeting with Rater and Subcontractors | 2 | 0.5 | 1 |
| O3 | Orientation and Training to Occupants—Conduct Educational Walkthroughs | 0 | 0.5 | 0 |
| O4 | Builder's or Developer's Management Staff are Certified Green Building Professionals | 0 | 0.5 | 0 |
| O5 | Home System Monitors | 0 | 1 | 0 |
| O5.1 | Energy Home System Monitors | 0 | 1 | 0 |
| O5.2 | Water Home System Monitors | 0 | 1 | 0 |
| O6. Green Building Education | | | | |
| O6.1 | Marketing Green Building | 2 | 2 | 2 |
| O6.2 | Green Building Signage | 0 | 0.5 | 0 |
| O7 | Green Appraisal Addendum | Y | 1 | 1 |
| O8 | Detailed Durability Plan and Third-Party Verification of Plan Implementation | 0 | 1 | 0 |
| Summary | | | | |
| Total Available Points in Specific Categories | | 26.5 | 30 | 76.5 |
| Minimum Points Required in Specific Categories | | 0 | 0 | 0 |
| Total Points Achieved | | 76.5 | 6.0 | 38.5 |

| Item | Requirement | Points | Weight | Score |
|---|---|--------|--------|-------|
| K1 | Individual Entrways | 1 | 1 | 1 |
| K2 | Zero-VOC Interior Wall and Ceiling Paints | 2 | 2 | 2 |
| K3 | Low-VOC Caulks and Adhesives | 1 | 1 | 1 |
| K4. Environmentally Preferable Materials for Interior Finish | | | | |
| K4.1 | Cabinets | 0 | 2 | 0 |
| K4.2 | Interior Trim | 0 | 2 | 0 |
| K4.3 | Shelving | 0 | 2 | 0 |
| K4.4 | Doors | 0 | 2 | 0 |
| K4.5 | Countertops | 0 | 1 | 0 |
| K5. Formaldehyde Emissions in Interior Finish Exceed CARB | | | | |
| K5.1 | Doors | 0 | 1 | 0 |
| K5.2 | Cabinets and Countertops | 0 | 2 | 0 |
| K5.3 | Interior Trim and Shelving | 0 | 2 | 0 |
| K6. Products That Comply With the Health Product Declaration Open Standard | | | | |
| K7 | Indoor Air Formaldehyde Level Less Than 27 Parts Per Billion | 0 | 2 | 0 |
| K8 | Comprehensive Inclusion of Low Emitting Finishes | 0 | 1 | 0 |
| LOADING | | | | |
| L1 | Environmentally Preferable Flooring | 0 | 3 | 0 |
| L2 | Low-Emitting Flooring Meets CDPH 2010 Standard Method—Residential | 1 | 3 | 1 |
| L3 | Durable Flooring | 1 | 1 | 1 |
| L4 | Thermal Mass Flooring | 1 | 1 | 1 |
| APPLIANCES AND LIGHTING | | | | |
| M1 | ENERGY STAR® Dishwasher | 1 | 1 | 1 |
| M2. Efficient Laundry Appliances | | | | |
| M2.1 | CEE Tier 2 | 2 | 1 | 2 |
| M2.2 | ENERGY STAR® Dryer | 2 | 1 | 2 |
| M2.3 | Solar Dryer Laundry Lines | 0 | 0.5 | 0 |
| M3. Size-Efficient ENERGY STAR® Refrigerator | | | | |
| M4 | Permanent Centers for Waste Reduction Strategies | 2 | 2 | 2 |
| M4.1 | Bulk-In Recycling Center | 1 | 1 | 1 |
| M4.2 | Bulk-In Composting Center | 0 | 1 | 0 |
| M5. Lighting Efficiency | | | | |
| M5.1 | High-Efficiency Lighting | 2 | 2 | 2 |
| M5.2 | Lighting System Designed to IESNA Footcandle Standards or Designed by Lighting Consultant | 0 | 2 | 0 |
| COMMUNITY | | | | |
| N1 | Smart Development | 0 | 1 | 0 |
| N1.1 | IFES Site | 0 | 1 | 0 |
| N1.2 | Designated Brownfield Site | 0 | 1 | 0 |
| N1.3 | Conserve Resources by Increasing Density | 0 | 2 | 0 |
| N1.4 | Cluster Homes for Land Preservation | 0 | 1 | 0 |
| N1.5 | Home Size Efficiency | 0 | 1 | 0 |
| N2 | Home(s) Development Located Near Transit | 0 | 1 | 0 |
| N2.1 | 1/1 Within 1 Mile of a Major Transit Stop | 0 | 1 | 0 |
| N2.2 | 1/2 Within 1/2 Mile of a Major Transit Stop | 0 | 2 | 0 |
| N3. Pedestrian and Bicycle Access | | | | |
| N3.1 | Pedestrian Access to Services Within 1/2 Mile of Community Services | 2 | 2 | 2 |
| N3.2 | Enter the number of Tier 1 services | 0 | 1 | 0 |
| N3.3 | Enter the number of Tier 2 services | 0 | 1 | 0 |
| N3.4 | Connection to Pedestrian Pathways | 1 | 1 | 1 |
| N3.5 | Traffic Calming Strategies | 2 | 2 | 2 |
| N4. Outdoor Gathering Places | | | | |
| N4.1 | Public or Semi-Public Outdoor Gathering Places for Residents | 1 | 1 | 1 |
| N4.2 | Public Outdoor Gathering Places with Direct Access to Tier 1 Community Services | 1 | 1 | 1 |
| N5. Social Interaction | | | | |



THESE PLANS ARE PROVIDED BY THE COUNTY OF SAN LUIS OBISPO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRIBUTE THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

FOR USE IN THE COUNTY OF SAN LUIS OBISPO
NOT FOR CONSTRUCTION

COUNTY OF SAN LUIS OBISPO
ACCESSORY DWELLING UNIT
SAN LUIS OBISPO, CA

ENERGY COMPLIANCE - PLAN 3

APPROVED SET

DATE
09/28/2023

SHEET

T24 - 313