

# Well 23 Replacement Project


The City of Pismo Beach is replacing the failing Well 23 to secure reliable groundwater and reduce dependence on surface water supplies.

## Reliance on Surface Water Deliveries

**IMPORTANT INFORMATION ABOUT YOUR DRINKING WATER**  
Este aviso contiene información muy importante sobre su agua potable. Para una copia en español, favor de llamar al sistema de agua (805) 781-5111.  
County of San Luis Obispo Lopez Project - CA4010022 April 30, 2025


**BOIL WATER NOTICE**

Lopez Pipeline Boil Water Notice

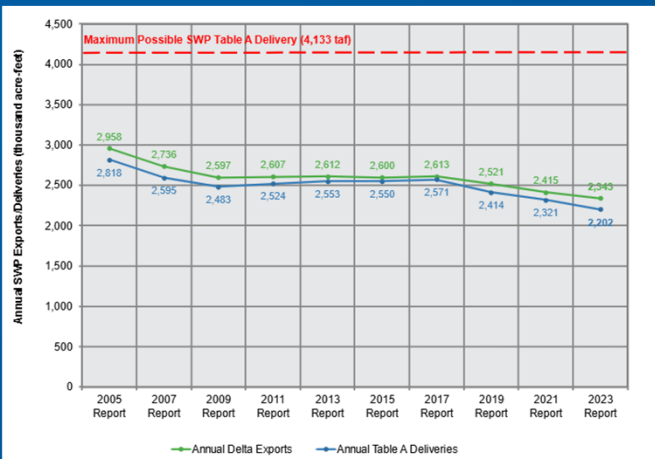


DWR SWP Supply projections

## Well 23 High Risk of Failure

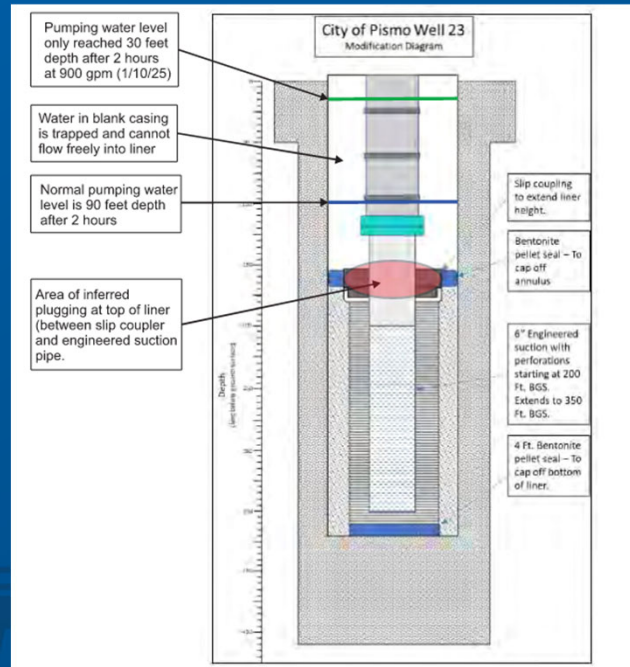

Current Conditions and Plugging of Well 23 By Cleath Harris Geologists

## Reduced Capacity Due to Sand Production

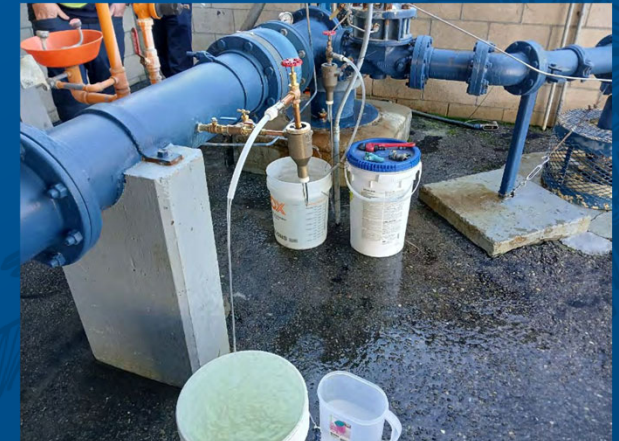

Sand Testing By Cleath Harris Geologists



# \$1 M Funding Request for Phase I – Well Drilling

The City is at risk of losing


**720 GPM**  
or  
**1 MGD**

of groundwater production

The City can only meet

**43%**

of peak demand with groundwater

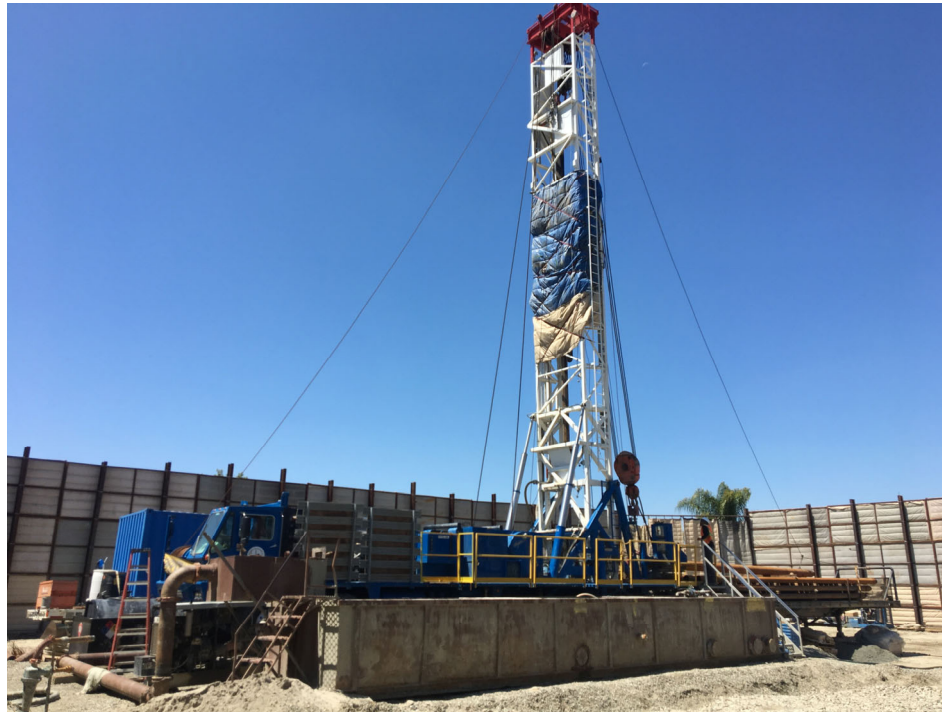

The new well provides

**280 GPM**  
or  
**0.4 MGD**

of increased groundwater  
production

With the new well, the City can  
meet

**52%**

of peak demand with groundwater

